



中国国家强制性产品认证证书

证书编号：2024010305656857

认证委托人名称及地址

ABB France

11 Rue d' Arsonval 69680, Chassieu, FRANCE

生产者名称及地址

ABB France

11 Rue d' Arsonval 69680, Chassieu, FRANCE

生产企业名称及地址

Linaset a. s.

Ceskoslovenske armady 362, Budisov 74787 nad Budisovkou Czech Republic

产品名称和系列、型号、规格

辅助触点

CAL4-**, CA4-**, CC4-**; 详见参数附页

产品标准和技术要求

GB/T 14048.5-2017

上述产品符合《强制性产品认证实施规则 低压电器 低压元器件》
(CNCA-C03-02:2024) 的要求，特发此证。

发证日期：2024年07月12日 有效期至：2029年07月11日

证书信息和有效性可扫描下方二维码或登录发证机构网站查验，
也可在认监委网站 (www.cnca.gov.cn) 查询。



签发：

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE



中国质量认证中心有限公司



中国国家强制性产品认证证书

证书编号：2024010305656857

证书附页：第 1 页 共 3 页

CAL4-**, CA4-**, CC4-**

Ui: 690V;

Uimp: 6kV;

Ith: 16A;

AC-15:Ue/Ie: AC24-127V/6A,AC220-240V/4A,AC380-440V/3A,

AC500-690V/2A;

DC-13:Ue/Ie: DC24V/6A,DC48V/4A,DC72V/1A,DC110-125V/0.55A,

DC220-250V/0.27A,DC400V/0.15A,DC500V/0.13A,

DC600V/0.1A;

外壳防护等级:IP20

(注:AC24V-36V,DC24V 不在 CCC 认证范围内)

本页为证书附页，应与证书主页同时使用。



中国质量认证中心

CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



中国国家强制性产品认证证书

证书编号: 2024010305656857

证书附页: 第 2 页 共 3 页

型号的解释:

NOMENCLATURE:命名法

CA4 10 **

I II III

I - Main designation 辅助触点代号

CA4 Auxiliary contacts module, front mounted CA4 正面安装

II - Auxiliary Pole Construction 触点对数

01 - 1 normally closed auxiliary pole provided. 1 对常闭触点

10 - 1 normally opened auxiliary pole provided. 1 对常开触点

III - Connection type 接线方式

Blank = Screw type connection 空白 = 螺钉接线

K = Push-In connection K = 插入式

S = Spring type connection S = 弹簧式

NOMENCLATURE: 命名法

CAL411 **

I II III

I - Main designation 辅助触点代号

CAL4 Auxiliary contacts module, lateral mounted 横向安装

II - Auxiliary Pole Construction 触点对数

11 - 1 normally opened and 1 normally closed auxiliary poles. 11: 1 对常开触点和 1 对常闭触点

III - Connection type

Blank = Screw type connection

K = Push-In connection

S = Spring type connection

RT = Ring Tongue connection

NOMENCLATURE: 命名法

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



中国国家强制性产品认证证书

证书编号: 2024010305656857

证书附页: 第 3 页 共 3 页

CC4 10 **

I II III

I - Main designation 辅助触点代号

CC4 Auxiliary contacts module, front mounted, with NO leading contact or NC lagging contact

CC4 正面安装, 带有 NO 超前触点或 NC 滞后触点

II - Auxiliary Pole Construction 触点对数

01 - 1 normally closed auxiliary pole provided. 1 对常闭触点

10 - 1 normally opened auxiliary pole provided. 1 对常开触点

III - Connection type 接线方式

Blank = Screw type connection 空白 = 螺钉式

List of type 型号列表

Designation
CA4-01
CA4-01K
CA4-01S
CA4-10
CA4-10K
CA4-10S
CAL4-11
CAL4-11K
CAL4-11S
CAL4-11RT
CC4-01
CC4-10

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心

CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO.: 2024010305656857

NAME AND ADDRESS OF THE APPLICANT

ABB France
11 Rue d'Arsonval 69680, Chassieu, FRANCE

NAME AND ADDRESS OF THE MANUFACTURER

ABB France
11 Rue d'Arsonval 69680, Chassieu, FRANCE

NAME AND LOCATION OF THE FACTORY

Linaset a.s.
Ceskoslovenske armady 362, Budisov 74787 nad Budisovkou Czech Republic

PRODUCT NAME,MODEL AND SPECIFICATION

Auxiliary Contacts
CAL4-**, CA4-**, CC4-** ; See the Appendix

STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 14048.5-2017

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification(REFNO. CNCA-C03-02:2024).

Valid from: Jul.12,2024

Valid until: Jul.11,2029

The certificate information and validity could be checked by scanning the QR code below or logging in to the website of the issuing authority, or on the website of the CNCA (www.cnca.gov.cn).



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.





CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO. : 2024010305656857

Appendix: Page 1 of 1

CAL4-**, CA4-**, CC4-**

Ui: 690V;

Uimp: 6kV;

Ith: 16A;

AC-15:Ue/Ie: AC24-127V/6A,AC220-240V/4A,AC380-440V/3A,

AC500-690V/2A;


DC-13:Ue/Ie: DC24V/6A,DC48V/4A,DC72V/1A,DC110-125V/0.55A,

DC220-250V/0.27A,DC400V/0.15A,DC500V/0.13A,

DC600V/0.1A;

IP20

(AC24V-36V,DC24VNot within the scope of CCC certification)

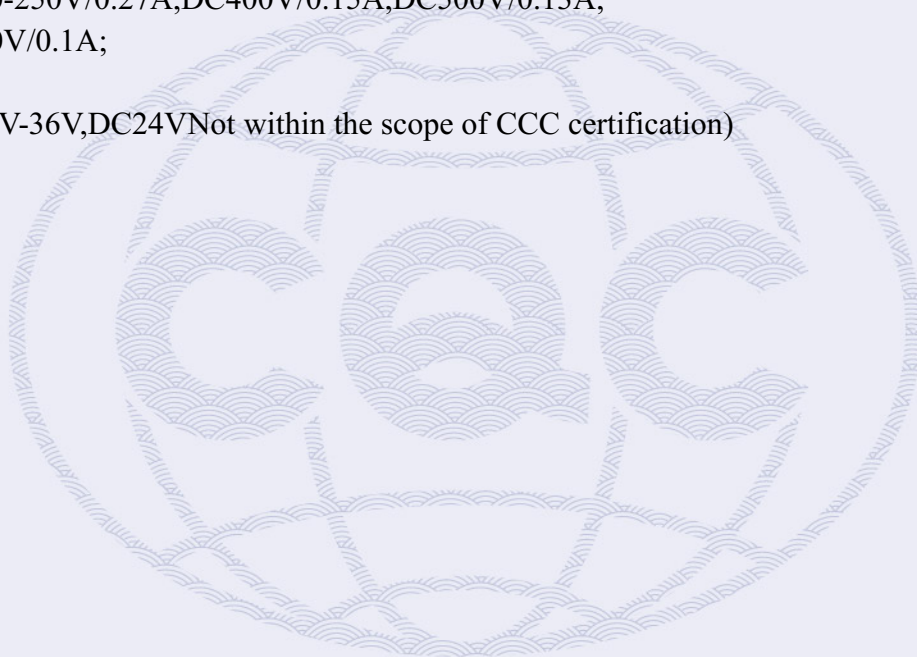

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.