




Similar to illustration

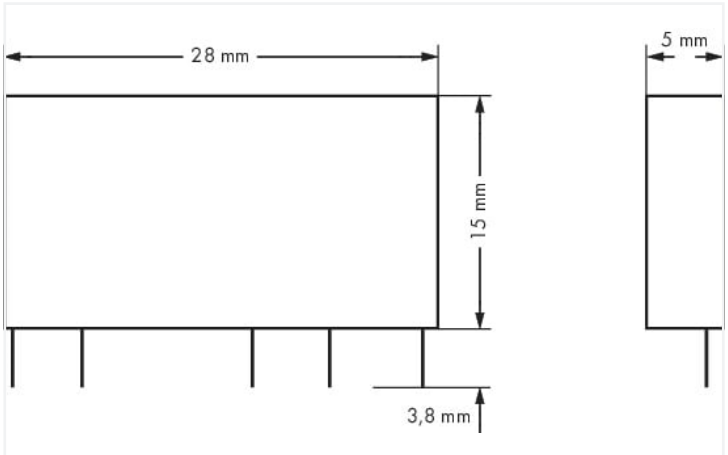

Dimensions in mm

Notes	
Note	Optocouplers and solid state relays are designed for use in signal processing networks, which are not supplied by the low-voltage power supply networks.

Technical data			
Control circuit		Load circuit	
Nominal input voltage U_N	DC 60 V	Circuit type	2-wire connection
Input voltage range (low level)	DC 0 ... 10 V	Limiting continuous current	0.1 A
Input voltage range (high level)	DC 35 ... 72 V	Nominal output voltage	DC 24 V
Nominal input current at U_N	3 mA	Output voltage range	DC 0 ... 48 V
		Voltage drop	≤ 1 VDC
		Leakage current at rated voltage	$\leq 1 \mu\text{A}$
		Switching current (min.)	50 μA
		Turn-on time	$\leq 100 \mu\text{s}$
		Turn-off time	$\leq 600 \mu\text{s}$
		Switching frequency	≤ 1 kHz

Safety and protection	
Dielectric strength (control/load circuit) (AC, 1 min)	3.75 kVrms

Physical data	
Width	5 mm / 0.197 inches
Height from the surface	15 mm / 0.591 inches
Depth	28 mm / 1.102 inches



Mechanical data	
Mounting type	Pluggable module

Material data	
Fire load	0 MJ
Weight	4.6 g

Environmental requirements	
Ambient temperature (operation at U _N)	-30 ... +80 °C
Ambient temperature (storage)	-40 ... +100 °C
Relative humidity	5 ... 95 % (no condensation permissible)
Operating altitude (max.)	2000 m

Commercial data	
Product Group	6 (INTERFACE ELECTRONIC)
eCl@ss 10.0	27-26-15-03
eCl@ss 9.0	27-26-15-03
ETIM 8.0	EC001504
ETIM 7.0	EC001504
PU (SPU)	20 pcs
Packaging type	Box
Country of origin	IT
GTIN	4045454997663
Customs tariff number	85365005000

Environmental Product Compliance	
RoHS Compliance Status	Compliant,No Exemption

Approvals / Certificates

General approvals



Approval	Standard	Certificate Name
UL Underwriters Laboratories Inc.	UL 508	E340707

Downloads

Environmental Product Compliance

Compliance Search			
Environmental Product Compliance 857-165			

Documentation

Bid Text			
857-165	19.02.2019	xml 3.41 KB	
857-165	29.11.2018	doc 26.00 KB	

CAD/CAE-Data

CAE data			
EPLAN Data Portal 857-165			
WSCAD Universe 857-165			

Installation Notes

Installation



Removing a relay via ejector.