




**Mindestkabellänge  
Minimum cable length  
Moindre encablure**

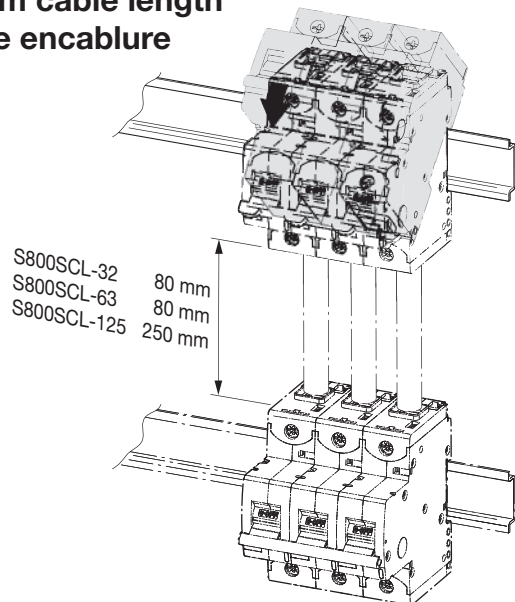



- (D)** Eine kurzschlussfeste Verbindung ist zu verwenden.
- (F)** La connection doit être protégée contre les court circuits (câbles double isolation)
- (GB)** Connection between has to be short-circuit proof „double insulated cable“.
- (I)** La connessione deve essere resistente al corto circuito (doppio isolamento)

4

**Test**

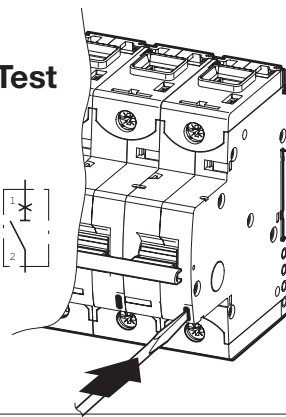

**Reset**

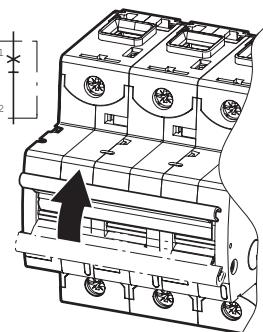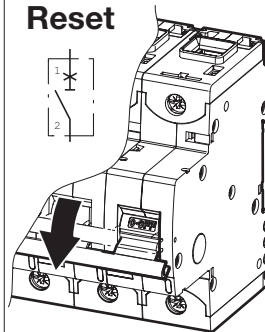

5



**Warning!** Installation by person with electro technical expertise only.

**Warnung!** Installation nur durch elektrotechnische Fachkraft.

**Avvertenza!** Fare installare solo da un elettricista qualificato.

**Avertissement!** Installation uniquement par des personnes qualifiées en électrotechnique.

**Advertencia!** La instalación deberá ser realizada únicamente por electricistas especializados.