
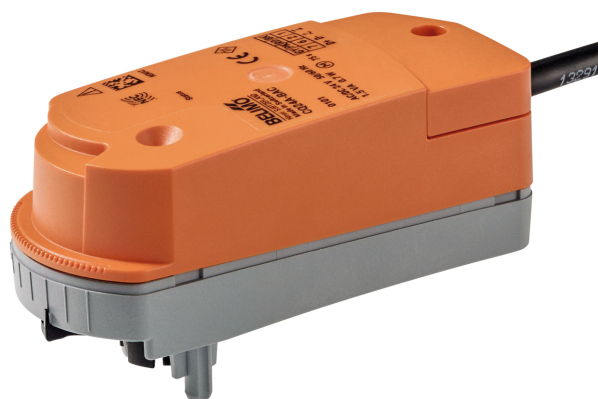


Communicative rotary actuator for zone valves

- Torque motor 1 Nm
- Nominal voltage AC/DC 24 V
- Control communicative
- Snap-assembly of the actuator
- Flow setting variable
- Communication via BACnet MS/TP or Modbus RTU


Technical data

| | | |
|-------------------------------|--|--|
| Electrical data | Nominal voltage | AC/DC 24 V |
| | Nominal voltage frequency | 50/60 Hz |
| | Nominal voltage range | AC 19.2...28.8 V / DC 21.6...28.8 V |
| | Power consumption in operation | 0.7 W |
| | Power consumption in rest position | 0.6 W |
| | Power consumption for wire sizing | 1.5 VA |
| | Connection supply / control | Cable 1 m, 4x 0.34 mm ² |
| Data bus communication | Communicative control | BACnet MS/TP (factory setting) Modbus RTU |
| | Number of nodes | BACnet / Modbus see interface description |
| Functional data | Torque motor | 1 Nm |
| | Manual override | with actuator (clicked out) |
| | Running time motor | 75 s / 90° |
| | Sound power level, motor | 35 dB(A) |
| | Position indication | Yes |
| | Flow setting | see product features |
| Safety data | Protection class IEC/EN | III, Safety Extra-Low Voltage (SELV) |
| | Degree of protection IEC/EN | IP40 |
| | EMC | CE according to 2014/30/EU |
| | Certification IEC/EN | IEC/EN 60730-1 and IEC/EN 60730-2-14 |
| | Type of action | Type 1 |
| | Rated impulse voltage supply / control | 0.8 kV |
| | Pollution degree | 2 |
| | Ambient humidity | Max. 95% RH, non-condensing |
| | Ambient temperature | 10...40°C [50...104°F] |
| | Storage temperature | -40...80°C [-40...176°F] |
| Servicing | maintenance-free | |
| Weight | Weight | 0.19 kg |


Safety notes



- This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- Outdoor application: only possible in case that no (sea) water, snow, ice, insulation or aggressive gases interfere directly with the device and that it is ensured that the ambient conditions remain within the thresholds according to the data sheet at any time.
- Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied with during installation.
- The device may only be opened at the manufacturer's site. It does not contain any parts that can be replaced or repaired by the user.
- Cables must not be removed from the device.
- The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

Product features

- Mode of operation** The actuator is fitted with an integrated interface for BACnet MS/TP and Modbus RTU, it receives the digital control signal from the control system and returns the current status.
- Simple direct mounting** Tool-free snap assembly.
The actuator can be plugged on the valve by hand (Caution! Just vertical movements). Pins must match the holes on the flange.
The mounting orientation in relation to the valve can be selected in 180° increments. (Possible two times)
- Manual override** Click out the actuator and rotate the valve spindle with the help of the actuator.
- High functional reliability** The actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached.
- Flow setting** The CQ24A-BAC actuator is delivered without an end stop clip. In order to set the kv value (QCV) or the V'max value (PIQCV), the angle-of-rotation limitation can be set on this actuator easily and quickly using the Assistant App or bus communication.
The table below shows the corresponding values in percent and degrees for the clip positions listed in the zone valve data sheets.
Adjustable kv values (C2..Q-.., C4..Q-..) / V'max values (C2..QP(T)-..) are given in the respective zone valve data sheets.

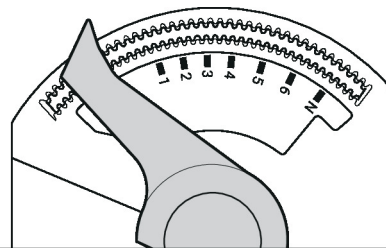

| Pos | 1 | 2 | 3 | 3+ | 4- | 4 | 4+ | 5- | 5 | 5+ | 6- | 6 | 6+ | N- | N | max. |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|------|
| Bus | 41% | 49% | 56% | 60% | 63% | 66% | 68% | 71% | 74% | 77% | 79% | 82% | 85% | 88% | 91% | 100% |
| ↔ | 37° | 44° | 51° | 54° | 57° | 59° | 61° | 64° | 67° | 69° | 71° | 74° | 77° | 79° | 82° | 90° |

Accessories

| Mechanical accessories | Description | Type |
|------------------------|--|-------|
| | Spindle extension CQ | ZCQ-E |
| | Housing cover CQ, Colour: white (RAL 9010) | ZCQ-W |

Accessories

| Tools | Description | Type |
|-------|---|------------------------------------|
| | Belimo Assistant App, Smartphone app for easy commissioning, parametrising and maintenance Converter Bluetooth / NFC | Belimo Assistant App ZIP-BT-NFC |

Electrical installation



The wiring of the line for BACnet MS/TP / Modbus RTU is to be carried out in accordance with applicable RS-485 regulations.

Modbus / BACnet: Supply and communication are not galvanically isolated. Connect earth signal of the devices with one another.

Wire colours:


- 1 = black
- 2 = red
- 6 = pink
- 7 = grey

Functions:


- C1 = D- = A (wire 6)
- C2 = D+ = B (wire 7)

Wiring diagrams

BACnet MS/TP / Modbus RTU

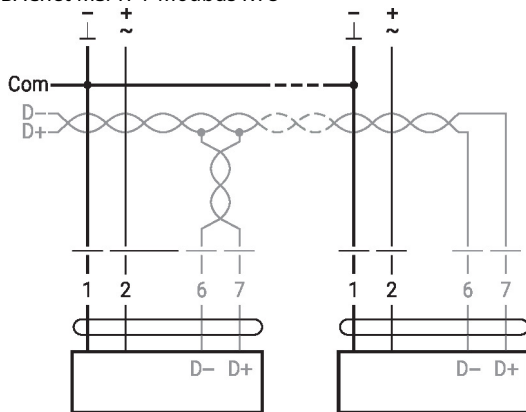

Operating controls and indicators

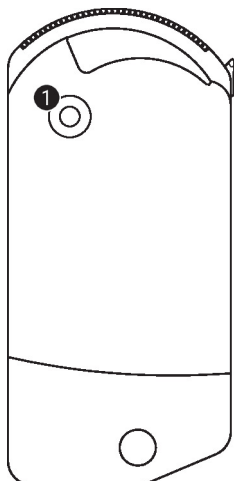

1 LED display yellow

- Off: No power supply or malfunction
- On: In operation
- Flickering: BACnet / Modbus communication active

Service


Tool connection Belimo devices marked with the NFC logo can be operated with the Belimo Assistant App.

Requirement:


- NFC- or Bluetooth-capable smartphone
- Belimo Assistant App (Google Play & Apple AppStore)

Align NFC-capable smartphone on the device so that both NFC antennas are superposed.

Connect Bluetooth-enabled smartphone via the Bluetooth-to-NFC Converter ZIP-BT-NFC to the device. Technical data and operation instructions are shown in the ZIP-BT-NFC data sheet.

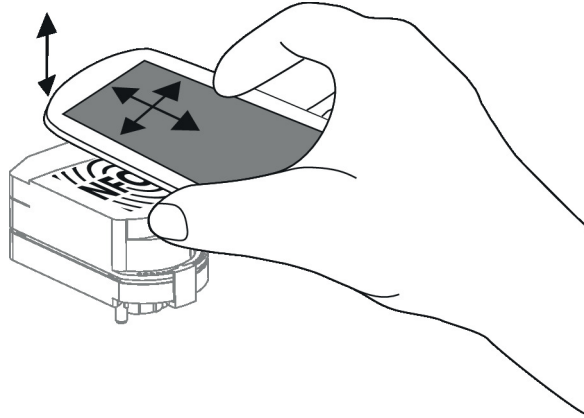

Dimensions

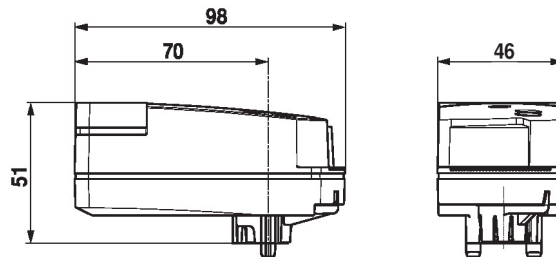

Further documentation

- BACnet Interface description
- Modbus Interface description
- The complete product range for water applications
- Data sheets for zone valves
- Installation instructions for zone valves and actuators
- General notes for project planning
- Notes for project planning for QCV valves
- Notes for project planning for 6-way PI zone valve
- Notes for project planning for pressure-independent zone valve PIQCV
- Notes for project planning for 6-way characterised control valves