



# 产品认证证书

证书编号: CQC2014010304673866

申请人名称及地址

ABB AB, Control Products  
SE-721 61 Vasteras Sweden

制造商名称及地址

ABB AB, Control Products  
SE-721 61 Vasteras Sweden

生产企业名称及地址

ABB 新会低压开关有限公司 (V005372)  
广东省江门市新会区今古洲工业开发区

产品名称和系列、规格、型号

接触器

AF265-30-□□-□□, AF305-30-□□-□□, AF370-30-□□-□□; 型号解释见附件

产品标准和技术要求

GB/T14048.4-2010

认证模式

型式试验+初始工厂检查+获证后监督

上述产品符合 CQC11-462142-2019 认证规则的要求, 特发此证。

发证日期: 2020 年 08 月 14 日      有效期至: 2023 年 11 月 06 日  
证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

主任: \_\_\_\_\_

陆梅



## 中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

C 0351916



# PRODUCT CERTIFICATE

**CERTIFICATE NO.:** CQC2014010304673866

**NAME AND ADDRESS OF THE APPLICANT**

ABB AB,Control Products  
SE-721 61 Vasteras Sweden

**NAME AND ADDRESS OF THE MANUFACTURER**

ABB AB,Control Products  
SE-721 61 Vasteras Sweden

**NAME AND ADDRESS OF THE FACTORY**

ABB Xinhui Low Voltage Switchgear Co.,Ltd. (V005372)  
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

**PRODUCT NAME, MODEL AND SPECIFICATION**

Contactor

AF265-30-□□-□□,AF305-30-□□-□□,AF370-30-□□-□□;See the appendix

**THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS**

GB/T14048.4-2010

**TYPE OF CERTIFICATION SCHEMES**

Type testing of product + initial factory inspection + follow up factory inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC11-462142-2019 .

Valid from: Aug.14,2020

Valid until: Nov.06,2023

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

President: \_\_\_\_\_

陆梅

Lu Mei



**CHINA QUALITY CERTIFICATION CENTRE**

Section 9, No.188, Nansihuan Xilu, Beijing 100070 P.R.China  
<http://www.cqc.com.cn>

C 0351916



# 产品认证证书

附录

第 1 页 共 3 页

证书编号: CQC2014010304673866

纸号: 351916

AF265-30-□□-□□, AF305-30-□□-□□, AF370-30-□□-□□

Ui: 1000V;

Uimp: 8kV;

Ith: 400A, 600A (带扩展型接线端子 LW370);

AF265-30:

AC-3: Ue/Ie: 220-240V/380-415V/440V/265A, 500V/690V/250A, 1000V/113A;

AC-1: Ue/Ie: 220-240V/380-415V/690V/400A (带扩展型接线端子 LW370), 1000V/350A;

AC-4: Ue/Ie: 500V/195A, 690V/153A, 1000V/90A;

AF305-30:

AC-3: Ue/Ie: 220-240V/380-415V/440V/305A, 500V/690V/290A, 1000V/131A;

AC-1: Ue/Ie: 220-240V/380-415V/690V/500A (带扩展型接线端子 LW370), 1000V/375A;

AC-4: Ue/Ie: 500V/230A, 690V/162A, 1000V/95A;

AF370-30:

AC-3: Ue/Ie: 220-240V/380-415V/440V/370A, 500V/350A, 690V/315A, 1000V/141A;

AC-1: Ue/Ie: 220-240V/380-415V/690V/600A (带扩展型接线端子 LW370), 1000V/400A;

AC-4: Ue/Ie: 500V/280A, 690V/188A, 1000V/100A;

极数: 3P;

Us: 24-60V 50/60Hz/20-60V d.c., 48-130V 50/60Hz, d.c., 100-250V 50/60Hz, d.c., 250-500V 50/60Hz, d.c. ;

配用辅助触头: (外置)

CAL19

Ith: 16A;

AC-15: Ue/Ie: 127V/6A, 240V/4A, 400V/440V/3A, 500V/690V/2A;

DC-13: Ue/Ie: 24V/3A, 48V/1.5A, 72V/1A, 110V/125V/0.55A, 220V/250V/0.3A;

注: 此附录与证书同时使用时有效。

主任:

陆梅



## 中国质量认证中心

中国·北京·南四环西路188号9区 100070

<http://www.cqc.com.cn>



# 产品认证证书

附录


第 2 页 共 3 页

证书编号: CQC2014010304673866

纸 号: 351916

1N01NC, 2N02NC

型号解释:

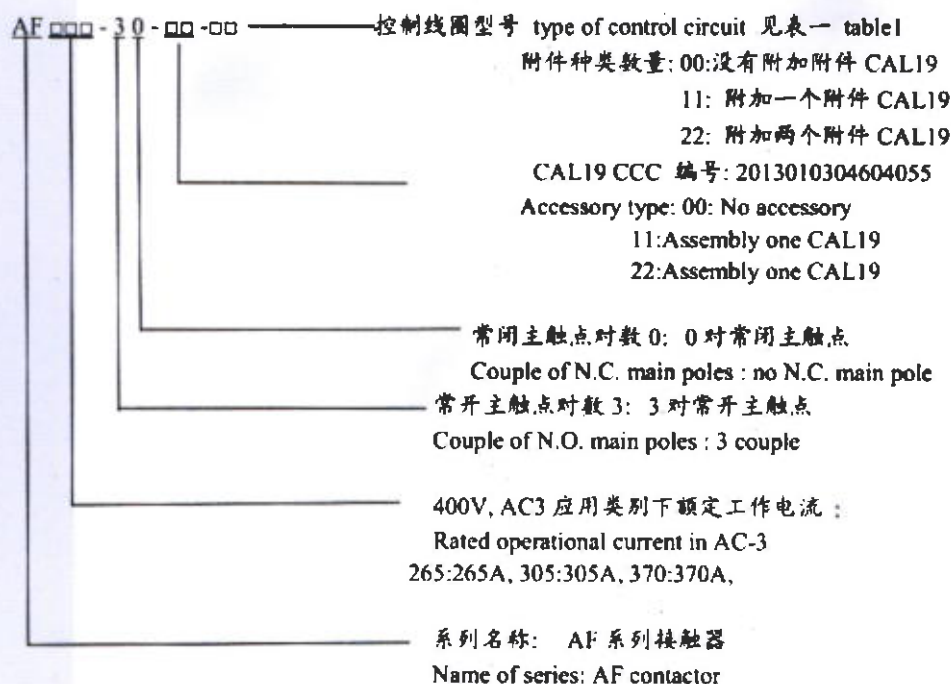

注: 此附录与证书同时使用时有效。

主任: 陆梅



## 中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



# 产品认证证书

附录

第 3 页 共 3 页

证书编号: CQC2014010304673866

纸号: 351916

表一 table1

| 额定工作电压 Rated voltage (V) |            | 线径 (mm)   | 匝数±1%    | 线圈代号 |
|--------------------------|------------|-----------|----------|------|
| DC                       | AC 50/60Hz | Wire dia. | NO. turn | Code |
| 20-60                    | 24-60      | 1.6       | 150      | 11   |
| 48-130                   | 48-130     | 0.9       | 500      | 12   |
| 100-250                  | 100-250    | 0.5       | 900      | 13   |
| 250-500                  | 250-500    | 0.315     | 2000     | 14   |

注: 此附录与证书同时使用时有效。

主任: 陆梅



## 中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>