



PHOTOMETRIC LIGHT REPORT

Emergency wall light IP66 | 5/10W 3-CCT | black | auto test

Article number: 600-050



Go to the
webshop
of Tronix
Lighting



TRONIX



600-050 Emergency wall light IP66 | 5/10W 3-CCT | black | auto test

Introduction

Purpose of this Document

This document provides accurate and objective photometric data for Tronix Lighting item 600-050. All information is based on actual measurements taken from standard production units. No modifications were made to enhance performance results. In some cases, minor adjustments—such as temporary removal of covers, cables, or mounting features—were necessary for testing purposes. These did not influence product performance.

Test Methodology

Testing was conducted using randomly selected, unopened samples from regular inventory. All tests comply with the LM-79-19 standard, the recognized method for photometric and electrical measurements of LED and OLED luminaires. This standard, an update of IES LM-79-2008, outlines environmental test conditions, stabilization procedures, measurement methods, and approved instruments. It uses absolute photometry, meaning results directly reflect the performance of the tested product, without comparison to rated lamp standards.

Product 600-050 was tested using:

- A photogoniometer to measure luminous intensity distribution at various angles
- An integrating sphere to determine total luminous flux and colour characteristics

Compliance & Certification

Item 600-050 meets the requirements of the following EU directives. Tronix Lighting certifies that all relevant tests were executed in accordance with the applicable standards, and the CE mark is applied accordingly:

- General Product Safety – Directive 2023/988/EC
- Low Voltage Directive (LVD) – Directive 2014/35/EU
- Electromagnetic Compatibility (EMC) – Directive 2004/108/EC
- Ecodesign – Directive 2009/125/EC
- RoHS 3 – Directive 2011/65/EU + Amendment 2015/863/EU

Recycling & Sustainability

Tronix Lighting is affiliated with national recycling systems for electrical and electronic waste. The luminaire is over 90% recyclable when disposed of as electronic waste at end of life. In addition, Tronix Lighting participates in national packaging recycling schemes, ensuring full compliance with both the WEEE and packaging directives.





600-050 Emergency wall light IP66 | 5/10W 3-CCT | black | auto test

Laboratory and equipment

Laboratory owner and location	Tronix Lighting BV. Uden. The Netherlands
Gonio spectrometer system and type	Viso Systems Type C. horizontal
Spectrometer manufacturer and model	(Gonio) Ocean Optics STS VIS (Sphere) Admesy HERA VIS 380–780nm
Flicker meter manufacturer and model	Viso Systems LabFlicker
Oscilloscope manufacturer and model	Tektronix MDO3024 oscilloscope (4 Channels. 200 MHz)
Power meter manufacturer and model	Vitretek PA900 Precision Multi-Channel Harmonic Power Analyzer
Power source manufacturer and model	(DC) Keithley Source Measure Unit SMU-2420 3A DC Source Meter (AC) Chroma 61601 AC Source
Datalogger Manufacturer and Model	Omega 8-Channel Thermocouple Thermometer/Data Logger

Measurement conditions gonio spectrometer

Number of C-planes and Resolution	2 planes – 180°
γ (gamma)-Resolution	1°
Test Distance	1.81 m
Room Temperature and Humidity	22°C +/- 10% – RH 50% +/- 20%
Input Power. Power and Displacement Factors	10.0 W – PF 0.84 – DPF 0.87
Frequency of Input Power	50 Hz
Warm-up Time and Variation	Lamp stabilized in 15 min 9 sec – +37.9%

Tested light source

Manufacturer and Order Code	Tronix Lighting – 600-050
Product Description	Emergency wall light IP66 5/10W 3-CCT black auto test

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)	1176 lm – 0% / 100%
Efficiency	118 lm/W
Energy efficiency class	E
Peak Intensity and Beam Angle	341 cd – 128.8°
Correlated Colour Temperature	CCT = 3812 K
Colour Shift. CIE duv	Duv -0.0016
Colour Rendering Index	CRI 83.7
Colour Rendering TM30-18	R _f 84.0 – R _g 95.1
Television Lighting Consistency Index	TLCI = 68
Flicker	SVM 0.26 – PstLM 1.52



600-050 Emergency wall light IP66 | 5/10W 3-CCT | black | auto test


Electrical measurement details

Input Power

RMS Input voltage feed. V_{RMS}	230 V
RMS Input current feed. I_{RMS}	0.052 A
Total input power	10.0 W
Frequency of input power	50 Hz
Power factor	0.84
Displacement power factor	0.87
Total harmonic distortion of the current	23.85%
Total harmonic distortion of the voltage	2.71%

Input Power Curve

Voltage - Current

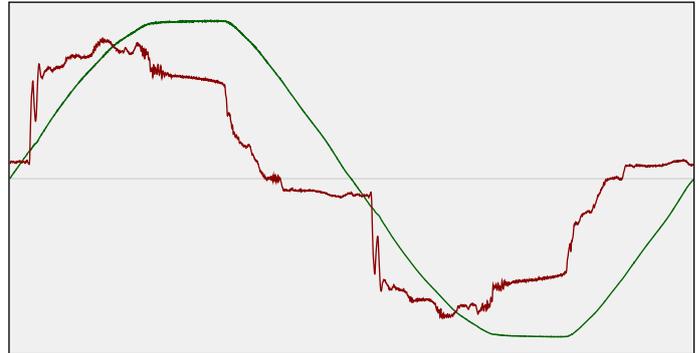

Efficiency

Radiated power efficiency: 35.5%




Lumen efficiency: 118 lm/W



Harmonics

3rd Harmonic	14.4%
5th Harmonic	15.28%
7th Harmonic	3.62%
9th Harmonic	6.91%
11th Harmonic	2.96%

Current Harmonics %

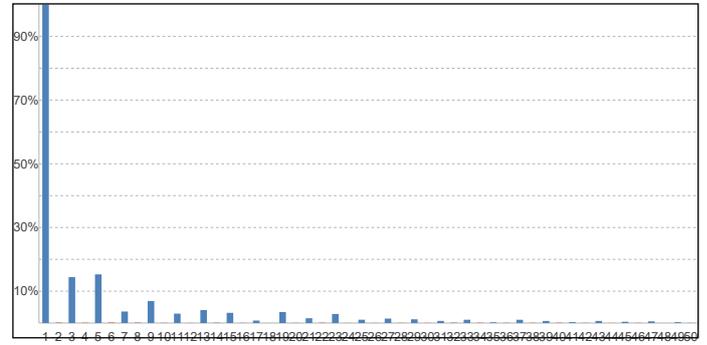

Stabilization Details

Warm-up Conditions

Stable period	15 min
Stable change max	2.0%
Minimum warm-up time	15 min

Colour temperature change during warm-up

CCT start	5331 K
CCT shift	-1519 K
CCT end	3812 K

Warm-up Results

Total warmup time	Lamp stabilized in 15 min 9 sec
Warmup variation	+37.9%

Output intensity change during warm-up

Output start	1093 lm
Output change	+83 lm
Output end	1176 lm




600-050 Emergency wall light IP66 | 5/10W 3-CCT | black | auto test

Colour measurement details



Total lumen output 1176 lm
 Correlated Colour Temperature 3812 K
 Colour coordinates CIE 1931 (x;y) = (0.388;0.378)
 Colour deviation from BBL Duv = -0.0016

TM30-18 Colour Fidelity Index R_f 84.0
 TM30-18 Colour Gamut Index R_g 95.1
 Colour Rendering Index (Ra) CRI 83.7
 Colour Rendering Index. (red component) R9 = 7.2


Colour Quality Scale CQS = 82.3
 Television Lighting Consistency Index TLCI = 68

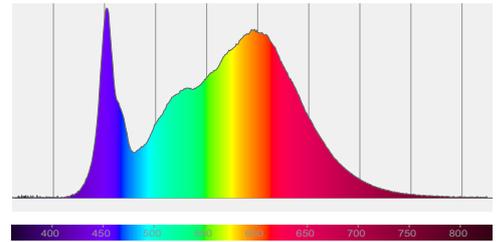


Relative spectral power distribution



TM30 details

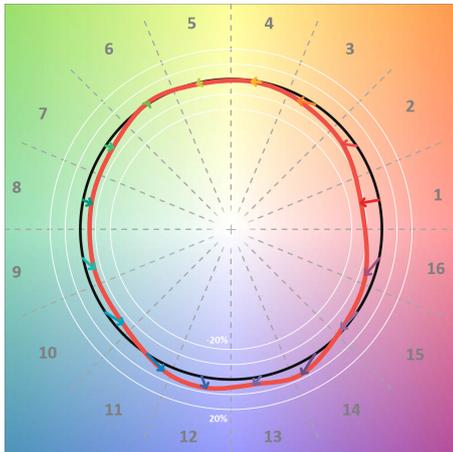


TM30 Colour vectors per hue bin

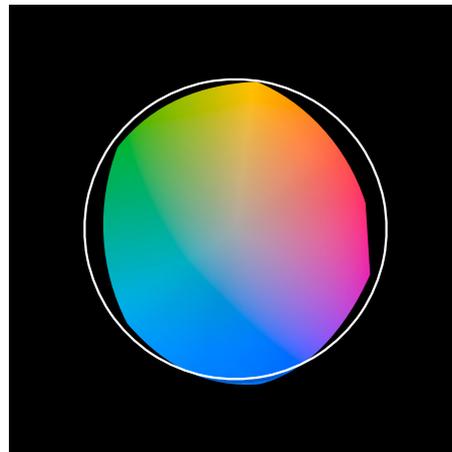


TM30 Colour distortion


Hue Bin	R _f	Shifts (%)	
		Chroma	Hue
C1	79	-12%	0%
C2	83	-7%	6%
C3	79	-4%	11%
C4	89	-1%	6%
C5	91	-1%	3%
C6	95	1%	-2%
C7	91	-5%	-2%
C8	89	-6%	1%
C9	86	-6%	8%
C10	78	-5%	13%
C11	78	3%	15%
C12	84	7%	4%
C13	89	4%	-5%
C14	81	6%	-14%
C15	79	-2%	-14%
C16	77	-7%	-12%

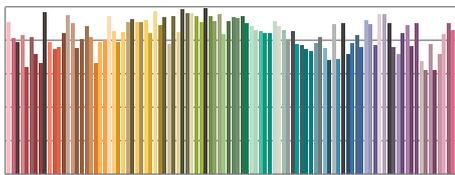

TM30-18 R_f-values per reference colour

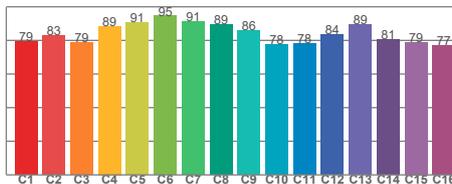


TM30-18 R_f-values per hue bin

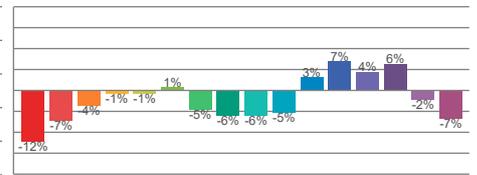


TM30 Chroma shift

Colour Quality details

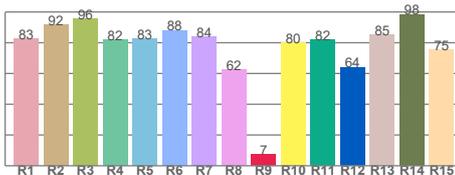

Colour Rendering Index

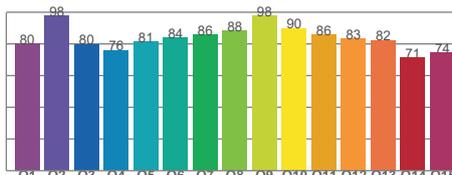

Colour Quality Scale



600-050 Emergency wall light IP66 | 5/10W 3-CCT | black | auto test

Flicker / temporal light artefacts details

Measurement conditions

Flicker meter type	Viso Systems LabFlicker
Flicker/TLA sample rate	20000 samples/s
Measurement time	5x 180 seconds (15 minutes) for PstLM. 1.2 sec for all other indices

Flicker indices according to Illuminating Engineering Society (IES)


Flicker frequency	99.5 Hz
Percent flicker	7.91 %
Flicker index	0.02

TLA indices (according IEC TR 61547-1. EN 61000-3-3 and EN 61000-4-15)


An LED luminaire is considered flicker-free if the SVM value is ≤ 0.4 and if the PstLM value is ≤ 1.0

PstLM value (F < 80 Hz)	1.52
SVM value (80 < F < 2000 Hz)	0.26


Flicker frame (one flicker period in time domain)

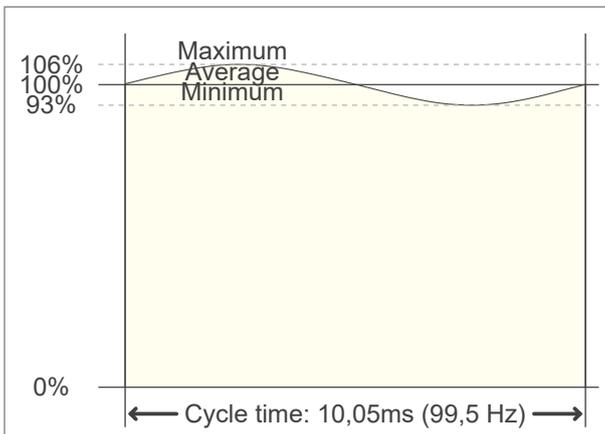

Flicker FFT (flicker curve in frequency domain)

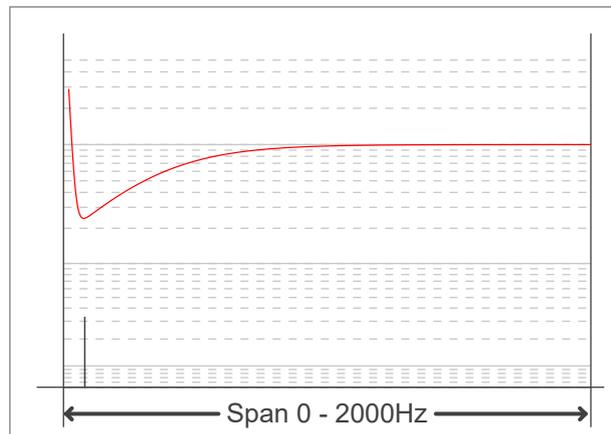

IEEE 1789-2015 Lighting Flicker Risk Zones

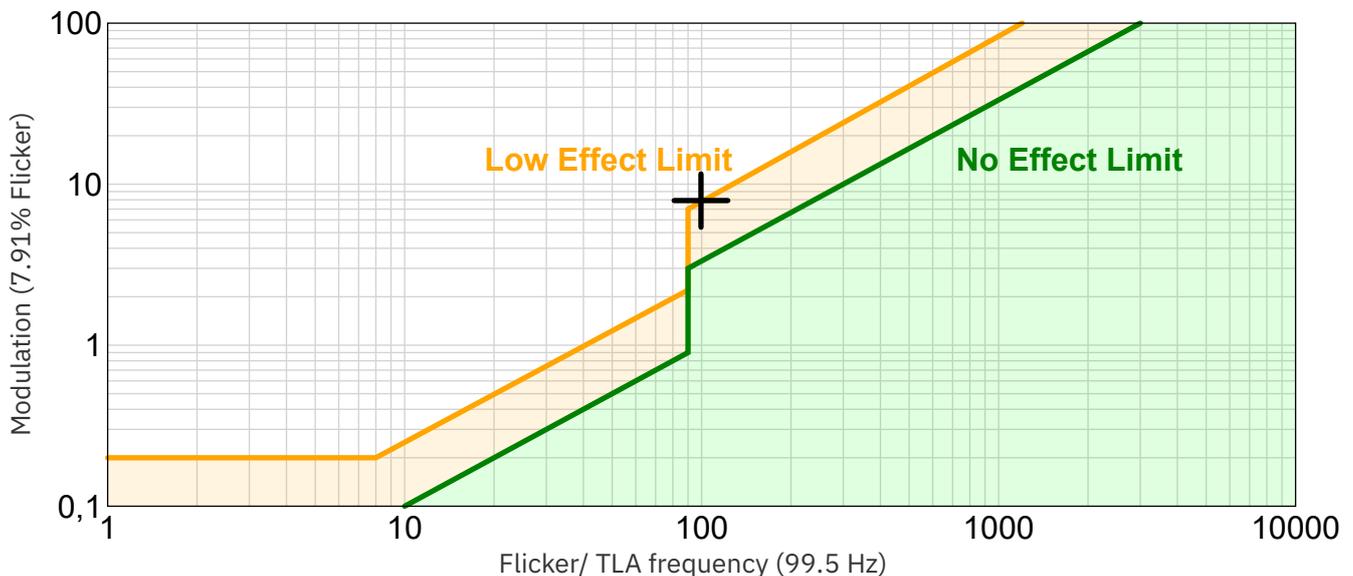

Document revision date: 1-7-2025 Measurement serial: VFR-250605-9516-SW




600-050 Emergency wall light IP66 | 5/10W 3-CCT | black | auto test

Beam angle

Luminous Intensity diagram

Unit: 0-100% of peak intensity

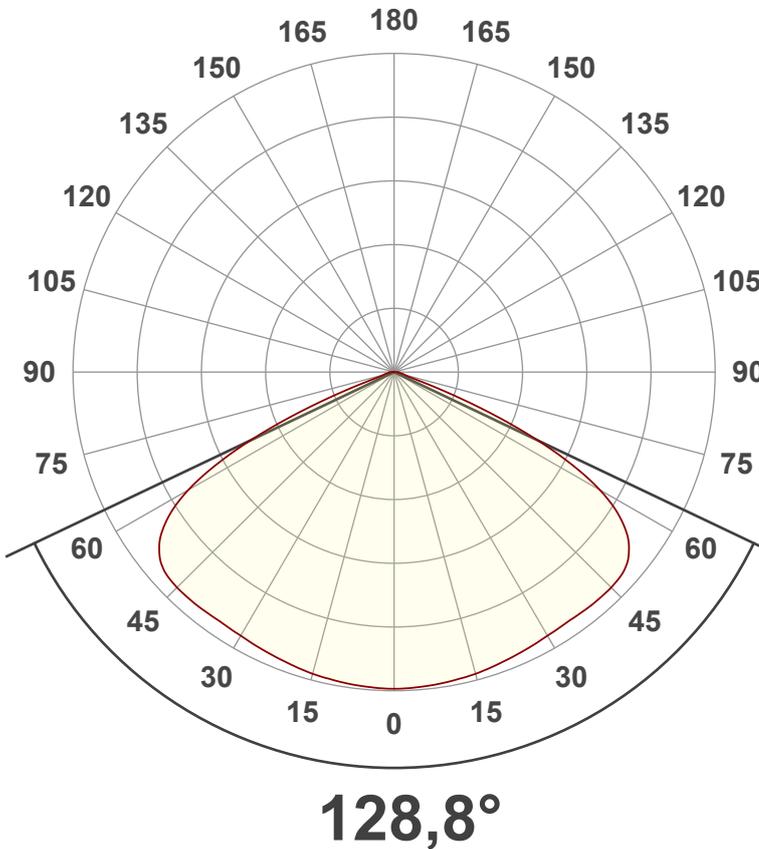

Main Values

Output (total Lumen)	1176 lm
Lumen Up/Down	0% / 100%
Peak Intensity	341 cd
Beam Angle (50%)	128.8°
Beam Angle (90%)	128.8°
Beam Angle (10%)	128.8°

Cut-off Angle

Average 2.5%	157.1°
--------------	--------

Field Angle

Average 10%	140.7°
-------------	--------


Intensity Ratio

In 120° cone	85.6%
In 90° cone	51.6%

C planes

- C000-C180
- C090-C270

Linear distribution diagram - Intensity (candela) vs γ -angle

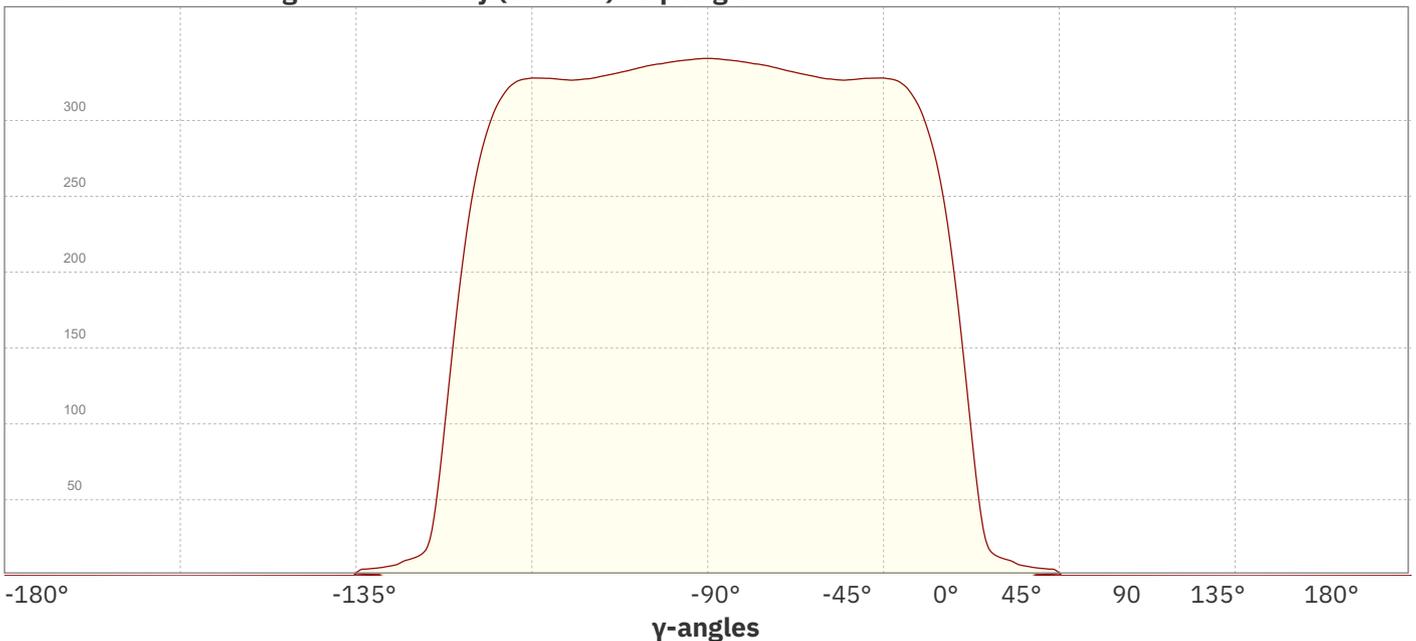


Document revision date: 1-7-2025 Measurement serial: VFR-250605-9516-SW



600-050 Emergency wall light IP66 | 5/10W 3-CCT | black | auto test

Beam Details

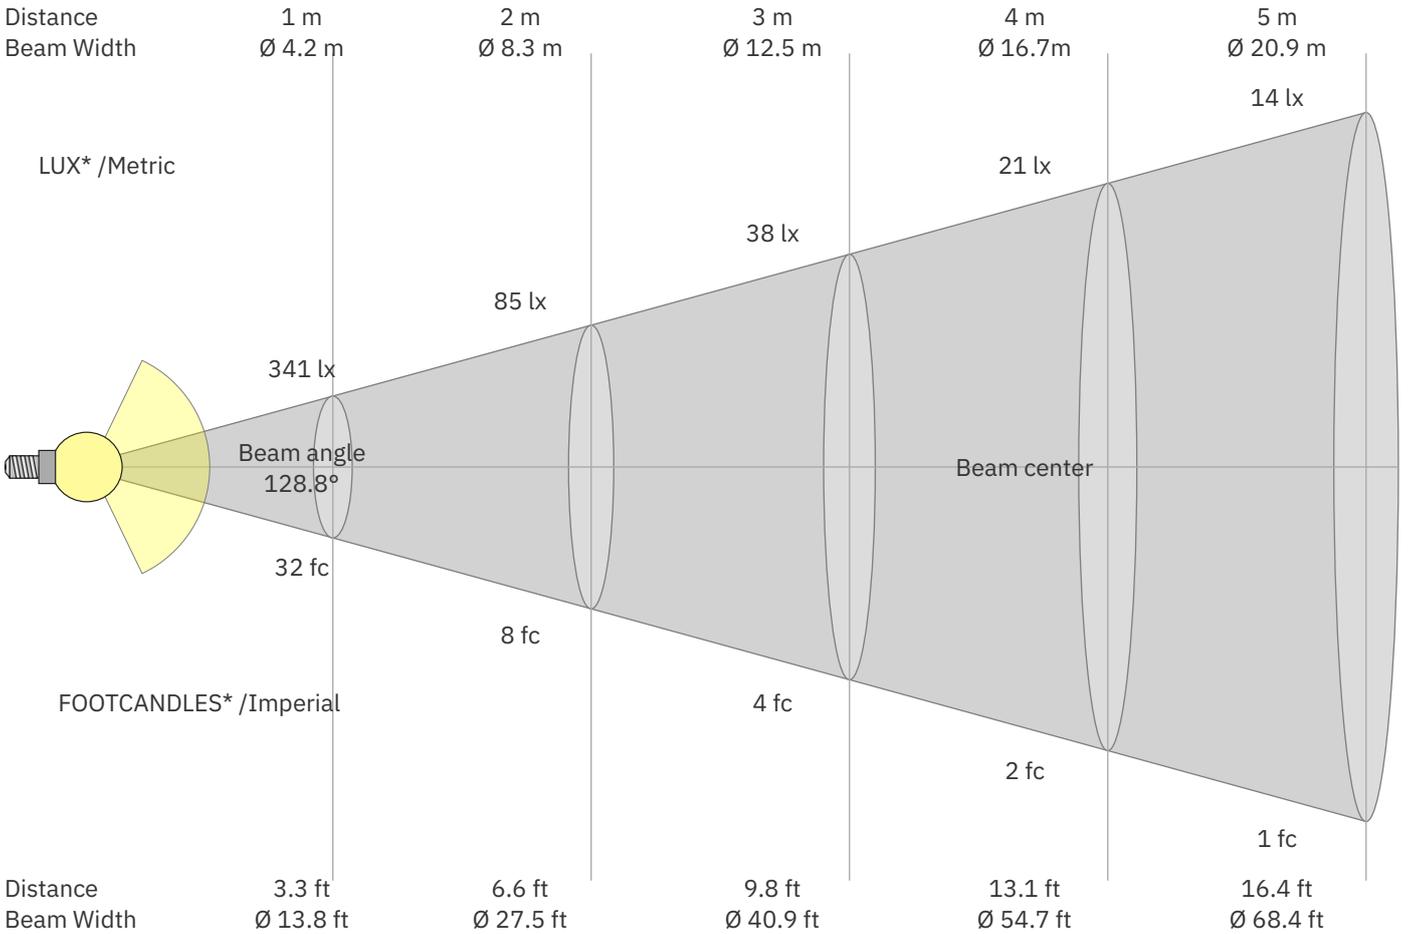

*Measured at center of beam

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m	
3.3	6.6	9.8	13.1	16.4	19.7	23	26.2	29.5	32.8	36.1	39.4	42.7	45.9	49.2	52.5	55.8	59.1	62.3	65.6	ft	
341	85	38	21	14	9	7	5	4	3	3	2	2	2	2	1	1	1	1	1	1	lux
31.7	7.9	3.5	2	1.3	0.9	0.6	0.5	0.4	0.3	0.3	0.2	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1	fc

Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ	
341	340	338	336	333	330	328	327	328	328	324	303	254	156	39	12	7	5	2	0	0	cd
100%	100%	99%	99%	98%	97%	96%	96%	96%	96%	95%	89%	74%	46%	12%	3%	2%	1%	0%	0%	0%	of 0°val

Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ	
341	340	338	336	333	330	328	327	328	328	324	303	254	156	39	12	7	5	2	0	0	cd
100%	100%	99%	99%	98%	97%	96%	96%	96%	96%	95%	89%	74%	46%	12%	3%	2%	1%	0%	0%	0%	of 0°val

Intensities in 180° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ	
341	340	338	336	333	330	328	327	328	328	324	303	254	156	39	12	7	5	2	0	0	cd
100%	100%	99%	99%	98%	97%	96%	96%	96%	96%	95%	89%	74%	46%	12%	3%	2%	1%	0%	0%	0%	of 0°val

Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ	
341	340	338	336	333	330	328	327	328	328	324	303	254	156	39	12	7	5	2	0	0	cd
100%	100%	99%	99%	98%	97%	96%	96%	96%	96%	95%	89%	74%	46%	12%	3%	2%	1%	0%	0%	0%	of 0°val

Document revision date: 1-7-2025 Measurement serial: VFR-250605-9516-SW





600-050 Emergency wall light IP66 | 5/10W 3-CCT | black | auto test

Light Planning – UGR table

Uncorrected, comprehensive UGR table according to CIE 117-1995

Reflectances		70	70	50	50	30	70	70	50	50	30
ρ Ceiling		70	70	50	50	30	70	70	50	50	30
ρ Walls		50	30	50	30	30	50	30	50	30	30
ρ Floor		20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	31.1	32.3	31.4	32.7	32.9	31.1	32.3	31.4	32.7	32.9
	3H	31.4	32.7	31.8	33.0	33.2	31.4	32.7	31.8	33.0	33.2
	4H	31.4	32.6	31.8	32.8	33.1	31.4	32.6	31.8	32.8	33.1
	6H	31.4	32.4	31.7	32.7	33.1	31.4	32.4	31.7	32.7	33.1
	8H	31.3	32.3	31.7	32.6	33.0	31.3	32.3	31.7	32.6	33.0
	12H	31.3	32.2	31.7	32.6	33.0	31.3	32.2	31.7	32.6	33.0
4H	2H	31.5	32.7	31.9	33.0	33.2	31.5	32.7	31.9	33.0	33.2
	3H	32.0	32.9	32.3	33.2	33.7	32.0	32.9	32.3	33.2	33.7
	4H	31.8	32.7	32.3	33.1	33.7	31.8	32.7	32.3	33.1	33.7
	6H	31.8	32.6	32.3	33.0	33.3	31.8	32.6	32.3	33.0	33.3
	8H	31.7	32.5	32.3	32.9	33.2	31.7	32.5	32.3	32.9	33.2
	12H	31.7	32.3	32.2	32.8	33.2	31.7	32.3	32.2	32.8	33.2
8H	4H	31.7	32.5	32.3	32.9	33.2	31.7	32.5	32.3	32.9	33.2
	6H	31.7	32.3	32.2	32.7	33.3	31.7	32.3	32.2	32.7	33.3
	8H	31.7	32.2	32.2	32.7	33.4	31.7	32.2	32.2	32.7	33.4
	12H	31.7	32.1	32.3	32.6	33.2	31.7	32.1	32.3	32.6	33.2
12H	4H	31.7	32.3	32.2	32.7	33.2	31.7	32.3	32.2	32.7	33.2
	6H	31.7	32.2	32.2	32.7	33.4	31.7	32.2	32.2	32.7	33.4
	8H	31.7	32.1	32.3	32.6	33.2	31.7	32.1	32.3	32.6	33.2

Variations with the observer position for the luminaire spacings. S:

S = 1.0H	0.2 / -0.2	0.2 / -0.2
S = 1.5H	0.9 / -0.9	0.9 / -0.9
S = 2.0H	2.1 / -5.0	2.1 / -5.0

Coefficients of Utilization

Ceiling reflectance	80	70	50	30	10	0												
Wall reflectance	70 50 30	10 70 50	30 10 50	30 10 50	30 10 50	30 10 0												
Floor reflectance	20 20 20	20 20 20	20 20 20	20 20 20	20 20 20	20 20 0												
RCR	(RCR: Room Cavity Ratio)																	
Room Values are expressed as percentage of Lumen delivered to the task surface																		
0	119	119	119	119	116	116	116	116	111	111	106	106	106	102	102	102	100	
1	110	106	102	98	107	103	100	97	99	96	94	95	93	91	92	90	88	86
2	100	92	86	80	98	90	85	80	87	82	78	84	80	76	81	77	74	72
3	91	81	73	67	89	79	72	66	76	70	65	74	68	64	71	67	63	60
4	83	71	62	56	81	70	62	55	67	60	55	65	59	54	63	58	53	51
5	76	63	54	47	74	62	53	47	60	52	47	58	51	46	56	50	46	43
6	70	56	47	41	68	55	47	41	53	46	40	52	45	40	50	44	39	37
7	64	51	42	35	63	50	41	35	48	41	35	47	40	35	45	39	35	33
8	60	46	37	31	58	45	37	31	44	36	31	43	36	31	41	35	31	29
9	55	42	33	28	54	41	33	28	40	33	28	39	32	27	38	32	27	25
10	52	38	30	25	50	38	30	25	37	30	25	36	29	25	35	29	24	23