

产品认证证书

II型自愿认证

证书编号: CQC2014010304724672

发证日期: 2021年09月10日

有效期至: 2031年09月10日

委托人名称
及注册地址 ABB Electrification Sweden AB, Motor Starting & Safety
Motorgrand 20, 72161 Vasteras, Sweden

制造商名称
及注册地址 ABB Electrification Sweden AB, Motor Starting & Safety
Motorgrand 20, 72161 Vasteras, Sweden

生产企业名称
及生产地址 ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

产品名称和系列、
规格、型号 接触器
AF190-30-□□-□□, AF205-30-□□-□□; 规格参数详见附件

产品标准和技术要求 GB/T 14048.4-2020


认证模式 产品型式试验+初次工厂检查+获证后监督

上述产品符合 CQC12-000001-2020 认证规则的要求, 特发此证。

本证书为变更证书, 证书首次颁发日期: 2020年08月14日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

可通过扫描下方二维码或登录国家认监委网站 (www.cnca.gov.cn) 查验证书信息



授权签字人

签发

刘江

谢肇熙



中国质量认证中心



<http://www.cqc.com.cn>

中国·北京·南四环西路188号9区 100070

电话: +86 10 83886666

C(2) 0104118

CERTIFICATE OF PRODUCT CERTIFICATION

TYPE II CQC CERTIFICATION

CERTIFICATE NO.: CQC2014010304724672

Valid from: Sep.10,2021

Valid until: Sep.10,2031

**NAME AND REGISTERED
ADDRESS OF THE APPLICANT**

ABB Electrification Sweden AB, Motor Starting & Safety
Motorgrand 20, 72161 Vasteras, Sweden

**NAME AND REGISTERED
ADDRESS OF THE
MANUFACTURER**

ABB Electrification Sweden AB, Motor Starting & Safety
Motorgrand 20, 72161 Vasteras, Sweden

**NAME AND LOCATION
OF THE FACTORY**

ABB Xinhui Low Voltage Switchgear Co., Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province,
P.R.China

**PRODUCT NAME, MODEL
AND SPECIFICATION**

Contactors
AF190-30-□□-□□, AF205-30-□□-□□; See the Appendix

**THE STANDARDS AND
TECHNICAL REQUIREMENTS
FOR THE PRODUCTS**

GB/T 14048.4-2020

**TYPE OF CERTIFICATION
SCHEMES**


Type Testing of Product + Initial Factory Inspection + Follow up Factory Inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC12-000001-2020.

Date of original issued: Aug.14,2020

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGN BY

刘江

SIGNATURE

谢肇煦



CHINA QUALITY CERTIFICATION CENTRE



<http://www.cqc.com.cn>

Section 9, No.188, Nansihuan Xilu, Beijing 100070 P.R.China

Tel: +86 10 83886666

C(2) 0104118

产品认证证书

II型自愿认证

证书编号: CQC2014010304724672

第 1 页 共 3 页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 104118

上报参数:

AF190-30-**-*, AF205-30-**-*

Ui:1000V;

Uimp:8kV;

Ith: 275A,355A (带扩展性端子 LW185) ;

AF190-30:

AC-1: Ue/Ie: 220-240V/380-415V/690V/275A,1000V/250A;

AC-3: Ue/Ie: 220-240V/190A, 380-415V/190A,440V/190A,500V/156A,690V/135A,1000V/85A;

AC-4: Ue/Ie: 500V/128A,690V/93A,1000V/72A;

AF205-30:

AC-1: Ue/Ie: 220-240V/380-415V/690V/350A,1000V/275A;

AC-3: Ue/Ie:220-240V/205A,380-415V/205A,440V/205A,500V/185A,690V/165A,1000V/100A;

AC-4: Ue/Ie: 500V/156A,690V/104A,1000V/85A;

Us: 24-60V 50/60Hz/20-60V d.c., 48-130V 50/60Hz, d.c., 100-250V 50/60Hz, d.c. ,

250-500V 50/60Hz, d.c. ;

3P;

配用辅助触头:(外置)

CAL19: CQC2013010304604055

Ith:16A;

AC-15:Ue/Ie:127V/6A, 240V/4A, 400V/3A, 440V/3A, 500V/2A, 690V/2A;

DC-13:Ue/Ie: 24V/3A,48V/1.5A,72V/1A, 110V/0.55A, 125V/0.55A,220V/0.3A,250V/0.3A;

1NO1NC,2NO2NC



中国质量认证中心



产品认证证书

II型自愿认证

证书编号: CQC2014010304724672

第 2 页 共 3 页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 104118

型号解释:

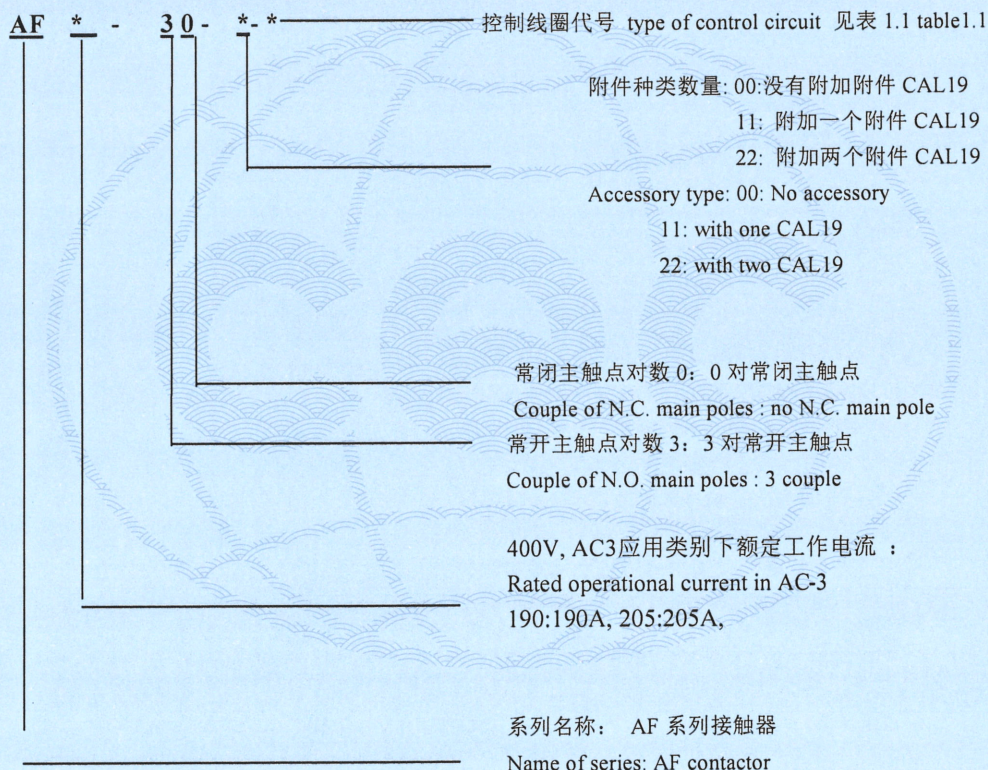


表 1.1 table1.1

额定工作电压 Rated voltage (V)		线圈代号
DC	AC 50/60Hz	
20-60	24-60	11
48-130	48-130	12



中国质量认证中心



产品认证证书

II型自愿认证


证书编号: CQC2014010304724672

第 3 页 共 3 页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 104118

100-250	100-250	13
250-500	250-500	14

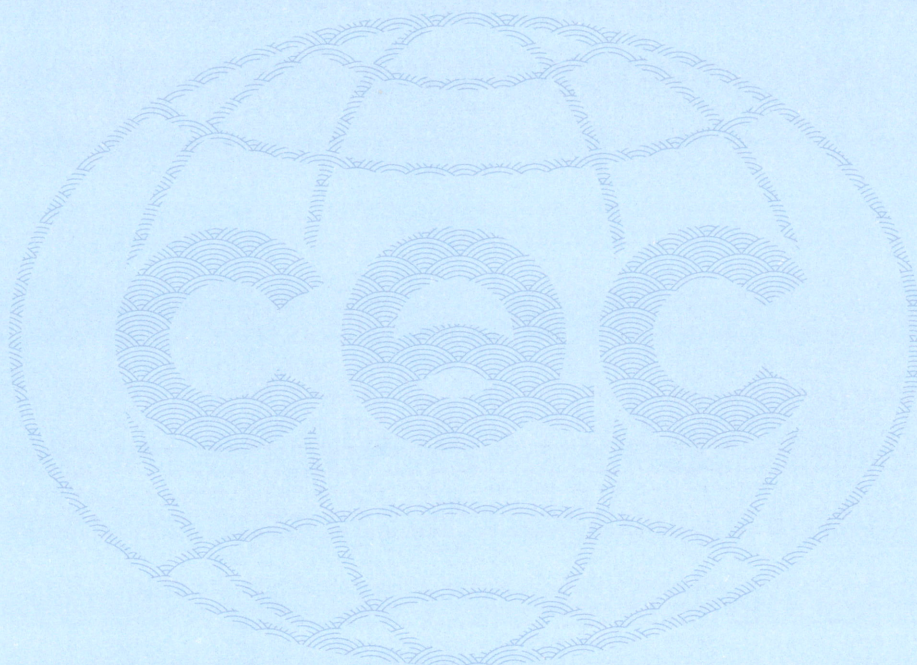

中国质量认证中心

