


GLV 032.01	GOODWE	XS, DNS, SDTG2, SMT, MT	
C10/26 - DECLARATION OF CONFORMITY for power-generating units GLV ed2.1.2 (12/2019)			
for the application of annex D "Technical basic requirements regarding the power-generation units" of the Synergrid prescription C10/11 ed2.1 (01/09/2019)			

The undersigned,	Manufacturer:	JIANGSU GOODWE POWER SUPPLY TECHNOLOGY CO.	Represented by:	JING XIE
	Address:	No. 90 Zijin Rd., SND Suzhou, CHINA	Country:	CHINA
			email:	jing.xie@goodwe.com
			Telephone:	0086 512 6958 2236

the following conditions:

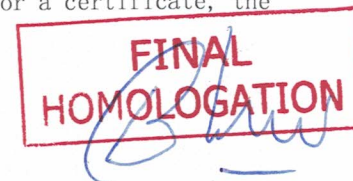
1. The power-generating unit complies with the relevant requirements set out in annex D "Technical basic requirements regarding the power-generation units" of the Synergrid prescription C10/11 ed2.1 (01/09/2019).
2. In order to substantiate this, a separate technical file has been submitted at least for each separate product series of the 'C10/26 list of power-generating units' of this homologation application. Each technical file shall be drawn up on the basis of a checklist Annex D, duly and correctly completed by the manufacturer, accompanied by all the required proof of conformity.


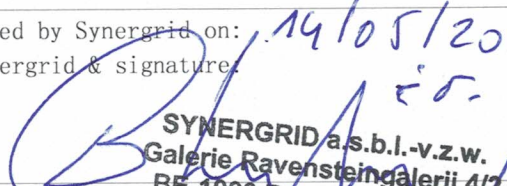
2.1 For technical requirements for which the required proof of conformity (column J in checklist annex D) is a declaration of honour by the manufacturer, the manufacturer declares by signing and dating this declaration of conformity the correctness of the information (conform / not conform / not applicable) provided by him or her in columns K, L and M of this checklist.

2.2. For technical requirements for which the required proof of conformity (column J in checklist Annex D) is a test report or a certificate, the necessary test reports and/or certificates are available * in the technical file:

- Certificates have been issued by an EN 45011 (or ISO 17065:2012) certification body accredited for these materials.
- Test reports have been established by an ISO 17025:2005 or ISO 17065:2012 laboratory accredited for these tests.

file.



Done at:	Suzhou, China		Homologated by Synergrid on: 14/05/20 Stamp Synergrid & signature:
On:	07-04-2020		
(stamp manufacturer & signature)		2020-04-07 10:13:05	

* Transition period till 01/05/2020 (see exceptions in chapter 3 of C10/11 ed 2.1 (01/09/2019)):

If at the time of submission of this homologation application it is not yet possible to submit all the necessary certificates and/or reports (exception 3), or that the units do not yet have all the required characteristics (exceptions 1 and 2), a temporary homologation may be granted. All necessary certificates and/or test reports must be in the possession of Synergrid at the latest on 30/04/2020 in order to obtain a final homologation. If this is not the case, the temporary C10/26 homologation will be withdrawn.

POWER-GENERATING UNITS TO BE HOMOLOGATED FOR LIST C10/26 ACCORDING TO THE REQUIREMENTS OF ANNEX D OF THE TECHNICAL PRESCRIPTION C10/11 ed2.1 (01/09/2019)
 2. C10/26 list with power-generating units in accordance with annex D of C10/11 ed2.1 (01/09/2019)

GLV 032.01 GOODWE XS, DNS, SDTG2, SMT, MT

checklist ed 2.1.2 (12/2019)

1	2	3	4	5	6		7		8		9	10	11				12				13		14		15		
					ONLY for units (suitable for) energy storage: Name and reference of the power control system		P _{acr} rated (active) power (W)	S _{max} maximum apparent power (VA)	1-phase or 3-phase	ADDITIONAL CHARACTERISTICS				LIMITATIONS				APPLICATION		Synergrid approval date							
					power control system type EnFluRi	other power control system				D.3 integrated automatic separation system			D.4.1 additional operating frequency range (51.5 Hz - 52.5 Hz) "RIG type B ready" = suitable for use in installation ≥ 1MW	D.5.2 power response to underfrequency	D.7.2 active power reduction (PU)	D.7.1 only homologated for "small power-generating installations" compliant power control system provided (e.g. EnFluRi)	D.4.3 only homologated for connection to Hi/Network	D.9.1 only homologated for use in module < 300W	only homologated as a backup power system according to §2.1.1		Solar energy	Wind energy	CHP (combined heat & power)	Energy storage		Backup power system	Other
	GOODWE	DNS	GW3000D-NS	V1.14.11 or above			3000	3000	1-phase	X		X	X	X			X										
	GOODWE	DNS	GW3600D-NS	V1.14.11 or above			3680	3680	1-phase	X		X	X	X			X										
	GOODWE	DNS	GW4200D-NS	V1.14.11 or above			4200	4200	1-phase	X		X	X	X			X										
	GOODWE	DNS	GW5000D-NS	V1.14.11 or above			5000	5000	1-phase	X		X	X	X			X										
	GOODWE	XS	GW700-XS	V1.11.11 or above			700	700	1-phase	X		X	X	X			X										
	GOODWE	XS	GW1000-XS	V1.11.11 or above			1000	1000	1-phase	X		X	X	X			X										
	GOODWE	XS	GW1500-XS	V1.11.11 or above			1500	1500	1-phase	X		X	X	X			X										
	GOODWE	XS	GW2000-XS	V1.11.11 or above			2000	2000	1-phase	X		X	X	X			X										
	GOODWE	XS	GW2500-XS	V1.11.11 or above			2500	2500	1-phase	X		X	X	X			X										
	GOODWE	XS	GW3000-XS	V1.11.11 or above			3000	3000	1-phase	X		X	X	X			X										
	GOODWE	SDT G2	GW4K-DT	V1.07.07 or above			4000	4000	3-phase	X		X	X	X			X										
	GOODWE	SDT G2	GW5K-DT	V1.07.07 or above			5000	5000	3-phase	X		X	X	X			X										
	GOODWE	SDT G2	GW6K-DT	V1.07.07 or above			6000	6000	3-phase	X		X	X	X			X										
	GOODWE	SDT G2	GW8K-DT	V1.07.07 or above			8000	8000	3-phase	X		X	X	X			X										
	GOODWE	SDT G2	GW10KT-DT	V1.07.07 or above			10000	10000	3-phase	X		X	X	X			X										
	GOODWE	SMT	GW25K-MT	V1.06.06.06 or above			25000	25000	3-phase	X		X	X				X										
	GOODWE	SMT	GW30K-MT	V1.06.06.06 or above			30000	30000	3-phase	X		X	X				X										
	GOODWE	SMT	GW36K-MT	V1.06.06.06 or above			36000	36000	3-phase			X	X				X										
	GOODWE	MT	GW50KN-MT	V1.10.10 or above			50000	50000	3-phase	X		X	X				X										
	GOODWE	MT	GW60KN-MT	V1.10.10 or above			60000	60000	3-phase	X		X	X				X										
	GOODWE	MT	GW50KBF-MT	V1.10.10 or above			50000	50000	3-phase	X		X	X				X										
	GOODWE	MT	GW60KBF-MT	V1.10.10 or above			60000	60000	3-phase	X		X	X				X										
	GOODWE	MT	GW75KBF-MT	V1.10.10 or above			75000	75000	3-phase	X		X	X				X										
	GOODWE	MT	GW80KBF-MT	V1.10.10 or above			80000	80000	3-phase	X		X	X				X										
	GOODWE	MT	GW70KHV-MT	V1.10.10 or above			70000	70000	3-phase	X		X	X				X										
	GOODWE	MT	GW80KHV-MT	V1.10.10 or above			80000	80000	3-phase	X		X	X				X										
	GOODWE	MT	GW80K-MT	V1.10.10 or above			80000	80000	3-phase	X		X	X				X										

FINAL HOMOLOGATION

SYNERGRID a.s.b./v.z.w.
 Galerie Ravensteingalerij 4/2
 BE-1000 Bruxelles/Brussel
 T.V.A./B.T.W. : BE 0402.958.091

EXPLANATIONS FOR THE COMPLETION OF THE TABLE

Column	Title	Remarks
1	SYNERGRID reference number (GlVxxx yy zzzz)	In the case of a positive homologation, each C10/26 homologated power generating unit is given a unique Synergrid reference number: xxx - unique reference of the manufacturer yy - serial number of manufacturer xxx's record xxx zzzz - unique unit reference for the manufacturer xxx <i>Note: "GLV" is the internal Synergrid abbreviation for Declaration of Conformity, based on the Dutch word "Gelijkvormigheidsverklaring".</i>
2	Brand name	Brand name under which the unit is marketed on the Belgian market.
3	Name of the product series	Name of the product range. Note: For each separate product range (or each group of units with common characteristics) a separate checklist according to Appendix D is required (sheet 3) together with the corresponding conformity proof documents.
4	Reference of the model / type of the unit	Unique product name or reference. Units of the same product range must be unequivocally distinguished from each other through this name or reference.
5	Firmware version	Reference of the firmware version of the unit.
6	power control system type EnFluRi	This case is only applicable for units (suitable for) energy storage, provided with a power control system of type EnFluRi: Name and reference of the power control system of type EnFluRi, compliant to the requirements in C10/11 ed2.1 (01/09/2019) § 4.1.7 and § 7.11.2.1
7	other power control system	This case is only applicable for units (suitable for) energy storage, provided with a power control system of another type than EnFluRi: Name and reference of the power control system, compliant to the requirements in C10/11 ed2.1 (01/09/2019) § 7.11.2.2
8	P _{ac,r} rated (active) power (W)	Active (electrical) power in W at the terminals of the unit, as stated on the technical sheet / data sheet / brochure and nameplate. (For photovoltaic inverters: see also definition in § 3.2.5 of IEC 62894 2016 11)
9	S _{max} maximum apparent power (VA)	Maximum apparent (electrical) power at the terminals of the unit, as stated on the certificate / the test report / the technical sheet / data sheet / brochure.
10	1 phase or 3 phase	Indicate whether the unit is single or three phase. This characteristic refers to the unit itself, not to the nature of the connection to the distribution network to which the unit can be connected.
11	Additional characteristics	In these columns optional additional characteristics of the units are indicated, following the information in checklist annex D and the corresponding technical file. Put an "X" at each relevant additional characteristic. Note: Only units < 1 MW that are "type B ready" may be applied in an installation ≥ 1 MW (installation "type B" according to the European Network Code RfG). A unit < 1 MW is only "type B ready" if it complies with <u>all</u> optional properties ticked in column 1 of the checklist Annex D.
12	Limitations	These columns specify limitations of the units to their application in certain types of installations, in accordance with the information in the checklist in annex D and the corresponding technical file. Put an "X" to each relevant limitation.
13	Application	Indicate the applications for which the unit is suitable. Include an "X" with each application for which the unit can be used.
14	Synergrid approval date Temporary homologation (expires on 01/05/2020)	Date on which the submitted homologation file was approved by Synergrid for a limited period of time. A temporary homologation is granted if the applicant invokes exceptions in chapter 3 of C10/11 ed2.1 (01/09/2019) and has not yet submitted all the test reports required for a definitive homologation with his homologation application (exception 3), or if the units do not yet have all the required properties (exceptions 1 and 2). The expiry date for a temporary homologation is 01/05/2020 - see conditions in chapter 3 of C10/11 ed.2.1 (01/09/2019).
15	Synergrid approval date Final homologation	Date on which the submitted homologation file was definitely approved by Synergrid. A final approval will be granted as soon as Synergrid has a fully compliant homologation dossier. A final homologation only remains valid under the following conditions: - No changes that have an influence on the initial approval are made to (the production of) the units. - There is no new edition of prescription C10/11. - The validity date of the test reports in the technical file submitted for approval has not been exceeded. See also the general Synergrid procedure S1/01 for homologation of material, which is applicable. (1)

**FINAL
HOMOLOGATION**

(1) - S1/01 Technical specification: procedure for application for homologation and renewal of homologation of materials


SYNERGRID a.s.b.l.-v.z.w.
Galerie Ravensteingalerij 4/2
BE-1000 Bruxelles/Brussel
T.V.A./B.T.W : BE 0402.958.091