




ALTAIR 120 H ALTAIR 160 H

False ceiling mounting



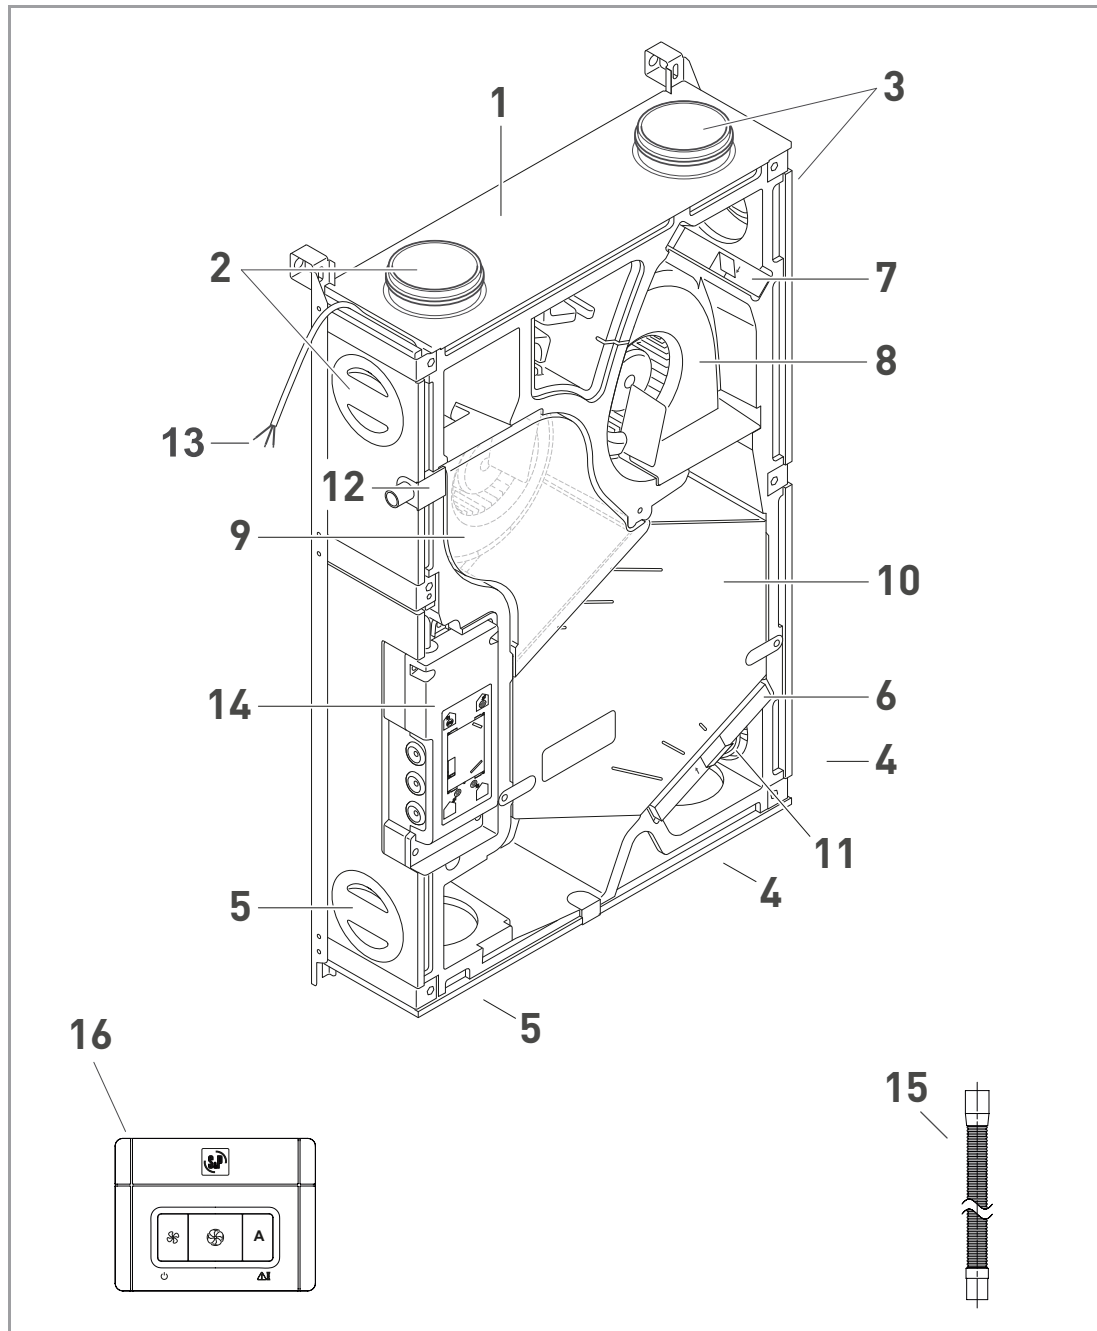

1. Heat recovery unit ALTAIR
2. Exhaust air (EHA)
3. Outdoor air (ODA)
4. Extract air (ETA)
5. Supply air (SUP)
6. G4 filter (extract air)
7. G4 filter (outdoor air)
8. Supply air fan
9. Exhaust air fan
10. Counterflow heat exchanger
11. Humidity sensor
12. Condensation water connection
13. Power supply cable
14. Control
15. Drain duct (l=150mm)
16. Remote control (includes 10m cable)

1. GENERAL

1.1. WARNINGS

This product was manufactured according to rigorous technical safety rules in compliance with DC standards. The DC declaration and the manual can be downloaded from the Internet.

Before installing and using this product, carefully read these instructions, which contain important indications to ensure your safety and that of the users during the installation, commissioning and servicing of this product.

Once the installation is terminated, leave this manual in the machine for future consulting.

The installation of this product (implementation, connections, commissioning, maintenance) and all other interventions must be performed by a professional, applying the recognized rules of good practice, standards and safety regulations in force.

It must conform to the prescriptions related to Electromagnetic Compatibility (EMC) and the Low Voltage Directive (LVD).

S&P shall not be held responsible for possible injuries and/or damages caused by the non compliance with safety instructions or following a modification of the product.



This appliance is considered to be suitable for use in countries having a warm damp equable climate as specified in IEC 60721-2-1. It may also be used in other countries.

Indoor installation:

- Minimum recommended ambient temperature for the unit +10°C.
- Limits, ambient temperature min. +10°C and max. +50°C.
- Limits, air temperatures -18°C and +50°C.
- Relative humidity: max 95% non condensing.
- Atmosphere not potentially explosive.
- Atmosphere with low salt content, without corrosive chemical agents.

Means for disconnection must be incorporated in the fixed wiring according with the wiring rules. An external disconnecting device, which will function as the “designated” disconnect device must be provided, and:

- 1) It shall disconnect the “Line”, while disconnection of the “Neutral” is optional;
- 2) Its OFF-position shall be clearly marked;
- 3) Not to position the equipment so that it is difficult to operate it; and
- 4) The protection current device must be at least 16A, 250V, curve Type C.
- 5) The device must be powered via a differential switch (RCD) with a rated residual operating current not exceeding 30 mA.

If the supply cord is damaged, it must be replaced by the manufacturer, its service agent or similarly qualified persons in order to avoid a hazard.

1.2. SAFETY INSTRUCTIONS

This appliance can be used by children aged from 8 years and above and persons with reduced physical, sensory or mental capabilities or lack of experience and knowledge if they have been given supervision or instruction concerning use of the appliance in a safe way and understand the hazards involved. Children shall not play with the appliance. Cleaning and user maintenance shall not be made by children without supervision.

- Wear appropriate IPE (Individual Protection Equipment) before any intervention.
- Before installing the unit, make sure that the support and placement are sufficient resistant to withstand the units weight.
- Do not open the access doors without first switching off the electrical power supply.
- If the work is to be performed inside the device, switch off the electrical power supply on the main circuit breaker and make sure that no one can accidentally switch it on.
- Make sure that the moving parts are stopped.

**Before starting, check the following points:**

- Make sure that the device does not contain any foreign body.
- Make sure that all the components are attached in their original placements.
- Check the earthing connection.
- Precautions must be taken to avoid the back-flow of gases into the room from the open flue of gas or other fuel-burning appliances (for duct and partition fans).

1.3. ACCEPTANCE – STORAGE

In case of missing, non-conforming, or totally or partially damaged delivered products, the purchaser must make written reservation on the transporter's receipt and confirm them within seventy-two (72) hours by sending a recommended letter to the transporter, as well as a copy to S&P. Acceptance of the unit without any reservation will deprive the purchaser of any claims.

The product must be stored in an area protected from bad weather, shock and stains due to splashing or splattering of any kind during its transport from the supplier to the end customer and onto the worksite before installation.

1.4. WARRANTY

The unit supplied by S&P is warranted 24 months, parts only, starting from the invoicing date.

S&P agrees to replace the parts or the unit whose operation is recognized defective by our departments except for all damages and interests or penalties such as operating losses, commercial prejudice, or other immaterial or indirect damages.

The following are not covered by our warranty: defects resulting from an abnormal usage or a usage not conforming to the recommendations of our manuals; faults observed as a consequence of normal wear; incidents caused by negligence, lack of monitoring, or servicing; faults due to the incorrect installation of the devices or to bad storage conditions before mounting.

In any case, S&P will not be responsible for transformed unit, repaired even partially.

2. TECHNICAL INFORMATION

2.1. GENERAL INFORMATION

The ALTAIR ensures optimum ventilation of a house with a maximum energy recovery. It draws air from the rooms (bathroom(s), toilet, kitchen and wash room(s)) and supplies fresh air through the main rooms (living room, bedroom(s), office, etc.).

The fresh and extract airflows are separated and filtered. Only heat energy is transferred to the fresh filtered air that is introduced. Due to the high-efficiency heat exchanger used in the ALTAIR, performance can reach 86%.

Condensation forms during the heat exchange process and is recovered in the condensate tray, which must be connected to a waste water drain.



Outdoor air (ODA):

Install the fresh air intake (wall or roof) at a sufficient distance from any source of high pollution (trees, exhaust fumes, roads, etc.)

This duct must be sealed and insulated to prevent condensation.



Supply air (SUP):

To avoid thermal losses and optimize the performance of the installation, it is recommended to use insulated duct.



Extract air (ETA):


To avoid thermal losses and optimize performance of the installation, it is recommended to use insulated ducts.



Exhaust air (EHA):



This duct must be sealed and insulated to prevent condensation.

This duct must be sealed and insulated to prevent condensation.

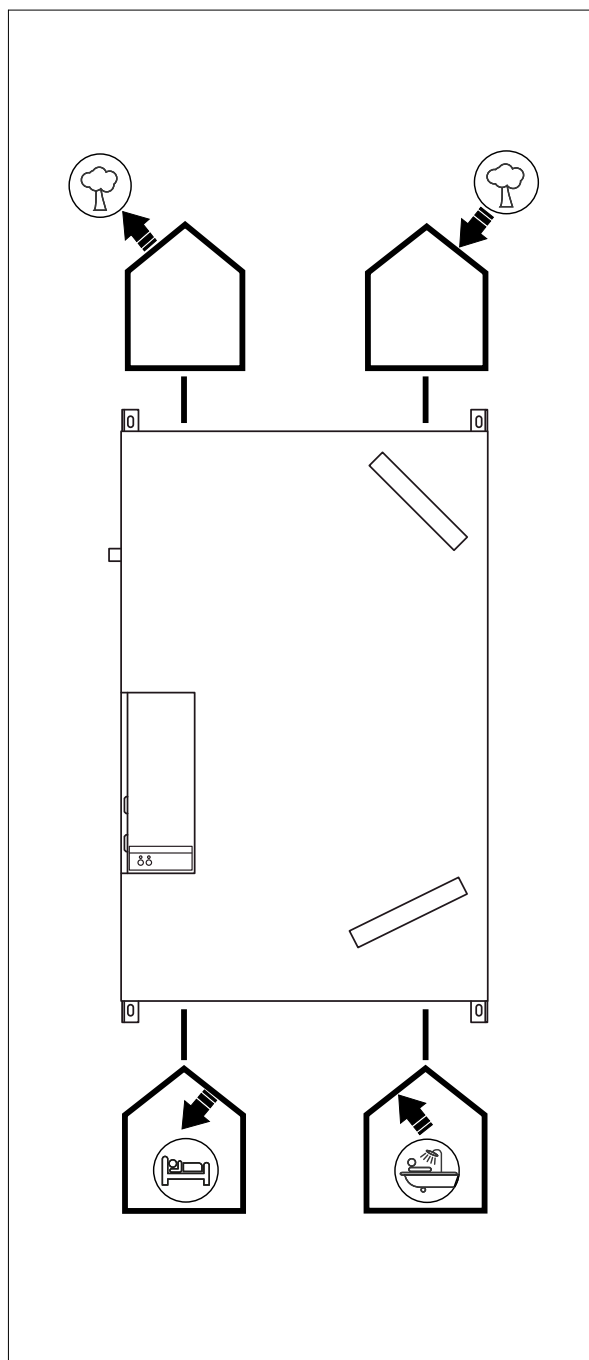


2.2. DIMENSIONS AND ELECTRIC CONNECTION

Dim.	ALTAIR 120 H	ALTAIR 160 H
A	90 mm	106 mm
B	360 mm	313 mm
C	550 mm	550 mm
D	94 mm	123 mm
E	22 mm	22 mm
F	660 mm	729 mm
G	850 mm	970 mm
H	30 mm	32 mm
I	178 mm	211 mm
J	91 mm	106 mm
K	208 mm	231 mm

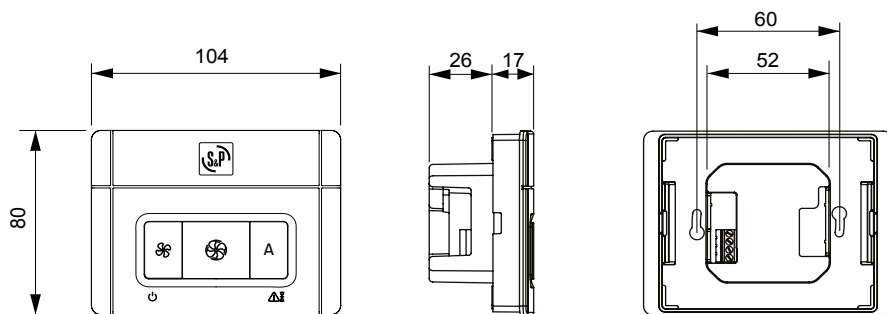
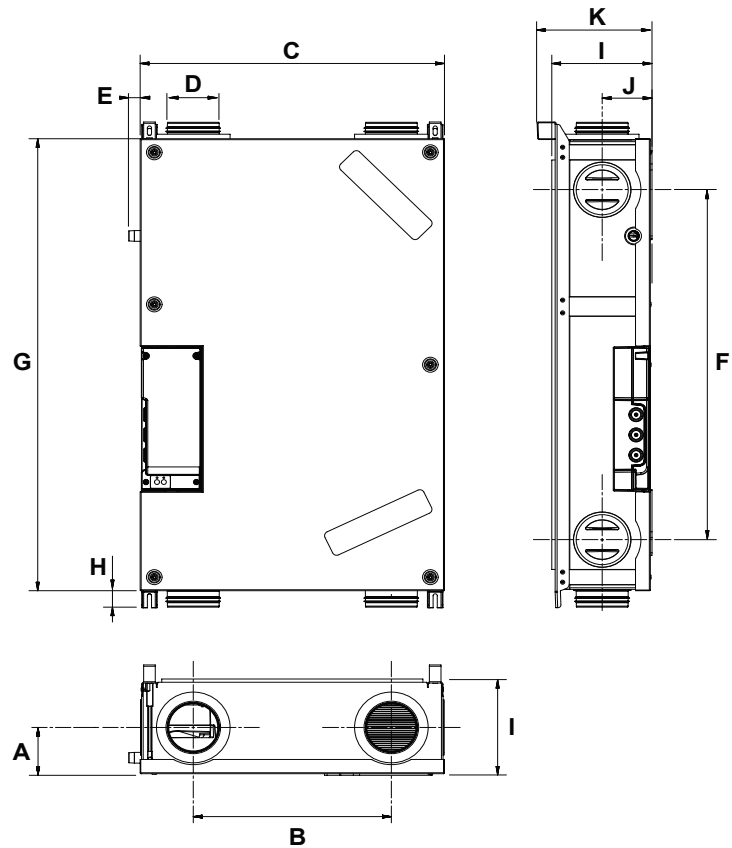


REMOTE CONTROL

included 10m cable type HV05-F-4G0.25
(max. length 50 m)

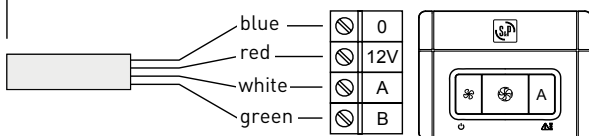


SPCM-1 (optional)

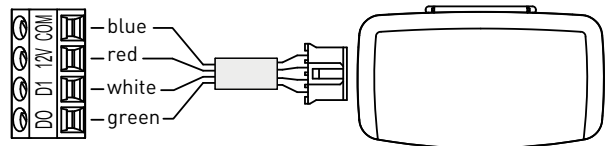

~230V 50/60Hz

2.3. INSTALLATION

Ceiling:

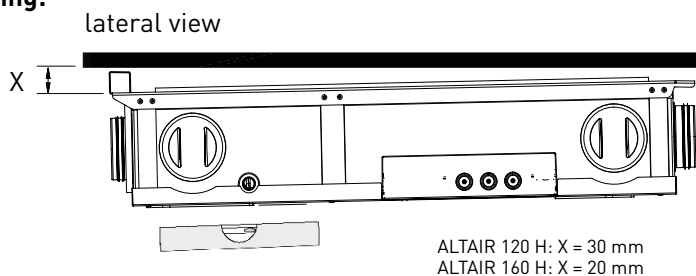

To avoid the vibration transmission and noise to the duct, we recommend to use flexible connections.

ALTAIR 120 H


Supply/Extract air: Installation of flexible silencers type LAF 95 0,5M (5209358600) / LAF 95 1M (5209358500)

Outdoor/Exhaust Air: Connection with flexible duct thermally insulated type GP-ISO 100/25 6M ECOSOFT (5209346600)


ALTAIR 160 H

Supply/Extract air: Installation of flexible silencers type LAF 125 0,5M (5209358600) / LAF 125 1M (5209061600)

Outdoor/Exhaust Air: Connection with flexible duct thermally insulated type GP-ISO 125/25 6M ECOSOFT (5209346000)

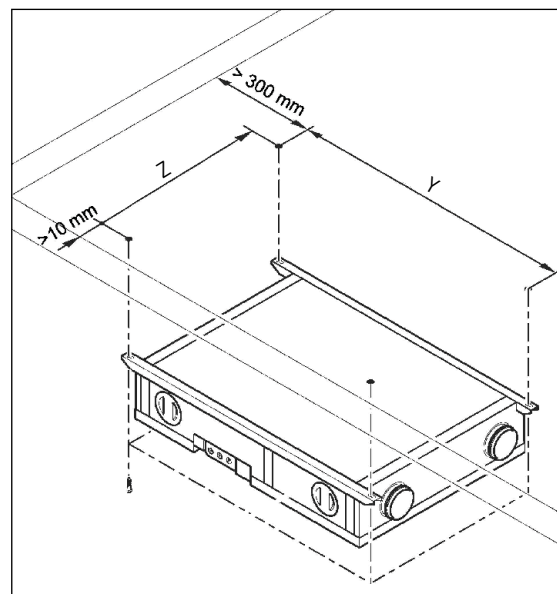

Dim.	ALTAIR 120 H	ALTAIR 160 H
Y	874 mm	994 mm
Z	516 mm	516 mm

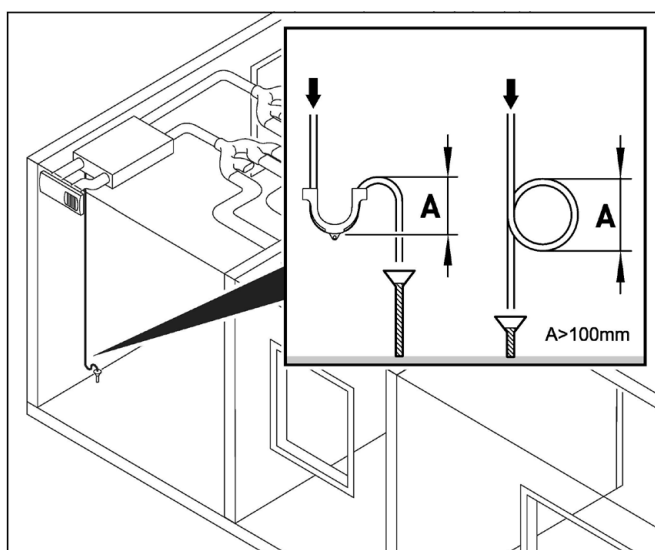

The drain pipe should be installed with a drop of min. 1% to assure a good drainage and has to be connected to a with water filled siphon.

Please assure that the access opening to the unit is big enough to allow maintenance or replacing the unit.

It is recommended to install the ALTAIR in the heated zone of the house.
The minimum temperature should not be less than +10°C.



In climate zones where outdoor temperatures are often under -10°C it is recommended to install a pre-heater.



The ALTAIR heat recovery unit is designed for indoor installation.



2.4. START UP

Installer


The remote control allows to adjust:

- Airflows (3 speeds)
- Period for filter maintenance
- Balance of supply/extract airflow

To adjust the speed please turn the corresponding potentiometer with a small screw driver in the wished position.

The ALTAIR units are working with constant airflow. This allow to adjust the airflow as in the tables below without the necessity to balance.

The potentiometer “balance airflows” allows to work in over/under pressure if wished.

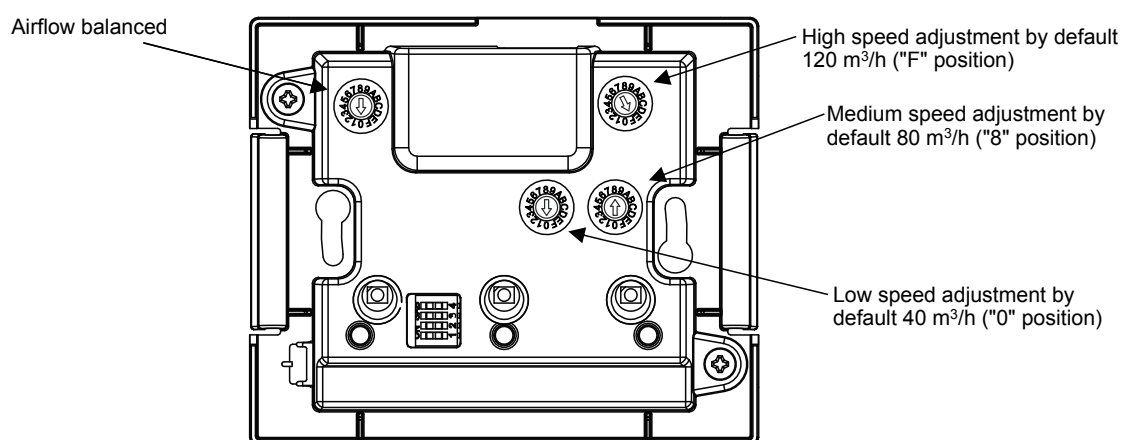

Airflow adjustment

low speed																
Potentiometer position	0	1	2	3	4	5	6	7	8	9	A	B	C	D	E	F
ALTAIR 120 H / Assigned value (m³/h)	40	45	50	55	60	65	70	75	80	85	90	95	100	105	110	120
ALTAIR 160 H / Assigned value (m³/h)	40	48	56	64	72	80	88	96	104	112	120	128	136	144	152	160

medium speed																
Potentiometer position	0	1	2	3	4	5	6	7	8	9	A	B	C	D	E	F
ALTAIR 120 H / Assigned value (m³/h)	40	45	50	55	60	65	70	75	80	85	90	95	100	105	110	120
ALTAIR 160 H / Assigned value (m³/h)	40	48	56	64	72	80	88	96	104	112	120	128	136	144	152	160

hight speed																
Potentiometer position	0	1	2	3	4	5	6	7	8	9	A	B	C	D	E	F
ALTAIR 120 H / Assigned value (m³/h)	40	45	50	55	60	65	70	75	80	85	90	95	100	105	110	120
ALTAIR 160 H / Assigned value (m³/h)	40	48	56	64	72	80	88	96	104	112	120	128	136	144	152	160



Airflows balancing

Potentiometer position	9	A	B	C	D	E	F	0	1	2	3	4	5	6	7	8
% Q supply / Q extraction	-14	-12	-10	-8	-6	-4	-2	0	2	4	6	8	10	12	14	16


Adjustment of the filter maintenance period

It is possible to set the period to 6, 9, 12, or 15 months (12 month factory setting). The filter clogging depends on the pollution of the area where the unit is installed. We recommend checking the time in which the filter clogs and adjusting this period. It is advisable to do this after the second filter change. Of course, after the installation, the extract air is dusty and not representative. During the second filter check, if you notice that the filters are clean you can increase the time, if you notice the filters are very dirty you should decrease the time.


Lift the cover of the control and adjust the timer as shown. To do this set the dipswitches 1 and 2 as in the drawings below.

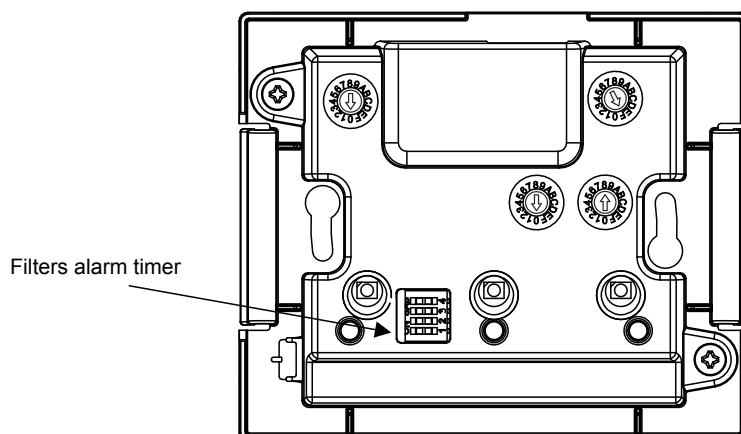


6 months



9 months



12 months
(factory setting)





15 months

the black colour represents the switch position

Adjustment of the relative humidity %


The ALTAIR has as a standard a humidity sensor in the extract air installed. This sensor allows to adjust the velocity in dependence of the relative humidity in the extract air. The upper limit of the relative humidity can be adjusted with the potentiometer as shown below (factory setting position A=84% rH).

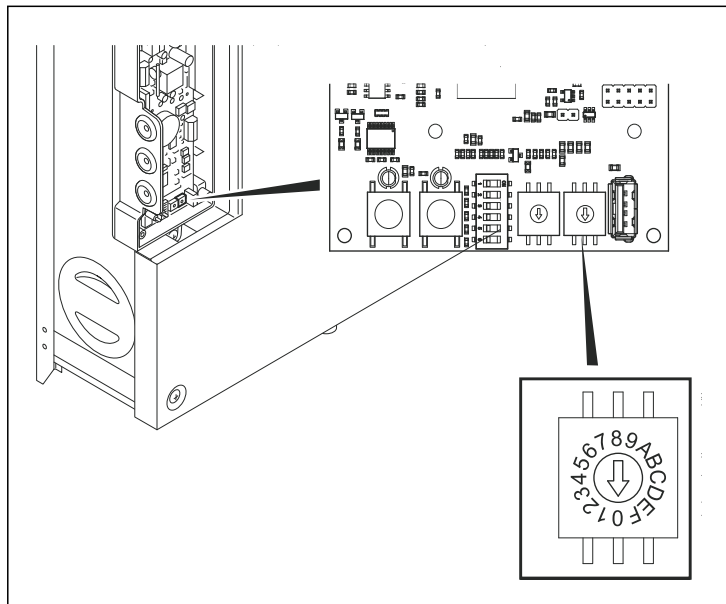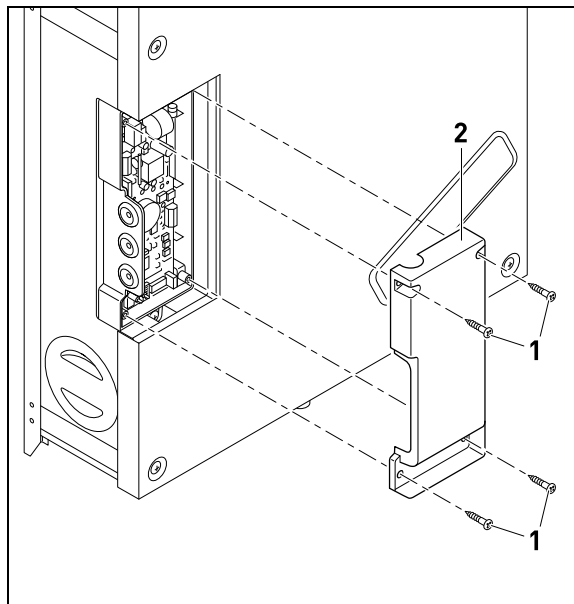

Potentiometer position	Maximum relative humidity (%)
0	64
1	66
2	68
3	70
4	72
5	74
6	76
7	78
8	80
9	82
A	84
B	86
C	88
D	90
E	-
F	-

Electronic board description

1	without function
2	without function
3	DIP SWITCH 6: 1 (Default command) - 0 (SPCM)
4	without function
5	Set point humidity sensor. No function in case of connection of the SPCM-1 Module
6	USB connector (for software updates)
7	temperature sensor
8	humidity sensor
9	extract fan
10	supply fan
11	power supply motors (230V/50Hz)
12	Potential free input to activate BOOST (maximum speed). Contact closed = BOOST active
13	outgoing error signal
14	Command connection / SPCM-1 Communication module

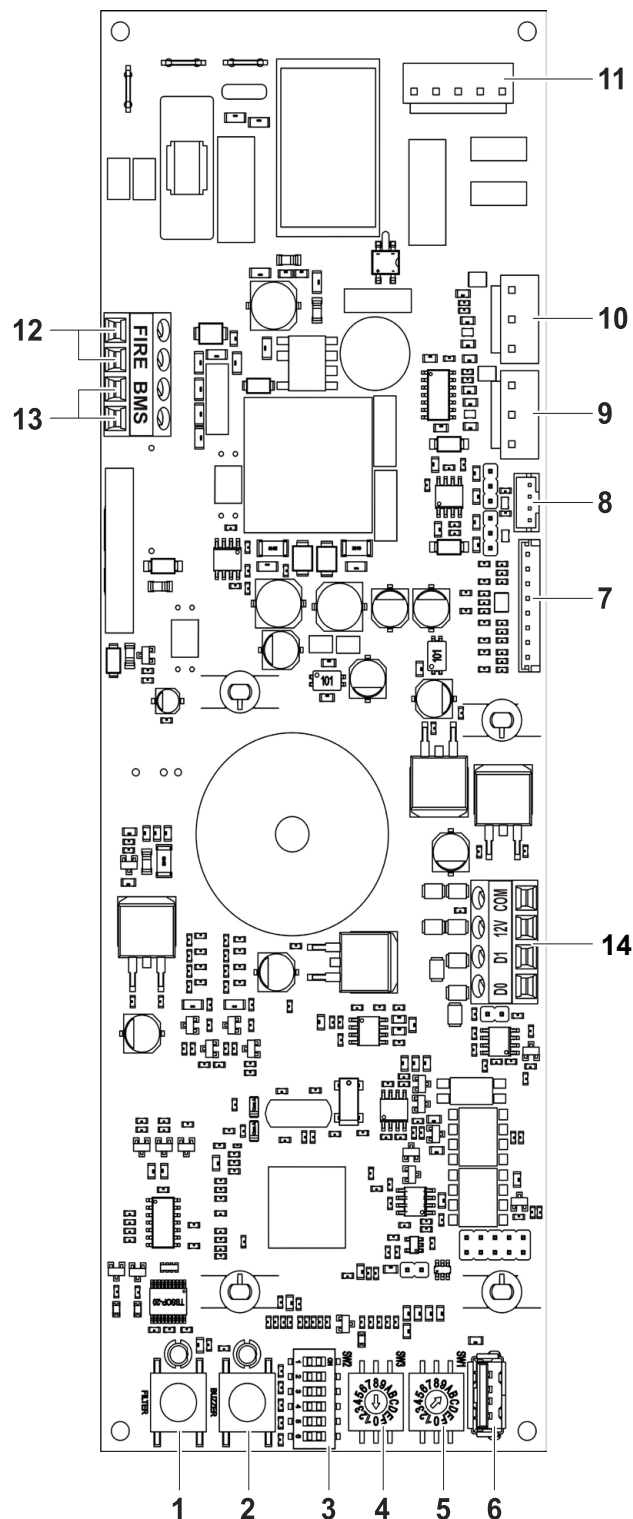

SPCM-1 COMMUNICATIONS MODULE: (optional)

The SPCM-1 communications board will allow you to connect the ALTAIR unit with the S&P IoT Platform: CONNEC-TAIR.

To connect the SPCM-1 module to the ALTAIR you must first disconnect the control (14) and then connect the SPCM-1 with the cable supplied to the same terminal block (14).


The communications module box can be attached to the ALTAIR for the Velcro type element.

We recommend sticking it to one of the sheet metal braces to ensure its correct fixation. If it is not possible, two screws with their respective plugs are attached to be fixed to the wall.

To allow the output of ALTAIR to the Internet, you must first connect it to your router. The SPCM-1 communications module has a wired (ETHERNET) or wireless (WIFI) connection. Follow the instructions you will find in the module box.




Remote control adjustments – USER

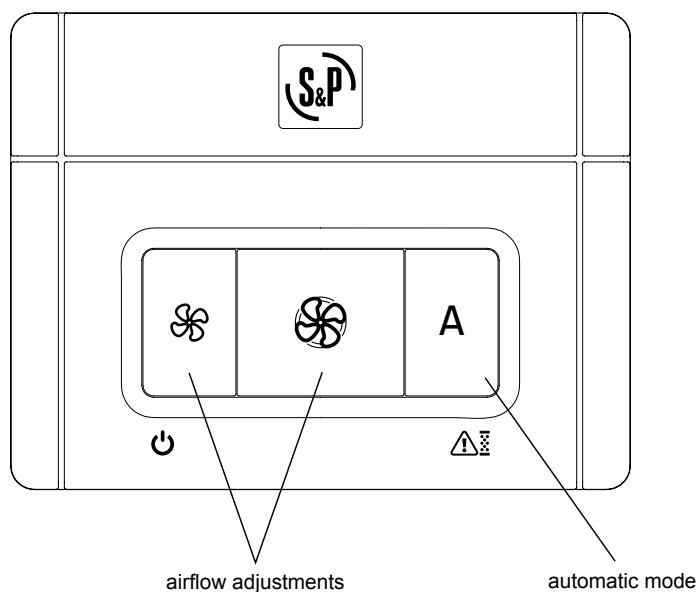

Speed adjustment


Pressing the “speed adjustment” buttons you can change the airflow. The LED of the active button will light green (left fan symbol= decrease speed, right fan symbol=increase speed).

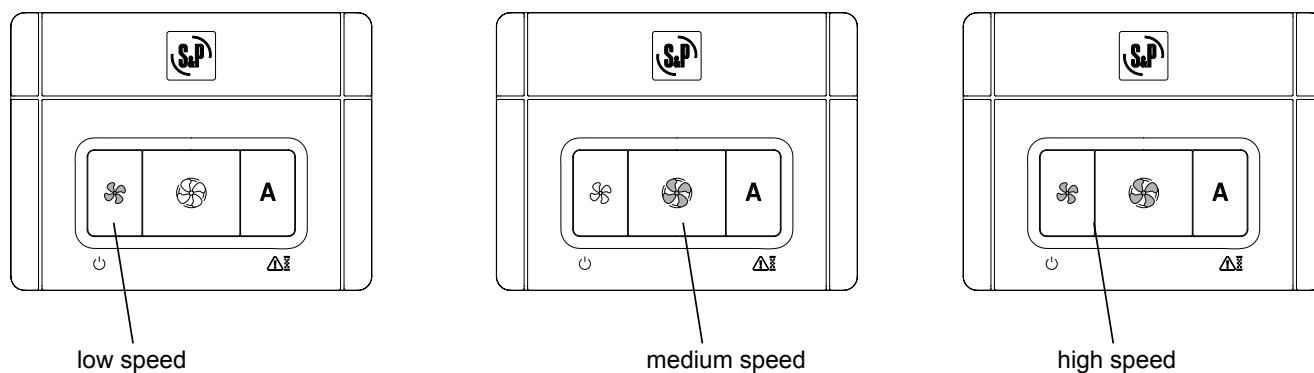

Automatic mode

Pressing the button “A” there can be activated the automatic mode. In the automatic mode works the unit proportional in dependence of the humidity measured in the extract airflow.


The working range is between 45% humidity and the 84% relative humidity. The max. humidity can be adjusted as explained in “Adjustment of the relative humidity %”.

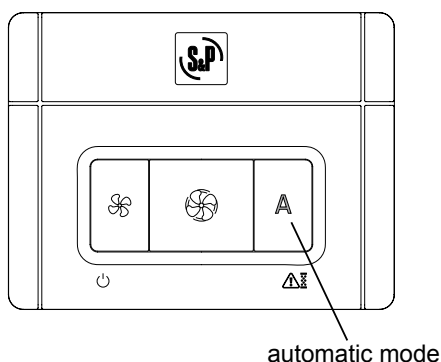


2.5. FILTER MAINTENANCE

We recommend a periodical maintenance of the filters (minimum 1x year).

After the adjusted period de alarm will be activate. For changing the filter, please remove the plastic taps (1) put the filters (2) out and substitute them with new ones. After changing the filter put back the plastic taps.

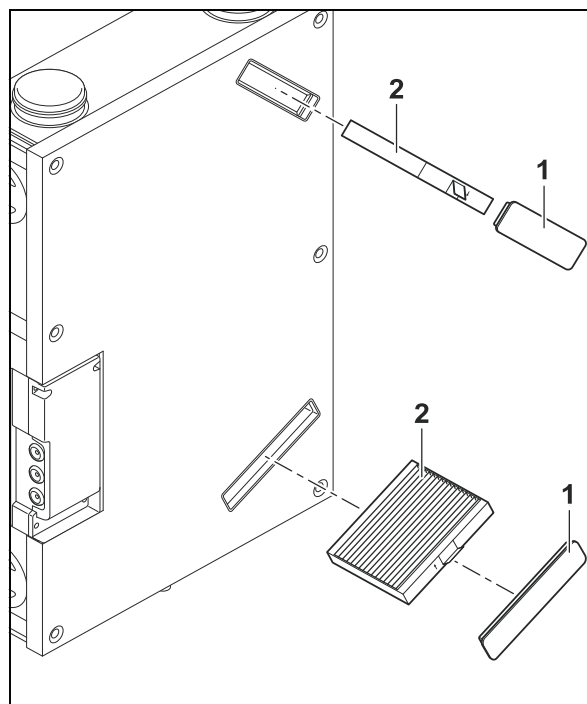


Everytime when filters are replaced the filter maintenance period has to be reseted pressing the button "A" during 5 seconds.

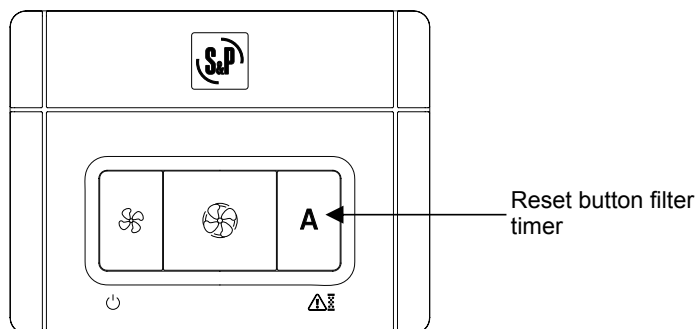

2.6. STANDBY FUNCTION

Push and hold the button for 3 seconds, the unit will switch into the standby mode. During the standby mode the button (posar simbol ventilador) will be red illuminated (see drawing below). To switch the unit on push the button again.

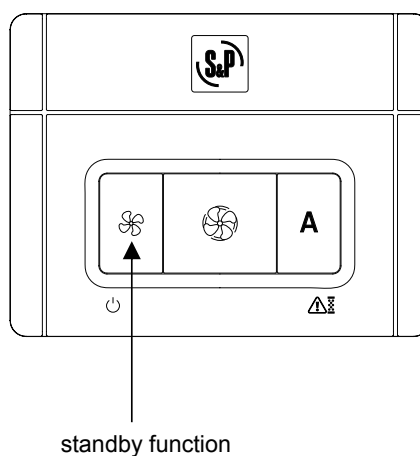



2.7. ALARM INDEX

Through the LED located in the "A" button on the remote control it is possible to supervise the status of the unit. This LED will show the alarm in case of a failure or missfunction on the unit. Depending on the risk level of the generated alarm the unit will stop for safety reasons.

Priority	Alarm	LED	Action
1	Extract fan error	1 red blink	unit stops
2	Supply fan error	2 red blinks	unit stops
3	Supply air temperature <5°C	4 red blinks	unit stops. Every 2 hours the unit starts for 5 minutes to check if conditions allow normal operation.
4	Humidity sensor	5 red blinks	normal operation
5	ODA sensor error (fresh air)	7 red blinks	normal operation
6	SUP sensor error (supply air)	8 red blinks	normal operation
7	ETA sensor error (extract air)	9 red blinks	normal operation
8	EHA sensor error (exhaust air)	10 red blinks	normal operation
9	Filter alarm	Red, continous	after 60 days the unit stops if filter is not changed an alarm reseted

2.8. GENERAL DATA

Parameter	ALTAIR 120 H	ALTAIR 160 H
Height	850 mm	970 mm
Width	550 mm	550 mm
Depth	208 mm	231 mm
Connection	ø95 mm	ø125 mm
Weight	20 kg	25 kg
Material	EPP body; front cover plate painted in white	
Drain	3/4" (drainpipe)	
Power supply	230 V AC, 50 Hz	
Maximum consumption	55W	74W
Airflow	120 m³/h	160 m³/h
Radiated noise LwA	52,2 dB (A)	53 dB(A)
Ambient temperature	from +10°C to +50°C	
Exterior temperature	until -18°C	
Extract temperature	from +10°C to +50°C	
Speed control	according to the adjusted speed on the remote control	
Fans	2 units, forward curved with EC motor	
Filters	supply G4 / extraction G4	
Thermal efficiency	83%	84%
Protection	IP21	

2.9. PUTTING OUT OF SERVICE AND RECYCLING

 EEC legislation and our consideration of future generations mean that we should always recycle materials where possible; please do not forget to deposit all packaging in the appropriate recycling bins. If your device is also labeled with this symbol, please take it to the nearest Waste Management Plant at the end of its serviceable life.

2.10. ERP DATA

 Ecodesign Commission regulation (EU) N°1253/2014 of July 2014 Information requirements (Annex V)		ALTAIR 120 H	ALTAIR 160 H
a	Trade mark	S&P	S&P
b	Identifier	5153811000	5153182800
c	SEC average climate (kWh/(m ² .an))	-38,0	-37,8
	SEC class	A	A
	SEC cold climate (kWh/(m ² .an))	-75,1	-73,9
	SEC warm climate (kWh/(m ² .an))	-14,2	-14,6
d	Typology	RVU bidirectional	RVU bidirectional
e	Type of drive	Variable speed drive	Variable speed drive
f	Type of HRC	Recuperative	Recuperative
g	Thermal efficiency (%)	83	79
h	Maximum flow rate (m ³ /h)	120	158
i	Electrical power input at maximum flow rate (W)	55,0	54
j	Sound power level (LWA)	47	48
k	Reference flow rate (m ³ /s)	0,023	0,031
l	Reference pressure difference (Pa)	50,0	96
m	SPI (W/m ³ /h)	0,262	0,222
n	Control factor	0,85	0,85
	Control typology	Central demand	Central demand
o	Maximum internal leakage for BVU (%)	2,9	1,3
	Maximum external leakage for BVU and UVU (%)	2,9	3,0
p	Mixing rate for BVU without duct connection (%)	not applicable	not applicable
q	Position of visual filter warning	Remote control	Remote control
	description of visual filter warning	Pilot light	Pilot light
r	Instructions to install supply grilles	not applicable	not applicable
	Instructions to install exhaust grilles	not applicable	not applicable
s	Internet address	www.solerpalau.com	www.solerpalau.com
t	Airflow sensitivity to pressure variation	not applicable	not applicable
u	Indoor/outdoor air tightness (m ³ /h)	not applicable	not applicable
v	Annual electricity consumption - Average climat (kWh/a)	282	246
	Annual electricity consumption - Warm climat (kWh/a)	237	201
	Annual electricity consumption - Cold climat (kWh/a)	819	783
w	Annual heating saved - Average climat (kWh/a)	4440	4332
	Annual heating saved - Warm climat (kWh/a)	2010	1959
	Annual heating saved - Cold climat (kWh/a)	8690	8474



S&P SISTEMAS DE VENTILACIÓN, S.L.U.

C. Llevant, 4
Polígono Industrial Llevant
08150 Parets del Vallès
Barcelona - España

Tel. +34 93 571 93 00
www.solerpalau.com



Ref. 9023110800-04