



产品认证证书

证书编号: CQC2014010302740479

申请人名称及地址

ABB S.P.A. - ABB SACE Division
Via C. Pescaria 5, 24123 Bergamo ITALY

制造商名称及地址

ABB S.P.A. - ABB SACE Division
Via C. Pescaria 5, 24123 Bergamo ITALY

生产企业名称及地址

ABB S.P.A. - ABB SACE Division (V054909)
Via Enrico Fermi 14, IT-03100 Frosinone Italy

产品名称和系列、规格、型号

隔离开关

XT1 D, XT1H-D; 详见附件

产品标准和技术要求

GB/T14048.3-2017

认证模式

型式试验+初始工厂检查+获证后监督

上述产品符合 CQC11-462141-2019 认证规则的要求, 特发此证。

发证日期: 2020 年 09 月 02 日 有效期至: 2024 年 12 月 10 日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

经中国合格评定国家认可委员会认可 CNAS C001-P

主任: _____

陆楠



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

C 0356154



PRODUCT CERTIFICATE

CERTIFICATE NO.: CQC2014010302740479

NAME AND ADDRESS OF THE APPLICANT

ABB S.P.A. - ABB SACE Division
Via C. Pescaria 5, 24123 Bergamo ITALY

NAME AND ADDRESS OF THE MANUFACTURER

ABB S.P.A. - ABB SACE Division
Via C. Pescaria 5, 24123 Bergamo ITALY

NAME AND ADDRESS OF THE FACTORY

ABB S.P.A. - ABB SACE Division (V054909)
Via Enrico Fermi 14, IT-03100 Frosinone Italy

PRODUCT NAME, MODEL AND SPECIFICATION

Switch-disconnector
XT1 D, XT1H-D;详见附件

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T14048.3-2017

TYPE OF CERTIFICATION SCHEMES

Type testing of product + initial factory inspection + follow up factory inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC11-462141-2019 .

Valid from: Sep.02,2020

Valid until: Dec.10,2024

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

Accredited by China National Accreditation Service for Conformity Assessment CNAS C001-P

President:

Lu Mei



CHINA QUALITY CERTIFICATION CENTRE

Section 9, No.188, Nansihuan Xilu, Beijing 100070 P.R.China
<http://www.cqc.com.cn>

C 0356154



产品认证证书

第 1 页 共 2 页

附 录

证书编号: CQC2014010302740479

纸 号: 356154

型号: XT1 D, XT1H-D

额定冲击耐受电压 (U_{imp}): 8kV;

额定绝缘电压 (U_i): 800V;

约定发热电流 (I_{th}): 160A (XT1 D), 125A (XT1H-D);

使用类别:

AC-22A: U_e/I_e : AC400V/415V/690V/160A (XT1 D),

AC400V/415V/690V/125A (XT1H-D);

AC-23A: U_e/I_e : AC400V/415V/690V /125A (XT1 D),

AC400V/415V/690V /125A (XT1H-D);

DC-22A: U_e/I_e : DC500V/160A (XT1 D), DC500V/125A (XT1H-D);

DC-23A: U_e/I_e : DC500V/125A (XT1 D), DC500V/125A (XT1H-D);

额定短时耐受电流 (I_{cw}): 2 kA/1s (XT1 D), 1.5kA/1s (XT1H-D);

额定短路接通能力 (I_{cm}) (峰值): 2.84kA (XT1 D), 2.12kA (XT1H-D);

极数: 3P, 4P;

频率: 50/60Hz;

直流接线方式:

注: 此附录与证书同时使用时有效。

主任: _____

陆杨



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



产品认证证书


附录

第 2 页 共 2 页


证书编号: CQC2014010302740479

纸号: 356154

500Vdc 4p in series

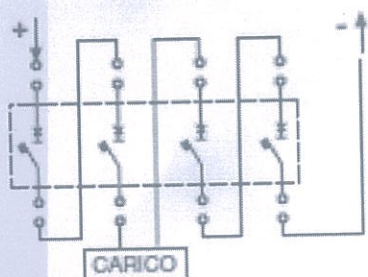

型号解释:

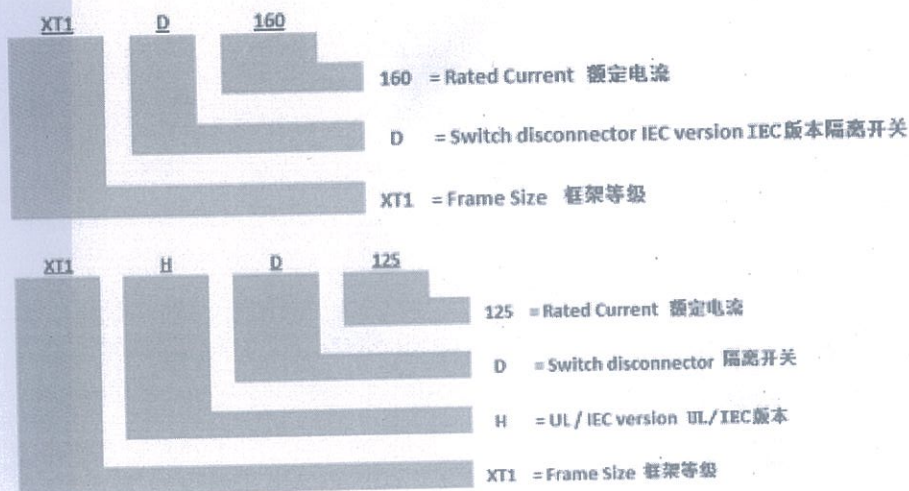

注: 此附录与证书同时使用时有效。

主任:

陆杨

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>

