



产品认证证书

证书编号: CQC2015010302794768

申请人名称及地址

ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

制造商名称及地址

ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

生产企业名称及地址

ABB 新会低压开关有限公司 (V005372)
广东省江门市新会区今古洲工业开发区

产品名称和系列、规格、型号

隔离开关

XT1D: 详情见附件

产品标准和技术要求

GB/T14048.3-2017

认证模式

型式试验+获证后监督

上述产品符合 CQC11-462141-2019 认证规则的要求, 特发此证。

发证日期: 2020 年 08 月 14 日 有效期至: 2024 年 11 月 14 日
证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

主任: _____

陆梅



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

C 0351931



PRODUCT CERTIFICATE

CERTIFICATE NO.: CQC2015010302794768

NAME AND ADDRESS OF THE APPLICANT

ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

NAME AND ADDRESS OF THE MANUFACTURER

ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

NAME AND ADDRESS OF THE FACTORY

ABB Xinhui Low Voltage Switchgear Co.,Ltd. (V005372)
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

PRODUCT NAME, MODEL AND SPECIFICATION

Switch — disconnecter
XT1 D: See the appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T14048.3-2017

TYPE OF CERTIFICATION SCHEMES

Type testing+Follow up factory inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC11-462141-2019 .

Valid from: Aug.14,2020

Valid until: Nov.14,2024

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

President: _____

陆梅

Lu Mei



CHINA QUALITY CERTIFICATION CENTRE

Section 9, No.188, Nansihuan Xilu, Beijing 100070 P.R.China

<http://www.cqc.com.cn>

C 0351931



产品认证证书

附录

第 1 页 共 2 页

证书编号: CQC2015010302794768

纸号: 351931

XT1 D

额定绝缘电压(U_i): 800V;

额定冲击耐受电压(U_{imp}): 8kV;

约定发热电流(I_{th}): 160A;

额定短时耐受电流(I_{cw}): 2 kA/1s;

额定短路接通能力(I_{cm}) (峰值): 2.84kA;

使用类别:

AC-22A : U_e/I_e : AC400V/415V/AC690V/160A;

AC-23A: U_e/I_e : AC400V/415V/AC690V /125A;


DC-22A: U_e/I_e : DC500V/160A;

DC-23A: U_e/I_e : DC500V/125A;

极数: 3P, 4P;

极数: 50/60Hz;

直流接线图:

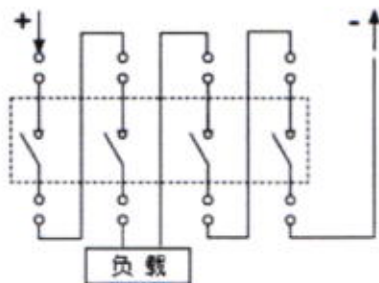

DC500V 4极串联

注: 此附录与证书同时使用时有效。

主任:

陆梅



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



产品认证证书

附 录


第 2 页 共 2 页

证书编号: CQC2015010302794768

纸 号: 351931

型号解释:

Tmax 系列隔离开关

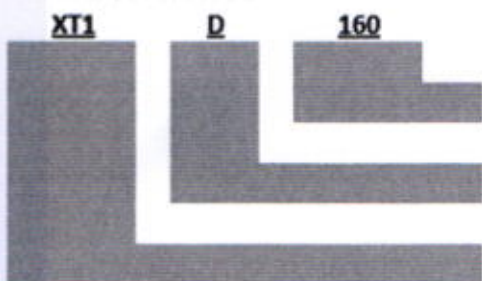

160 = 额定电流

D = 隔离开关

XT1 = 设计序号

注: 此附录与证书同时使用时有效。

主任: 陆梅



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>