

Eaton's Bussmann series 12 kV Medium voltage fuse links



Product description

Eaton's Bussmann series range of 12 kV DIN Medium voltage fuse links are suitable for transformer protection.

These fuse links can be used even where there is no secondary LV protection, provided they are used with fuse switches fitted with instantaneous striker tripping.

Standard features

- Cool running, low watts loss and power dissipation thanks to the M-effect ensuring high levels of substation utilisation.
- Silver elements ensuring high conductivity and low power (revenue) loss.
- 100% X-ray, all our medium voltage fuse links are X-rayed ensuring the highest possible standards are maintained.

Catalogue symbol:

- 12AILSJ(amp)
- 12TDLEJ(amp)
- 12THLEJ(amp)
- 12TKLEJ(amp)
- 12TXLEJ(amp)
- 12TFMSJ(amp)

Technical data:

- Volts: 12 kV
- Amps: 6.3 to 200 A
- Breaking capacity: 50 kA
- Class of operation: Back-up as IEC 60282-1 (2005)
- Suitable for outdoor and indoor use
- RoHS compliant

Standards/Approvals:

- DIN 43625
- VDE 0670 part 4 and 402
- IEC 60282-1 (2005)


Packaging:

- MOQ 3


Table 1. Technical data

Dimensions - mm

EJ Outline

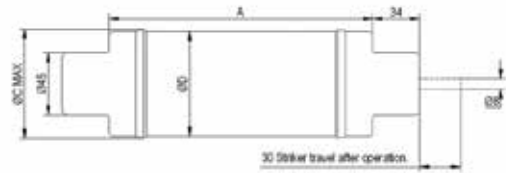

SJ Outline

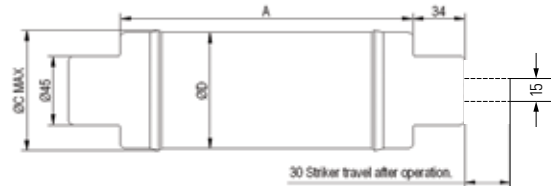

Fuse reference	A	C	D	Weight (Kg)
AILSJ	292	79	76	3.3
TDLEJ	292	54	51	1.7
THLEJ	292	67	64	2.6
TKLEJ	292	80	76	3.5
TXLEJ	292	88	88	3.7
THMEJ	442	67	64	3.7
TFMSJ	442	80	76	5.1

Part numbers	Current I_n (A)	Breaking capacity I_b (kA)	Minimum breaking current I_s (A)	Cold resistance & Watts loss in free air		Joule integral (I^2t)		Length mm	Diameter mm	Weight kg
				mΩ	W	Minimum Pre-arcing	Maximum operating			
12TDLEJ6.3	6.3	63	23	222	10	9.8×10^1	1×10^3	292	51	1.7
12TDLEJ10	10	63	35	131	16	2.8×10^2	2.3×10^3	292	51	1.7
12TDLEJ16	16	63	53	54.6	16	2.6×10^2	3.9×10^3	292	51	1.7
12TDLEJ20	20	63	73	39.1	18	5.2×10^2	5.4×10^3	292	51	1.7
12TDLEJ25	25	63	87	31.2	24	8.1×10^2	8.4×10^3	292	51	1.7
12TDLEJ31.5	31.5	63	111	23.4	28	1.4×10^3	1.5×10^4	292	51	1.7
12TDLEJ40	40	63	143	17.2	36	2.4×10^3	2.5×10^4	292	51	1.7
12TDLEJ50	50	63	168	13.5	47	2.8×10^3	3.1×10^4	292	51	1.7
12TDLEJ63	63	63	235	10.6	60	4.3×10^3	4.7×10^4	292	51	1.7
12THLEJ80	80	63	272	7.81	72	7.9×10^3	9.1×10^4	292	64	2.6
12THLEJ100	100	63	388	5.74	85	2×10^4	1.4×10^5	292	64	2.6
12AILSJ100*	100	31.5	176	53	70	1.4×10^4	2×10^5	292	76	3.3
12TKLEJ125	125	63	687	3.99	93	4×10^4	3.5×10^5	292	76	3.5
12TXLEJ160**	160	63	560	4.3	217	1.1×10^5	5×10^5	292	88	3.7
12TXLEJ200**	200	63	610	3.8	333	1.5×10^5	6.5×10^5	292	88	3.7
12THMEJ100	100	63	272	5.74	85	2×10^4	1.4×10^5	442	64	3.7
12TFMSJ160	160	50	485	3.65	139	5×10^4	3.5×10^5	442	76	5.1

* Not suitable for outdoor use / ** Not compliant with VDE 0670 part 402

Striker diagrams

S = Spring diagram 50N to DIN 43625 and IEC 60282-1 designation 'medium'

E = Spring striker 80N to IEC 60282-1 designation 'medium'

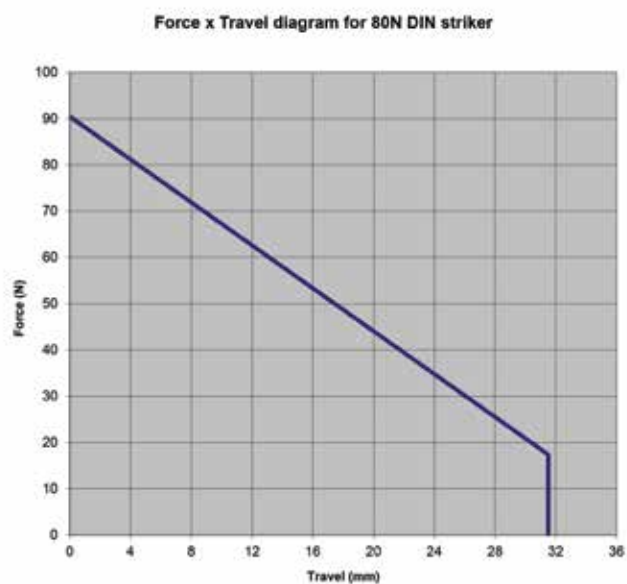
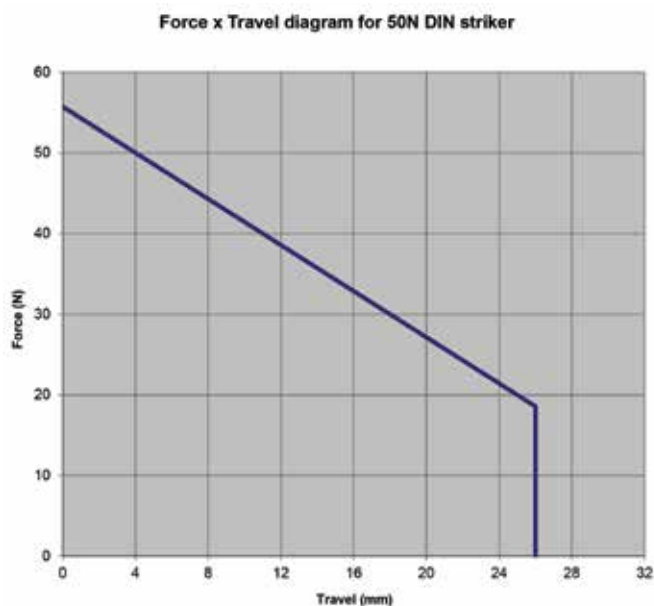



Table 2. Cross-reference

Eaton's Bussmann series	EFEN	SIBA	MESA	ETI 80N Striker	ETI 50N Striker	Merlin Gerin	Inael	ABB
12TDLEJ6.3	67120.0060	3000413	CF-12/6,3	4236005	4235005	51006 511 M0	IB-D1	1YMB531042M0001
12TDLEJ10	67120.0100	3000413	CF-12/10	4236006	4235006	51006 512 M0	IB-D1	1YMB531042M0002
12TDLEJ16	67120.0160	3000413	CF-12/16	4236007	4235007	51006 513 M0	IB-D1	1YMB531042M0003
12TDLEJ20	67120.0200	3000413	CF-12/20	4236008	4235008	51006 514 M0	IB-D1	1YMB531042M0004
12TDLEJ25	67120.0250	3000413	CF-12/25	4236009	4235009	51006 515 M0	IB-D1 & IB-D2	1YMB531002M0004
12TDLEJ31.5	67120.0320	3000413	CF-12-31,5	4236010	4235010	51006 516 M0	IB-D1 & IB-D2	1YMB531002M0014
12TDLEJ40	67120.0400	3000413	CF-12/40	4236011	4235011	51006 517 M0	IB-D1 & IB-D2	1YMB531002M0005
12TDLEJ50	67120.0500	3000413	CF-12/50	4236012	4235012	51006 518 M0	IB-D2	1YMB531002M0006
12TDLEJ63	67120.0630	3001213	CF-12/63	4236013	4235013	51006 519 M0	IB-D2	1YMB531002M0007
12THLEJ80	67120.0800	3001213	CF-12/80	4236014	4235014	51006 520 M0	IB-D3	1YMB531002M0021
12THLEJ100	67120.1000	3001213	CF-12/100	4236015	4235015	51006 521 M0	IB-D3	1YMB531002M0022
12TKLEJ125	67120.1250	3001213	N/A	4236016	4235016	N/A	N/A	1YMB531043M0010
12TXLEJ160	67220.1600	3002013	N/A	4236017	4235017	N/A	N/A	N/A
12TXLEJ200	67220.2000	3002014	N/A	N/A	N/A	N/A	N/A	N/A


Table 3. Watts loss comparison

Eaton's Bussmann series	Eaton's Bussmann series	Efen	SIBA	MESA	ETI	Merlin Gerin	INAEI	ABB
12TDLEJ6.3	10	19	14	16	15	16	12	46
12TDLEJ10	16	29	23	18	10	18	19	25
12TDLEJ16	16	21	28	37	19	37	27	34
12TDLEJ20	18	25	23	42	23	42	28	38
12TDLEJ25	24	31	29	52	33	52	29	47
12TDLEJ31.5	28	39	38	59	46	59	36	41
12TDLEJ40	36	46	50	74	56	74	50	52
12TDLEJ50	47	62	56	70	44	70	52	70
12TDLEJ63	60	60	63	82	65	82	64	78
12THLEJ80	72	82	76	102	77	102	95	82
12THLEJ100	85	96	104	120	104	120	120	101
12TKLEJ125	93	117	159		152			125
12TXLEJ160	217	217	173		200			
12TXLEJ200	333	333	292					


Time current curve - Fuse type AILS

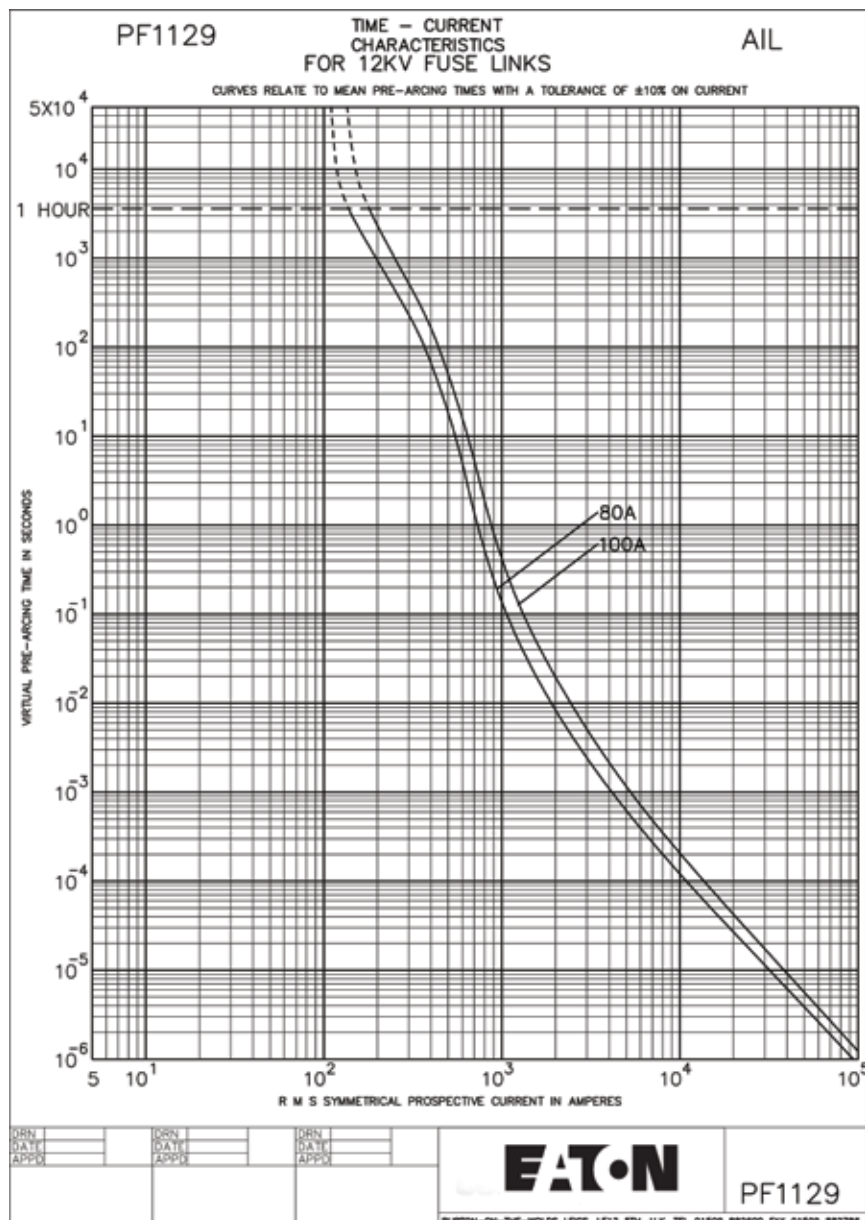


Time current curve - Fuse type TXL

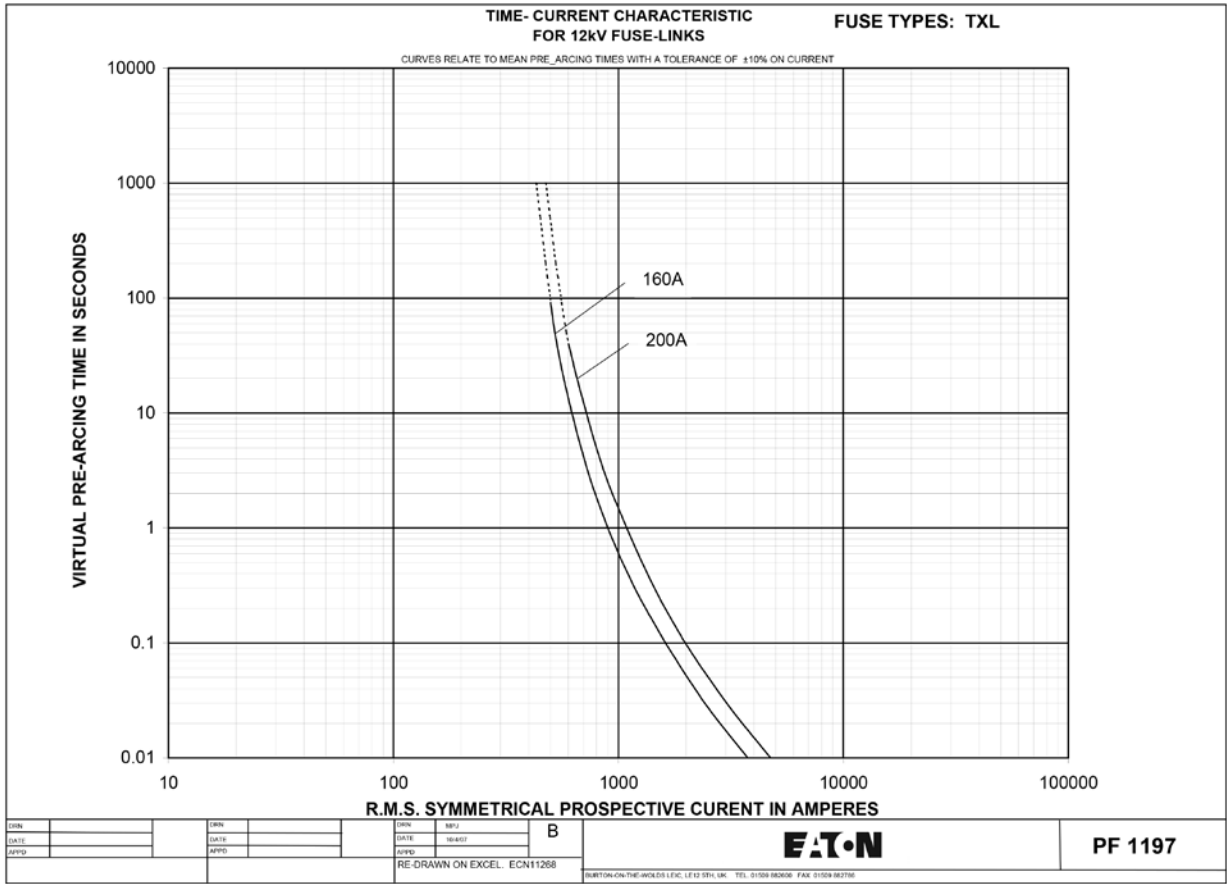


Time current curve - Fuse types TDL,THL,TKL

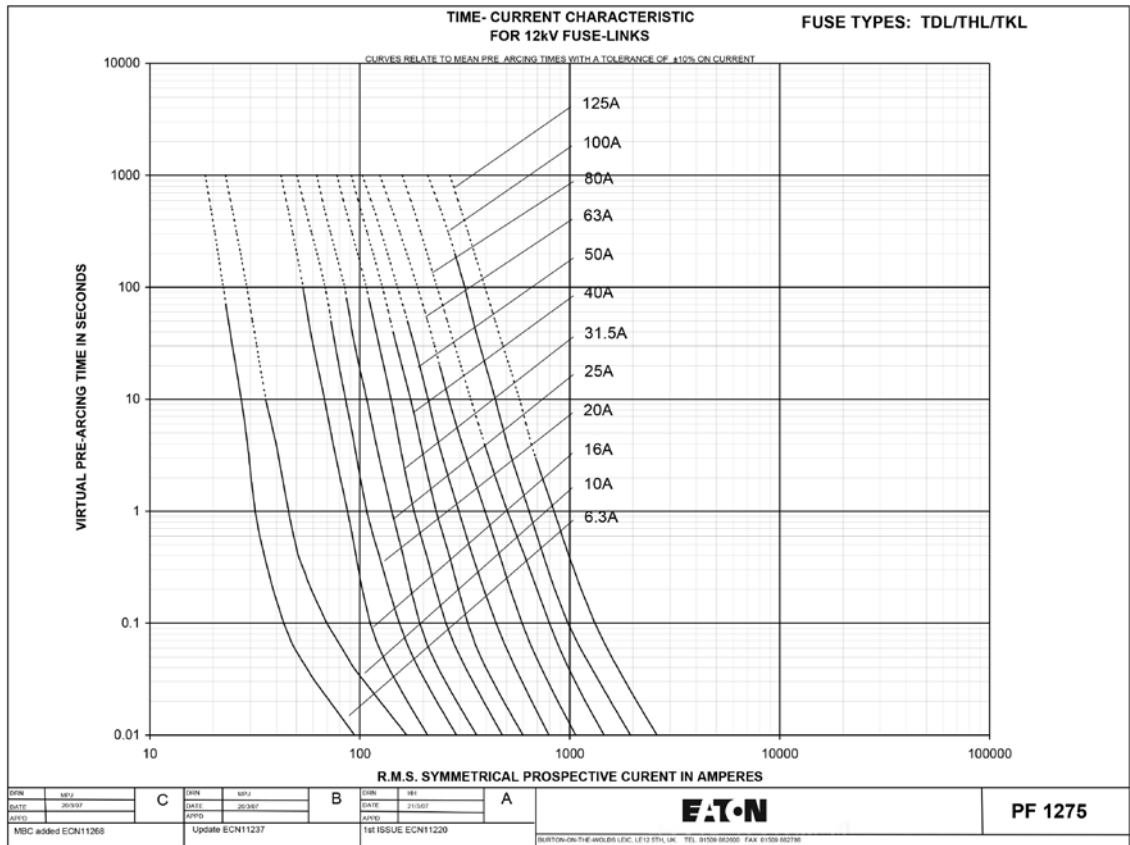


Time current curve - Fuse types THM, TKM, TFM

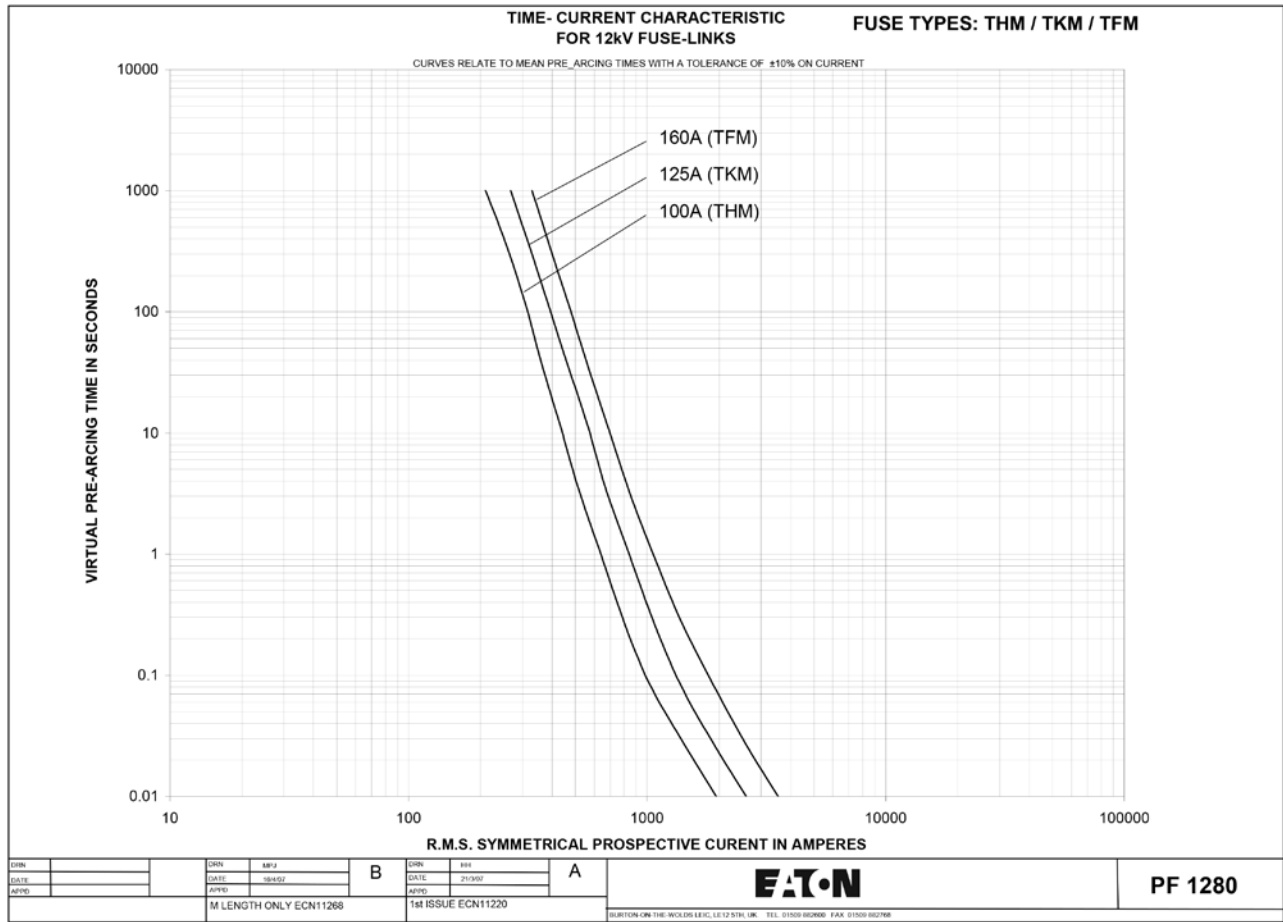


Cut-off curve - Fuse types TDL, THL, TKL

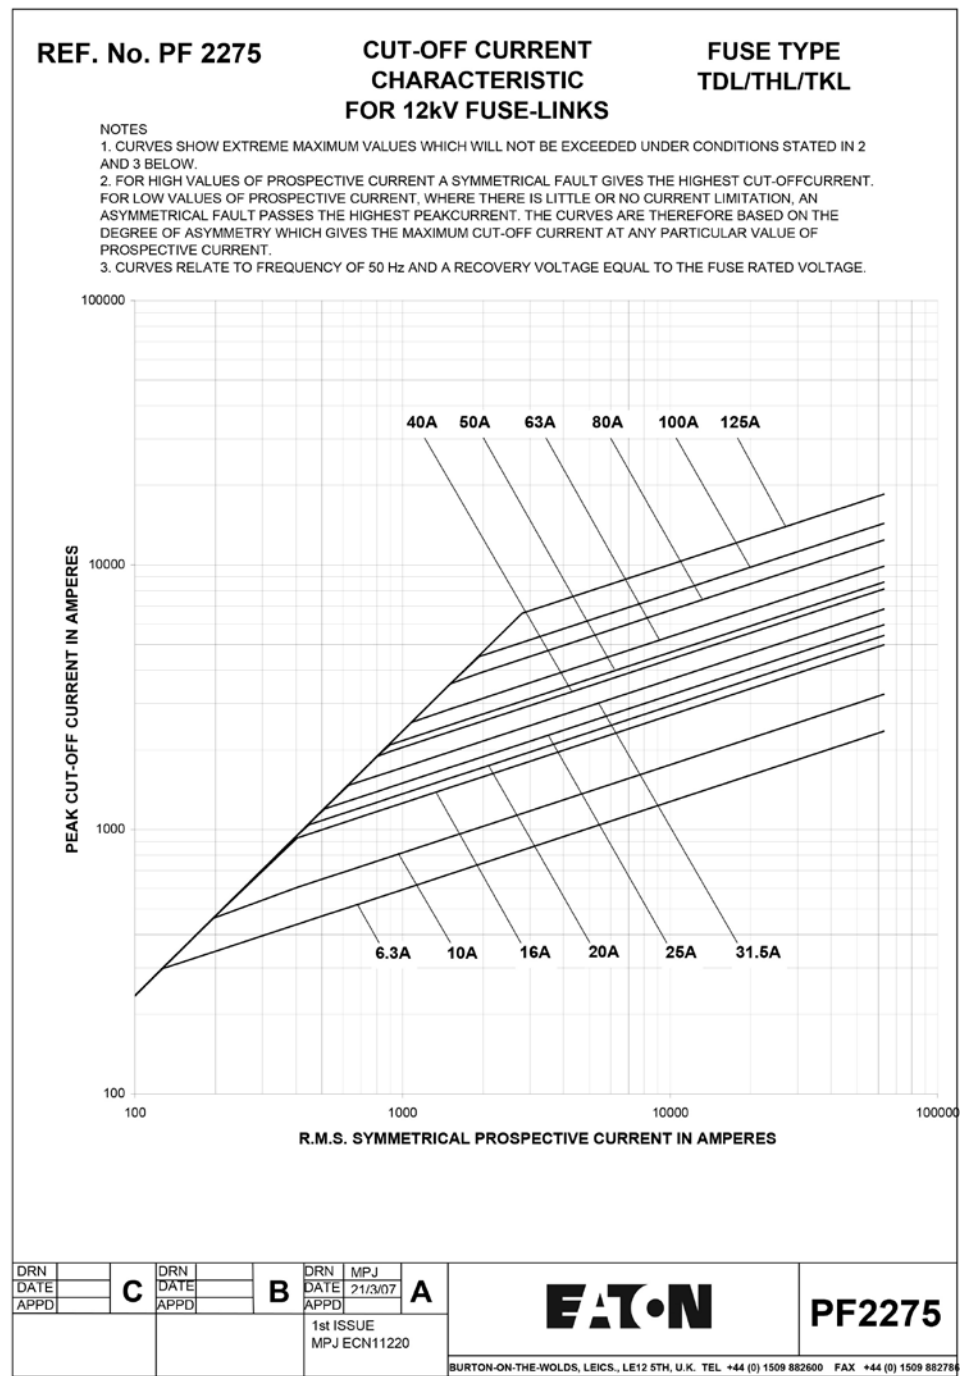

Cut-off curve - Fuse types THM, TKM, TFM

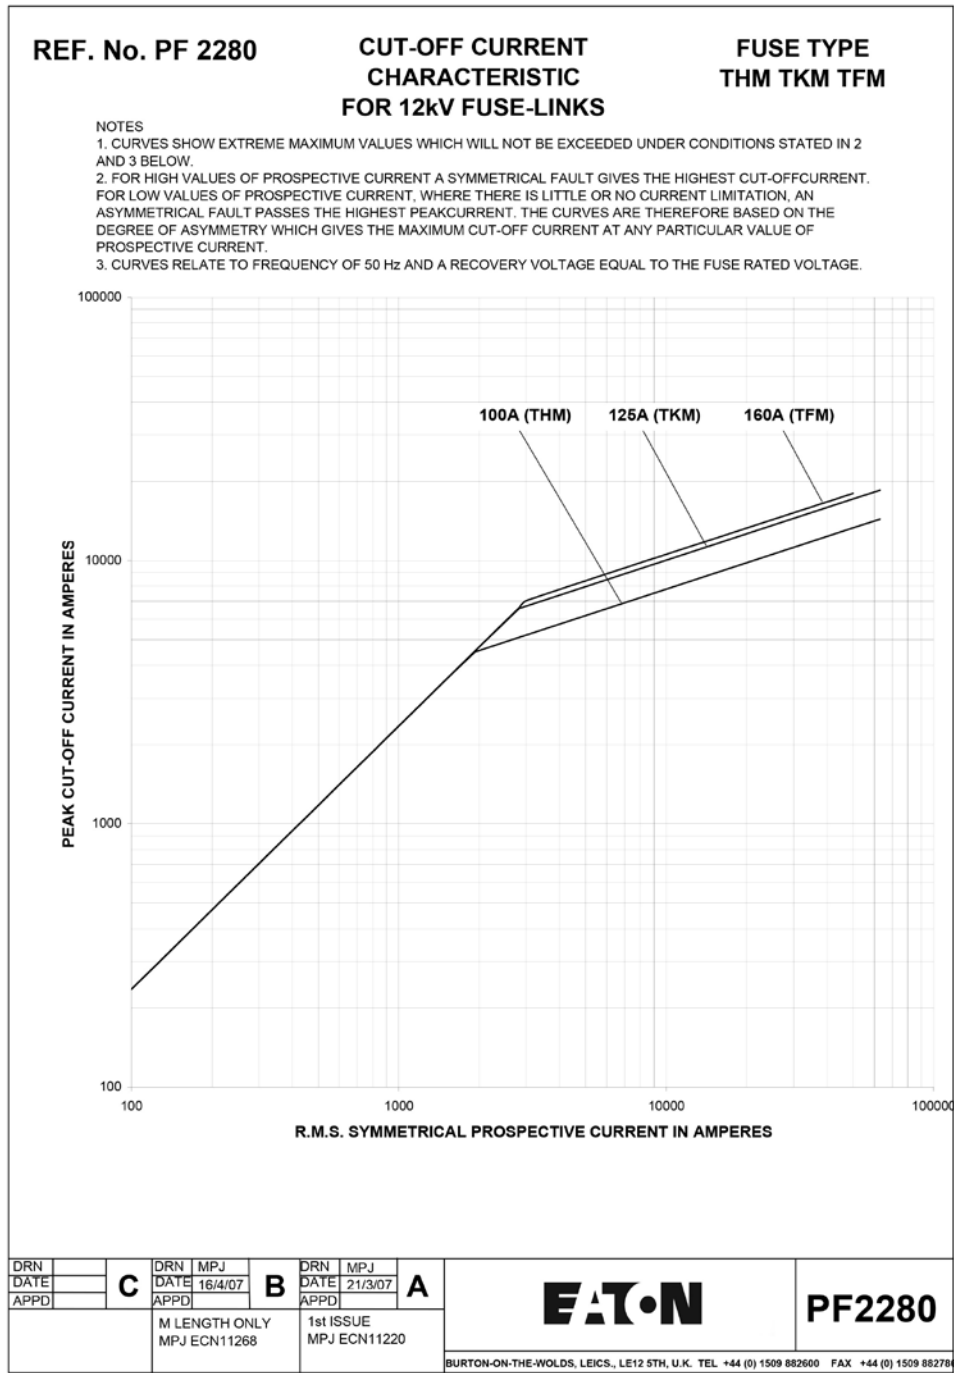

Cut-off curve - Fuse type TXL

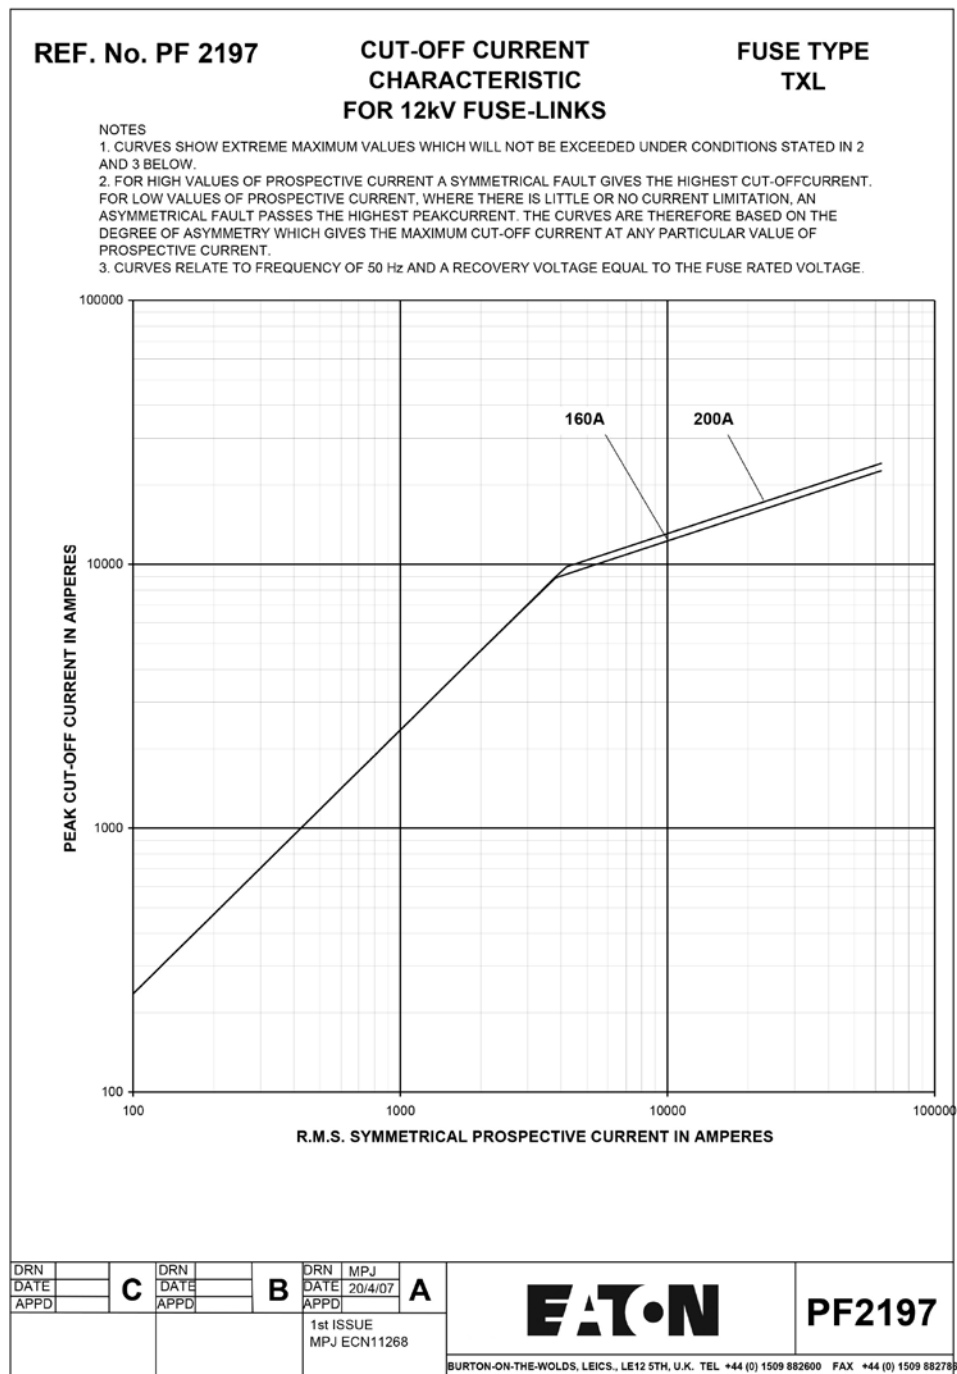

ASTA certificate

ASTA

CERTIFICATE OF SELECTED TYPE TESTS

Laboratory Ref. No: DHK007-01

Certificate No. 16595

APPARATUS: Eight Homogeneous Series of Air Insulated High Voltage Current Limiting Back-up Fuses Filled with Spring Operated Medium Striker Devices.

Ratings >	Series 1.	Type 12TDLEJ6.3	Rated Voltage 12kV	Rated Current 6.3A	Rated Frequency 50Hz
Series 2.	Type 12TDLEJ10	Rated Voltage 12kV	Rated Current 10A	Rated Frequency 50Hz	
Series 3.	Type 12TDLEJ16	Rated Voltage 12kV	Rated Current 16A	Rated Frequency 50Hz	
	Type 12TDLEJ20	Rated Voltage 12kV	Rated Current 20A	Rated Frequency 50Hz	
	Type 12TDLEJ25	Rated Voltage 12kV	Rated Current 25A	Rated Frequency 50Hz	
	Type 12TDLEJ31.5	Rated Voltage 12kV	Rated Current 31.5A	Rated Frequency 50Hz	
	Type 12TDLEJ40	Rated Voltage 12kV	Rated Current 40A	Rated Frequency 50Hz	
Series 4.	Type 12TDLEJ50	Rated Voltage 12kV	Rated Current 50A	Rated Frequency 50Hz	
Series 5.	Type 12TDLEJ63	Rated Voltage 12kV	Rated Current 63A	Rated Frequency 50Hz	
Series 6.	Type 12THLEJ80	Rated Voltage 12kV	Rated Current 80A	Rated Frequency 50Hz	
Series 7.	Type 12THLEJ100	Rated Voltage 12kV	Rated Current 100A	Rated Frequency 50Hz	
Series 8.	Type 12TKLEJ125	Rated Voltage 12kV	Rated Current 125A	Rated Frequency 50Hz	

DESIGNATION: Types "12TDLEJ6.3 to 63, 12THLEJ80 to 100, 12TKLEJ125"

MANUFACTURER: Cooper Bussmann India Private Limited, Evr Street, Sedarapet, Pondicherry - 605111, India.

TESTED BY: Dean H. Klohr Low Power Test Facility, Burton-on-the-Wolds, Loughborough, Leicestershire. LE12 5TH, United Kingdom.

DATE OF TESTS: 10th October 2006 to 15th February 2007

The apparatus, constructed in accordance with the description, drawings and photographs incorporated in this Certificate, has been subjected to the series of proving tests in accordance with

IEC 60282-1:2005 Sub-clause 6.5 - Temperature-rise tests and power-dissipation measurement
Sub-clause 6.7 - Tests for time-current characteristics
Sub-clause 6.8 - Tests of strikers
Sub-clause 7.3 - Thermal shock tests
Sub-clause 7.5 - Waterproof test - (ingress of moisture)
Sub-clause 7.6.2 - Pre-arcing temperature rise tests

The results are shown in the Record of Proving Tests and the oscillograms attached hereto. The values obtained and the general performance are considered to comply with the above Standard(s) and to justify the ratings and characteristics assigned by the manufacturer as listed on page number 1.

The record of Proving Tests applies only to the apparatus tested. The responsibility for conformity of any apparatus having the same designation with that tested rests with the Manufacturer.


This Certificate comprises 55 pages, 1 diagram, 3 oscillograms, 7 photographs, 16 drawings and no other sheets as detailed in page 2

Only integral reproduction of this Certificate, or reproductions of this page accompanied by any page(s) on which are stated the assigned rated characteristics of the apparatus tested, are permitted without written permission from ASTA BEAB Certification Services, Hilton House, Corporation Street, Rugby. CV21 2DN England.

 **UKAS**
PRODUCT
CERTIFICATION



 **ASTA Observer**
J. Gout

 **Director**
C. Dick-Evans

2014 April 2007 **Date**

010

KEMA certificate

KEMA 

**Type test Certificate of
breaking performance**

**Cooper Bussmann India
Private Limited**
Sedarapet, Pondicherry, India

has successfully passed the type test sequence on

Current limiting fuses

Type: 12TDLEJ6.3, 12TDLEJ10, 12TDLEJ16, 12TDLEJ20,
12TDLEJ25, 12TDLEJ31.5, 12TDLEJ40, 12TDLEJ50,
12TDLEJ63, 12THLEJ80, 12THLEJ100, 12THMEJ100,
12TKLEJ125

Rating: 12 kV – 63 kA – 50 Hz

The test object passed the specification of test duties of

IEC 60282-1

The test results are recorded in Certificate No.

137-06

This Certificate is issued on 17 April 2007

KEMA Nederland B.V.



P.G.A. Bus
KEMA T&D Testing Services
Managing Director



Copyright © KEMA Nederland B.V.
Please note that this document has been issued for information purposes only, and that the original bound
and sealed paper copy of the Certificate including the results of the tests of the apparatus will prevail. This
document does not imply that KEMA has certified or approved any apparatus other than the specimen tested.

Experience you can trust

KEMA certificate

KEMA 137-06

TYPE TEST CERTIFICATE OF BREAKING PERFORMANCE

APPARATUS Current limiting fuses

Designation	Rated voltage kV	Rated breaking capacity kA	Rated current A	Minimum breaking current A	Rated frequency Hz
12TDLEJ6.3	12	63	6,3	23	50
12TDLEJ10	12	63	10	35	50
12TDLEJ16 (1)	12	63	16	53	50
12TDLEJ20 (1)	12	63	20	73	50
12TDLEJ25 (1)	12	63	25	87	50
12TDLEJ31,5 (1)	12	63	31,5	111	50
12TDLEJ40 (1)	12	63	40	143	50
12TDLEJ50	12	63	50	168	50
12TDLEJ63	12	63	63	235	50
12THLEJ80	12	63	80	272	50
12THLEJ100, 12THMEJ100 (1)	12	63	100	388	50
12TKLEJ125	12	63	125	687	50

(1) See notes on page 7.

MANUFACTURER Cooper Bussmann India Private Limited,
Sedarepet, Pondicherry, India

TESTED FOR Cooper Bussmann (UK) Limited,
Burton-on-the-Wolds, United Kingdom

TESTED BY KEMA HIGH-POWER LABORATORY
Utrechtseweg 310 - 6812 AR Arnhem - The Netherlands

DATE(S) OF TESTS 25, 26, 27 September, 19 October, 3 November 2006, 16 January, 1 February 2007

The apparatus, constructed in accordance with the description, drawings and photographs incorporated in this Certificate, has been subjected to the series of proving tests in accordance with

IEC 60282-1 clause 6.6 (test duty 1, 2 and 3).

This Type Test Certificate has been issued by KEMA following exclusively the STL Guides.

The results are shown in the record of Proving Tests and the oscillograms attached hereto. The values obtained and the general performance are considered to comply with the above Standard and to justify the ratings assigned by the manufacturer as listed on page 6.

This Certificate applies only to the apparatus tested. The responsibility for conformity of any apparatus having other dimensions with that tested rests with the Manufacturer.

This Certificate consists of 2 pages in total.

This Certificate falls under the scope of the accreditation certificate L 020 of the Dutch Council for Accreditation.

Information sheet (page 2).

© Copyright: Only integral reproduction of this Certificate, or reproductions of this page accompanied by any page(s) on which are stated the endorsed ratings of the apparatus tested, are permitted without written permission from KEMA. Electronic copies in e.g. PDF-format or scanned version of this Certificate may be available and have the status "for information only". The sealed and bound version of the Certificate is the only valid version.

KEMA Nederland B.V.

P.G.A. Bus
KEMA T&D Testing Services
Managing Director

Arnhem, 17 April 2007

KEMA certificate



REPORT OF PERFORMANCE

589-06

APPARATUS Current limiting fuses

Designation	Rated voltage kV	Rated breaking capacity kA	Rated current A	Minimum breaking current A	Rated frequency Hz
12TDLEJ63	12 (1)	63 (1)	63	235	50
12THLEJ100	12 (1)	63 (1)	100	388	50
12TKLEJ125	12 (1)	63 (1)	125	687	50

(1) See note (1) on page 4.

CLIENT

Cooper Bussmann (UK) Limited,
Burton-on-the-Wolds, United Kingdom

MANUFACTURER

Cooper Bussmann India Private Limited,
Sedarapet, Pondicherry, India

TESTED BY

KEMA HIGH-POWER LABORATORY
Utrechtseweg 310 - 6812 AR Arnhem - The Netherlands

DATE(S) OF TESTS

19 October 2006

TEST SPECIFICATION

The tests have been carried out in accordance with the client's instructions.


This report consists of 33 sheets in total.

This report falls under the scope of the accreditation certificate L 020 of the Dutch Council for Accreditation.

Information sheet (1)

© Copyright: Only integral reproduction of this report, or reproductions of this page accompanied by any page(s) on which are stated the endorsed ratings of the apparatus tested, are permitted without written permission from KEMA. Electronic copies in e.g. PDF-format or scanned version of this report may be available and have the status "for information only". The sealed and bound version of the report is the only valid version.

KEMA Nederland B.V.



P.G.A. Bus
KEMA T&D Testing Services
Managing Director

Arnhem, 17 April 2007

KEMA certificate



REPORT OF PERFORMANCE

239-07

APPARATUS

Current limiting fuses

Designation	Rated voltage	Rated breaking capacity	Rated current	Minimum breaking current	Rated frequency
	kV	kA	A	A	Hz
12TDLEJ63	12	50	63	235	50
12THLEJ100	12	50	100	385	50

CLIENT

Cooper Bussmann (UK) Limited,
Burton-on-the-Wolds, United Kingdom

MANUFACTURER

Cooper Bussmann India Private Limited,
Sedarapet, Pondicherry, India

TESTED BY

KEMA HIGH-POWER LABORATORY
Utrechtseweg 310 - 6812 AR Arnhem - The Netherlands

DATE(S) OF TESTS

16 January 2007

TEST SPECIFICATION

The tests have been carried out in accordance with the client's instructions.

This report consists of 21 sheets in total.

This report falls under the scope of the accreditation certificate L 020 of the Dutch Council for Accreditation.
Information sheet (page 2)

© Copyright: Only integral reproduction of this report, or reproductions of this page accompanied by any page(s) on which are stated the endorsed ratings of the apparatus tested, are permitted without written permission from KEMA. Electronic copies in e.g. PDF-format or scanned version of this report may be available and have the status "for information only". The sealed and bound version of the report is the only valid version.

KEMA Nederland B.V.



P.G.A. Bos
KEMA T&D Testing Services
Managing Director

Arnhem, 17 April 2007

Changes to the products, to the information contained in this document, and to prices are reserved; so are errors and omissions. Only order confirmations and technical documentation by Eaton is binding. Photos and pictures also do not warrant a specific layout or functionality. Their use in whatever form is subject to prior approval by Eaton. The same applies to Trademarks (especially Eaton, Moeller, and Cutler-Hammer). The Terms and Conditions of Eaton apply, as referenced on Eaton Internet pages and Eaton order confirmations.



Powering Business Worldwide

Eaton Industries Manufacturing GmbH
Electrical Sector EMEA
Route de la Longeraie
71110 Morges, Switzerland
Eaton.eu

© 2017 Eaton
All Rights Reserved
Publication No. 720104
September 2017

Eaton is a registered trademark.
All other trademarks are property of their respective owners.