



PHOTOMETRIC LIGHT REPORT

# Downlight 3-CCT | cut out Ø135-145mm | 13/18W

Article number: 136-125



Go to the  
webshop  
of Tronix  
Lighting



**TRONIX**



## 136-125 Downlight 3-CCT | cut out Ø135-145mm | 13/18W

### Introduction

#### Purpose of this Document

This document provides accurate and objective photometric data for Tronix Lighting item 136-125. All information is based on actual measurements taken from standard production units. No modifications were made to enhance performance results. In some cases, minor adjustments—such as temporary removal of covers, cables, or mounting features—were necessary for testing purposes. These did not influence product performance.

#### Test Methodology

Testing was conducted using randomly selected, unopened samples from regular inventory. All tests comply with the LM-79-19 standard, the recognized method for photometric and electrical measurements of LED and OLED luminaires. This standard, an update of IES LM-79-2008, outlines environmental test conditions, stabilization procedures, measurement methods, and approved instruments. It uses absolute photometry, meaning results directly reflect the performance of the tested product, without comparison to rated lamp standards.

#### Product 136-125 was tested using:

- A photogoniometer to measure luminous intensity distribution at various angles
- An integrating sphere to determine total luminous flux and colour characteristics

#### Compliance & Certification

Item 136-125 meets the requirements of the following EU directives. Tronix Lighting certifies that all relevant tests were executed in accordance with the applicable standards, and the CE mark is applied accordingly:

- General Product Safety – Directive 2023/988/EC
- Low Voltage Directive (LVD) – Directive 2014/35/EU
- Electromagnetic Compatibility (EMC) – Directive 2004/108/EC
- Ecodesign – Directive 2009/125/EC
- RoHS 3 – Directive 2011/65/EU + Amendment 2015/863/EU

#### Recycling & Sustainability

Tronix Lighting is affiliated with national recycling systems for electrical and electronic waste. The luminaire is over 90% recyclable when disposed of as electronic waste at end of life. In addition, Tronix Lighting participates in national packaging recycling schemes, ensuring full compliance with both the WEEE and packaging directives.



136-125 Downlight 3-CCT | cut out Ø135-145mm | 13/18W

Laboratory and equipment

Laboratory owner and location	Tronix Lighting BV. Uden. The Netherlands
Gonio spectrometer system and type	Viso Systems Type C. horizontal
Spectrometer manufacturer and model	(Gonio) Ocean Optics STS VIS (Sphere) Admesy HERA VIS 380–780nm
Flicker meter manufacturer and model	Viso Systems LabFlicker
Oscilloscope manufacturer and model	Tektronix MDO3024 oscilloscope (4 Channels. 200 MHz)
Power meter manufacturer and model	Vitretek PA900 Precision Multi-Channel Harmonic Power Analyzer
Power source manufacturer and model	(DC) Keithley Source Measure Unit SMU-2420 3A DC Source Meter (AC) Chroma 61601 AC Source
Datalogger Manufacturer and Model	Omega 8-Channel Thermocouple Thermometer/Data Logger

Measurement conditions gonio spectrometer

Number of C-planes and Resolution	2 planes – 180°
γ (gamma)-Resolution	1°
Test Distance	1.81 m
Room Temperature and Humidity	22°C +/- 10% – RH 50% +/- 20%
Input Power. Power and Displacement Factors	16.4 W – PF 0.94 – DPF 0.95
Frequency of Input Power	50 Hz
Warm-up Time and Variation	Lamp stabilized in 17 min 20 sec --3.5%

Tested light source

Manufacturer and Order Code	Tronix Lighting – 136-125
Product Description	Downlight 3-CCT   cut out Ø135-145mm   13/18W

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)	1847 lm – 0% / 100%
Efficiency	113 lm/W
Energy efficiency class	E
Peak Intensity and Beam Angle	815 cd – 95.3°
Correlated Colour Temperature	CCT = 4396 K
Colour Shift. CIE duv	Duv -0.0090
Colour Rendering Index	CRI 86.3
Colour Rendering TM30-18	R <sub>f</sub> 82.9 – R <sub>g</sub> 100.2
Television Lighting Consistency Index	TLCI = 71
Flicker	SVM 0.04 – PstLM 0.18



136-125 Downlight 3-CCT | cut out Ø135-145mm | 13/18W


Electrical measurement details

**Input Power**

RMS Input voltage feed. $V_{RMS}$	231 V
RMS Input current feed. $I_{RMS}$	0.075 A
Total input power	16.4 W
Frequency of input power	50 Hz
Power factor	0.94
Displacement power factor	0.95
Total harmonic distortion of the current	13.26%
Total harmonic distortion of the voltage	2.76%

**Input Power Curve**

Voltage - Current

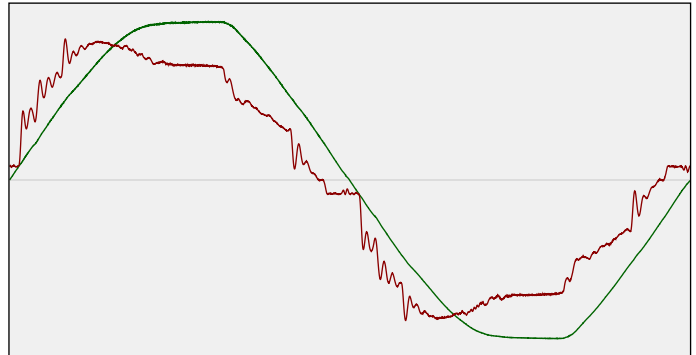

**Efficiency**

Radiated power efficiency: 36.3%




Lumen efficiency: 113 lm/W



**Harmonics**

3rd Harmonic	9.17%
5th Harmonic	6.99%
7th Harmonic	1.68%
9th Harmonic	4%
11th Harmonic	2.42%

**Current Harmonics %**

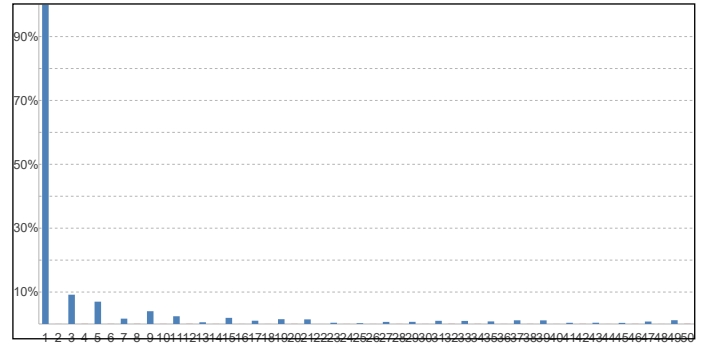

Stabilization Details

**Warm-up Conditions**

Stable period	15 min
Stable change max	2.0%
Minimum warm-up time	15 min

**Colour temperature change during warm-up**

CCT start	4362 K
CCT shift	+34 K
CCT end	4396 K

**Warm-up Results**

Total warmup time	Lamp stabilized in 17 min 20 sec
Warmup variation	-3.5%

**Output intensity change during warm-up**

Output start	1910 lm
Output change	-63 lm
Output end	1847 lm




136-125 Downlight 3-CCT | cut out Ø135-145mm | 13/18W

## Colour measurement details


Total lumen output 1847 lm  
 Correlated Colour Temperature 4396 K  
 Colour coordinates CIE 1931 (x;y) = (0.361;0.346)  
 Colour deviation from BBL Duv = -0.0090

TM30-18 Colour Fidelity Index  $R_f$  82.9  
 TM30-18 Colour Gamut Index  $R_g$  100.2  
 Colour Rendering Index (Ra) CRI 86.3  
 Colour Rendering Index. (red component)  $R_9 = 31.0$


Colour Quality Scale CQS = 81.4  
 Television Lighting Consistency Index TLCI = 71

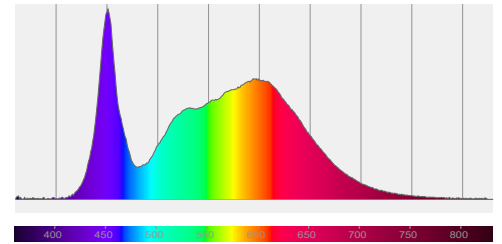

Relative spectral power distribution

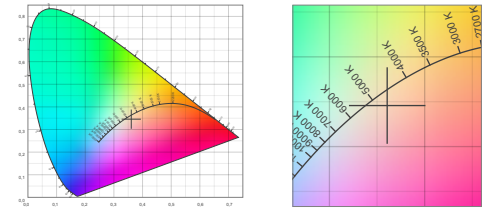

## TM30 details

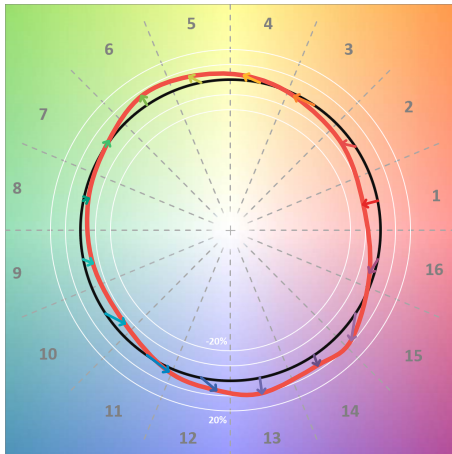


TM30 Colour vectors per hue bin




TM30 Colour distortion


Hue Bin	$R_f$	Shifts (%)	
		Chroma	Hue
C1	82	-10%	-1%
C2	85	-7%	7%
C3	74	-2%	14%
C4	82	3%	11%
C5	86	5%	7%
C6	89	7%	0%
C7	93	0%	-4%
C8	92	-3%	-2%
C9	89	-6%	4%
C10	77	-7%	13%
C11	72	1%	18%
C12	78	6%	11%
C13	87	10%	-1%
C14	88	7%	-2%
C15	80	7%	-16%
C16	83	-4%	-10%

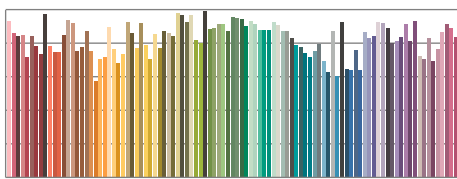

TM30-18  $R_f$ -values per reference colour

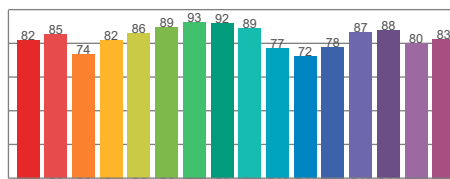


TM30-18  $R_f$ -values per hue bin

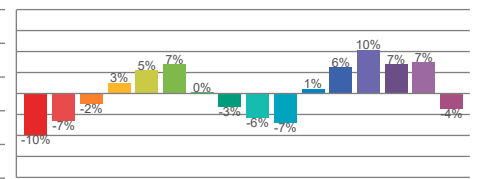


TM30 Chroma shift

## Colour Quality details

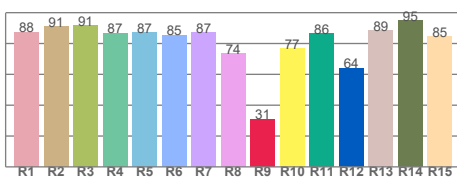

Colour Rendering Index

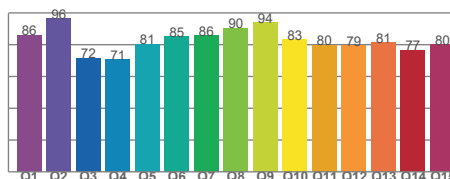

Colour Quality Scale

Document revision date: 1-7-2025 Measurement serial: VFR-250127-1479-MS



136-125 Downlight 3-CCT | cut out Ø135-145mm | 13/18W

Flicker / temporal light artefacts details

**Measurement conditions**

Flicker meter type	Viso Systems LabFlicker
Flicker/TLA sample rate	20000 samples/s
Measurement time	5x 180 seconds (15 minutes) for PstLM. 1.2 sec for all other indices

**Flicker indices according to Illuminating Engineering Society (IES)**


Flicker frequency	98.52 Hz
Percent flicker	1.38 %
Flicker index	0

**TLA indices (according IEC TR 61547-1. EN 61000-3-3 and EN 61000-4-15)**

An LED luminaire is considered flicker-free if the SVM value is  $\leq 0.4$  and if the PstLM value is  $\leq 1.0$

PstLM value (F < 80 Hz)	0.18
SVM value (80 < F < 2000 Hz)	0.04


**Flicker frame (one flicker period in time domain)**

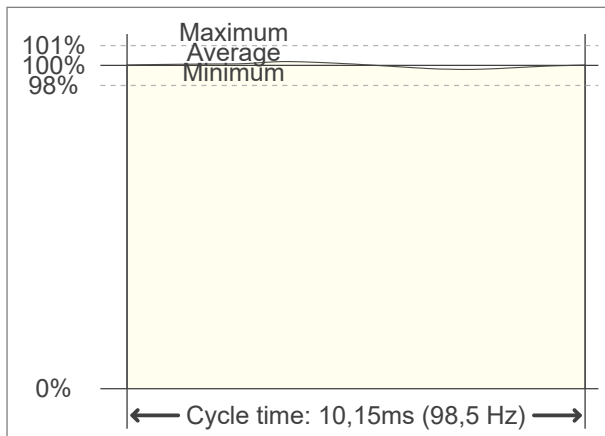

**Flicker FFT (flicker curve in frequency domain)**



**IEEE 1789-2015 Lighting Flicker Risk Zones**

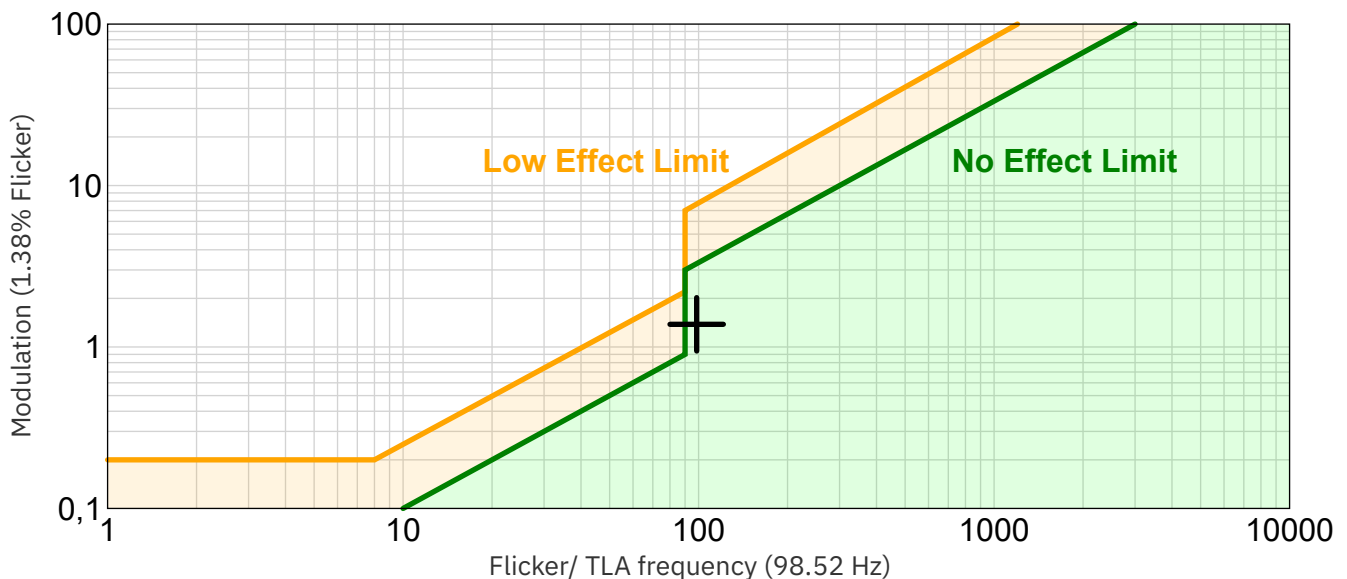

Document revision date: 1-7-2025 Measurement serial: VFR-250127-1479-MS




136-125 Downlight 3-CCT | cut out Ø135-145mm | 13/18W

Beam angle

**Luminous Intensity diagram**

Unit: 0-100% of peak intensity

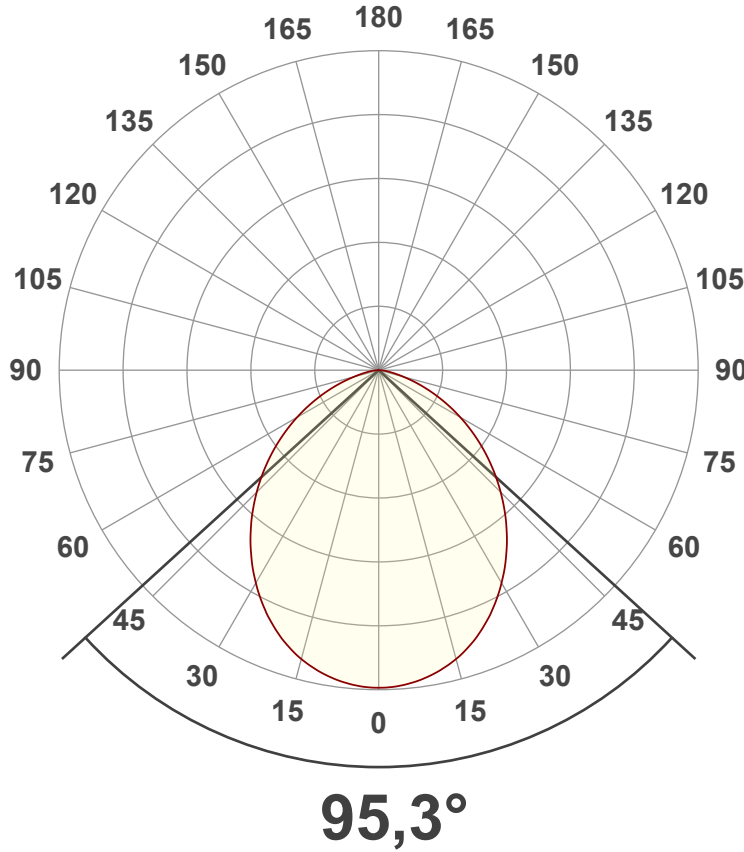

**Main Values**

Output (total Lumen)	1847 lm
Lumen Up/Down	0% / 100%
Peak Intensity	815 cd
Beam Angle (50%)	95.3°
Beam Angle (90%)	95.3°
Beam Angle (10%)	95.3°

**Cut-off Angle**

Average 2.5%	166°
--------------	------

**Field Angle**

Average 10%	146.8°
-------------	--------


**Intensity Ratio**

In 120° cone	85.6%
In 90° cone	61.8%

**C planes**

- C000-C180
- C090-C270

**Linear distribution diagram - Intensity (candela) vs  $\gamma$ -angle**

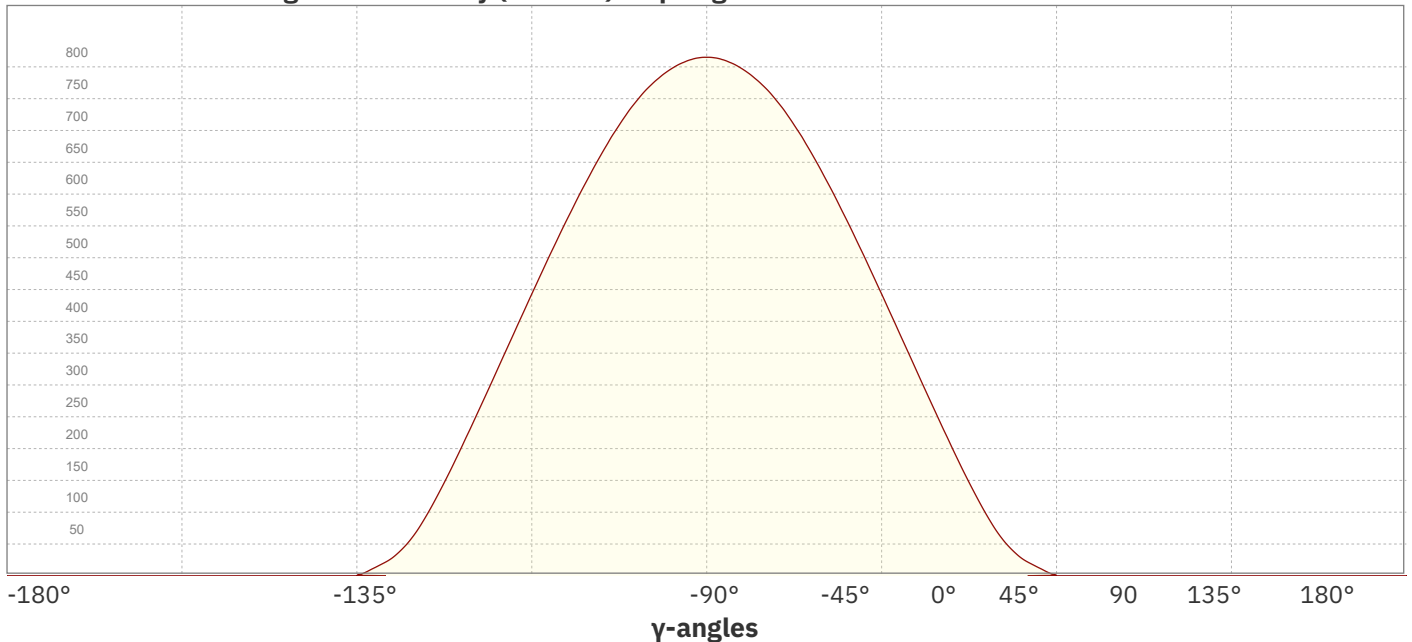


Document revision date: 1-7-2025 Measurement serial: VFR-250127-1479-MS



136-125 Downlight 3-CCT | cut out Ø135-145mm | 13/18W

Beam Details

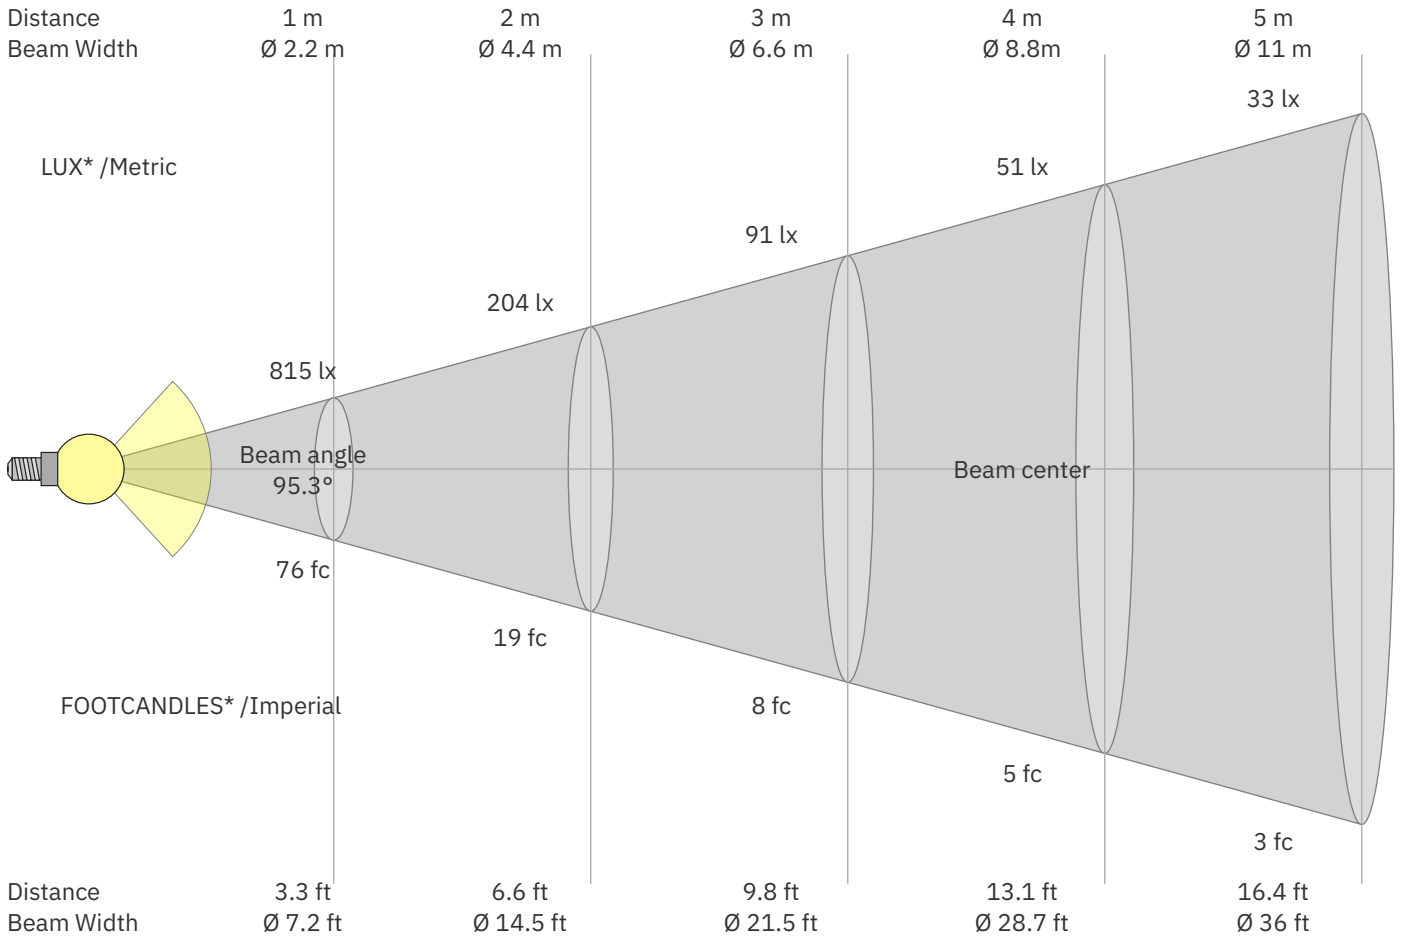

\*Measured at center of beam

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3.3	6.6	9.8	13.1	16.4	19.7	23	26.2	29.5	32.8	36.1	39.4	42.7	45.9	49.2	52.5	55.8	59.1	62.3	65.6	ft
815	204	91	51	33	23	17	13	10	8	7	6	5	4	4	3	3	3	2	2	lux
75.7	18.9	8.4	4.7	3	2.1	1.5	1.2	0.9	0.8	0.6	0.5	0.4	0.4	0.3	0.3	0.3	0.2	0.2	0.2	fc

Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
815	809	793	767	731	685	631	571	509	443	376	308	242	177	118	67	33	14	1	0	cd
100%	99%	97%	94%	90%	84%	77%	70%	62%	54%	46%	38%	30%	22%	14%	8%	4%	2%	0%	0%	of 0°val

Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
815	809	793	767	731	685	631	571	509	443	376	308	242	177	118	67	33	14	1	0	cd
100%	99%	97%	94%	90%	84%	77%	70%	62%	54%	46%	38%	30%	22%	14%	8%	4%	2%	0%	0%	of 0°val

Intensities in 180° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
815	809	793	767	731	685	631	571	509	443	376	308	242	177	118	67	33	14	1	0	cd
100%	99%	97%	94%	90%	84%	77%	70%	62%	54%	46%	38%	30%	22%	14%	8%	4%	2%	0%	0%	of 0°val

Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
815	809	793	767	731	685	631	571	509	443	376	308	242	177	118	67	33	14	1	0	cd
100%	99%	97%	94%	90%	84%	77%	70%	62%	54%	46%	38%	30%	22%	14%	8%	4%	2%	0%	0%	of 0°val

Document revision date: 1-7-2025 Measurement serial: VFR-250127-1479-MS



136-125 Downlight 3-CCT | cut out Ø135-145mm | 13/18W

Light Planning – UGR table

Uncorrected, comprehensive UGR table according to CIE 117-1995

Reflectances		70	70	50	50	30	70	70	50	50	30
ρ Ceiling		70	70	50	50	30	70	70	50	50	30
ρ Walls		50	30	50	30	30	50	30	50	30	30
ρ Floor		20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	25.8	26.9	26.0	27.2	27.4	25.8	26.9	26.0	27.2	27.4
	3H	26.6	27.8	27.1	28.1	28.3	26.6	27.8	27.1	28.1	28.3
	4H	26.9	28.0	27.3	28.3	28.5	26.9	28.0	27.3	28.3	28.5
	6H	27.1	28.1	27.4	28.3	28.7	27.1	28.1	27.4	28.3	28.7
	8H	27.1	28.0	27.5	28.4	28.8	27.1	28.0	27.5	28.4	28.8
	12H	27.1	28.0	27.5	28.3	28.8	27.1	28.0	27.5	28.3	28.8
4H	2H	26.2	27.3	26.6	27.6	27.8	26.2	27.3	26.6	27.6	27.8
	3H	27.3	28.2	27.7	28.6	29.0	27.3	28.2	27.7	28.6	29.0
	4H	27.6	28.4	28.0	28.9	29.4	27.6	28.4	28.0	28.9	29.4
	6H	27.8	28.6	28.3	28.9	29.3	27.8	28.6	28.3	28.9	29.3
	8H	27.8	28.6	28.3	28.9	29.3	27.8	28.6	28.3	28.9	29.3
	12H	27.8	28.4	28.3	28.9	29.3	27.8	28.4	28.3	28.9	29.3
8H	4H	27.7	28.4	28.2	28.8	29.2	27.7	28.4	28.2	28.8	29.2
	6H	28.0	28.5	28.5	29.0	29.5	28.0	28.5	28.5	29.0	29.5
	8H	28.1	28.5	28.6	29.1	29.7	28.1	28.5	28.6	29.1	29.7
	12H	28.1	28.5	28.7	29.0	29.6	28.1	28.5	28.7	29.0	29.6
12H	4H	27.7	28.3	28.2	28.7	29.2	27.7	28.3	28.2	28.7	29.2
	6H	28.0	28.5	28.5	29.0	29.6	28.0	28.5	28.5	29.0	29.6
	8H	28.1	28.5	28.7	29.0	29.6	28.1	28.5	28.7	29.0	29.6

Variations with the observer position for the luminaire spacings. S:

S = 1.0H	0.2 / -0.2	0.2 / -0.2
S = 1.5H	0.4 / -0.6	0.4 / -0.6
S = 2.0H	0.9 / -1.3	0.9 / -1.3

Coefficients of Utilization

Ceiling reflectance	80	70			50			30			10			0		
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	0	
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0	
RCR	(RCR: Room Cavity Ratio)															
Room Values are expressed as percentage of Lumen delivered to the task surface																
0	119	119	119	119	116	116	116	116	111	111	106	106	106	102	102	100
1	110	106	102	99	107	104	100	97	99	97	94	96	93	91	92	90
2	101	94	87	82	98	92	86	81	88	83	79	85	81	78	82	79
3	93	83	76	70	90	81	75	69	79	73	68	76	71	67	73	69
4	85	74	66	60	83	73	65	59	70	64	59	68	62	58	66	61
5	79	67	58	52	77	66	58	52	64	57	51	62	56	51	60	54
6	73	60	52	46	71	60	52	46	58	51	45	56	50	45	55	49
7	68	55	47	41	66	54	46	41	53	46	40	51	45	40	50	44
8	63	50	42	37	62	50	42	37	48	41	36	47	41	36	46	40
9	59	46	39	33	58	46	38	33	45	38	33	44	37	33	43	37
10	56	43	35	30	54	42	35	30	41	35	30	41	34	30	40	34