

Contact sensor Humidity / Temperature

Active contact sensor (0...10 V) for measuring the relative or absolute humidity and temperature on pipe surfaces. Instead of the humidity signal, the enthalpy or the dew point can be selected as an output signal. IP65 / NEMA 4X rated enclosure.


Type Overview

Type	Output signal active humidity	Output signal active temperature	Cable length
22HTH-110X	0...5 V, 0...10 V	0...5 V, 0...10 V	2 m

Technical data

Electrical data	Nominal voltage	AC/DC 24 V																			
	Nominal voltage range	AC 21.6...26.4 V / DC 13.5...26.4 V																			
	Power consumption AC	0.8 VA																			
	Power consumption DC	0.4 W																			
	Electrical connection	Pluggable spring loaded terminal block max. 2.5 mm ²																			
	Cable entry	Cable gland with strain relief ø6...8 mm																			
Functional data	Sensor technology	Polymer-based capacitive sensor with plastic cap and filter membrane																			
	Application	Air Water																			
Measuring data	Measured values	Relative humidity Absolute humidity Dew point Enthalpies Temperature																			
	Specification Temperature active	Measuring range temperature settings Active sensor: range selectable Attention: max. measuring temperature is restricted by max. fluid temperature (see Safety data) <table border="1"> <thead> <tr> <th>Setting</th> <th>Range [°C]</th> <th>Range [°F]</th> <th>Factory setting</th> </tr> </thead> <tbody> <tr> <td>S0</td> <td>-40...60</td> <td>-40...160</td> <td></td> </tr> <tr> <td>S1</td> <td>0...50</td> <td>40...140</td> <td></td> </tr> <tr> <td>S2</td> <td>-15...35</td> <td>0...100</td> <td></td> </tr> <tr> <td>S3</td> <td>-20...80</td> <td>0...200</td> <td style="text-align: right;">✓</td> </tr> </tbody> </table>	Setting	Range [°C]	Range [°F]	Factory setting	S0	-40...60	-40...160		S1	0...50	40...140		S2	-15...35	0...100		S3	-20...80	0...200
Setting	Range [°C]	Range [°F]	Factory setting																		
S0	-40...60	-40...160																			
S1	0...50	40...140																			
S2	-15...35	0...100																			
S3	-20...80	0...200	✓																		
	Accuracy temperature	±0.3°C @ 25°C [±0.5°F @ 77°F]																			
	Long term stability	±0.05°C p.a. @ 21°C [±0.09°F p.a. @ 70°F]																			
	Time constant τ (63%) in the room	Typical 143 s																			
Specification Humidity	Measuring range	0...100% RH																			
	Measuring range absolute humidity	adjustable at the transducer: 0...50 g/m ³ (default setting) 0...80 g/m ³																			
	Measuring range enthalpy	0...85 kJ/kg																			

Technical data

Specification Humidity	Measuring range dew point	adjustable at the transducer: 0...50°C (default setting) -20...80°C
	Accuracy	±2% between 20...80% RH @ 25°C
	Long term stability	±0.3% RH p.a. @ 21°C @ 50% RH
	Time constant τ (63%) in the room	Typical 10 s
Safety data	Protection class IEC/EN	III, Protective Extra-Low Voltage (PELV)
	Degree of protection IEC/EN	IP65
	Degree of protection NEMA/UL	NEMA 4X
	EU Conformity	CE Marking
	Certification IEC/EN	IEC/EN 60730-1
	Quality Standard	ISO 9001
	Type of action	Type 1
	Rated impulse voltage supply	0.8 kV
	Pollution degree	3
	Ambient humidity	Max. 95% RH, non-condensing
Materials	Cable gland	PA6, black
	Housing	Cover: PC, orange
		Bottom: PC, orange Seal: NBR70, black UV resistant

Safety notes


This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application. Unauthorised modifications are prohibited. The product must not be used in relation with any equipment that in case of a failure may threaten humans, animals or assets.

Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied with during installation.

The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

Remarks

General remarks concerning sensors Sensing devices with a transducer should always be operated in the middle of the measuring range to avoid deviations at the measuring end points. The ambient temperature of transducer electronics should be kept constant. The transducers must be operated at a constant supply voltage (± 0.2 V). When switching the supply voltage on/off, onsite power surges must be avoided.

Remark: Occurring draft leads to a better carrying-off of dissipative power at the sensor. Thus temporally limited fluctuations might occur upon temperature measurement.

Remark surface measurements When measuring temperature, humidity or condensation on a surface, both the temperature of the surface and that of the ambient air influence the measurement result. When measuring on a pipe surface, the influence of the ambient air can be minimised by using thermal contact fluid.

Remarks

Application notice for humidity sensors


The humidity sensor is extremely sensitive. Touching the sensor element or exposing it to aggressive substances like chlorine, ozone, ammonia, hydrogen peroxide or ethanol (i.e. as a cleaning agent) may affect the measurement accuracy.

Long term operation outside the recommended conditions (5...60°C and 20...80% RH) can result in a temporary offset. After returning into the recommended range, this effect disappears.


Accessories

Optional accessories	Description	Type
	Connection adapter flex conduit, M20x1.5, for cable gland 1x 6 mm, Multipack 10 pcs.	A-22G-A01.1

Wiring diagram

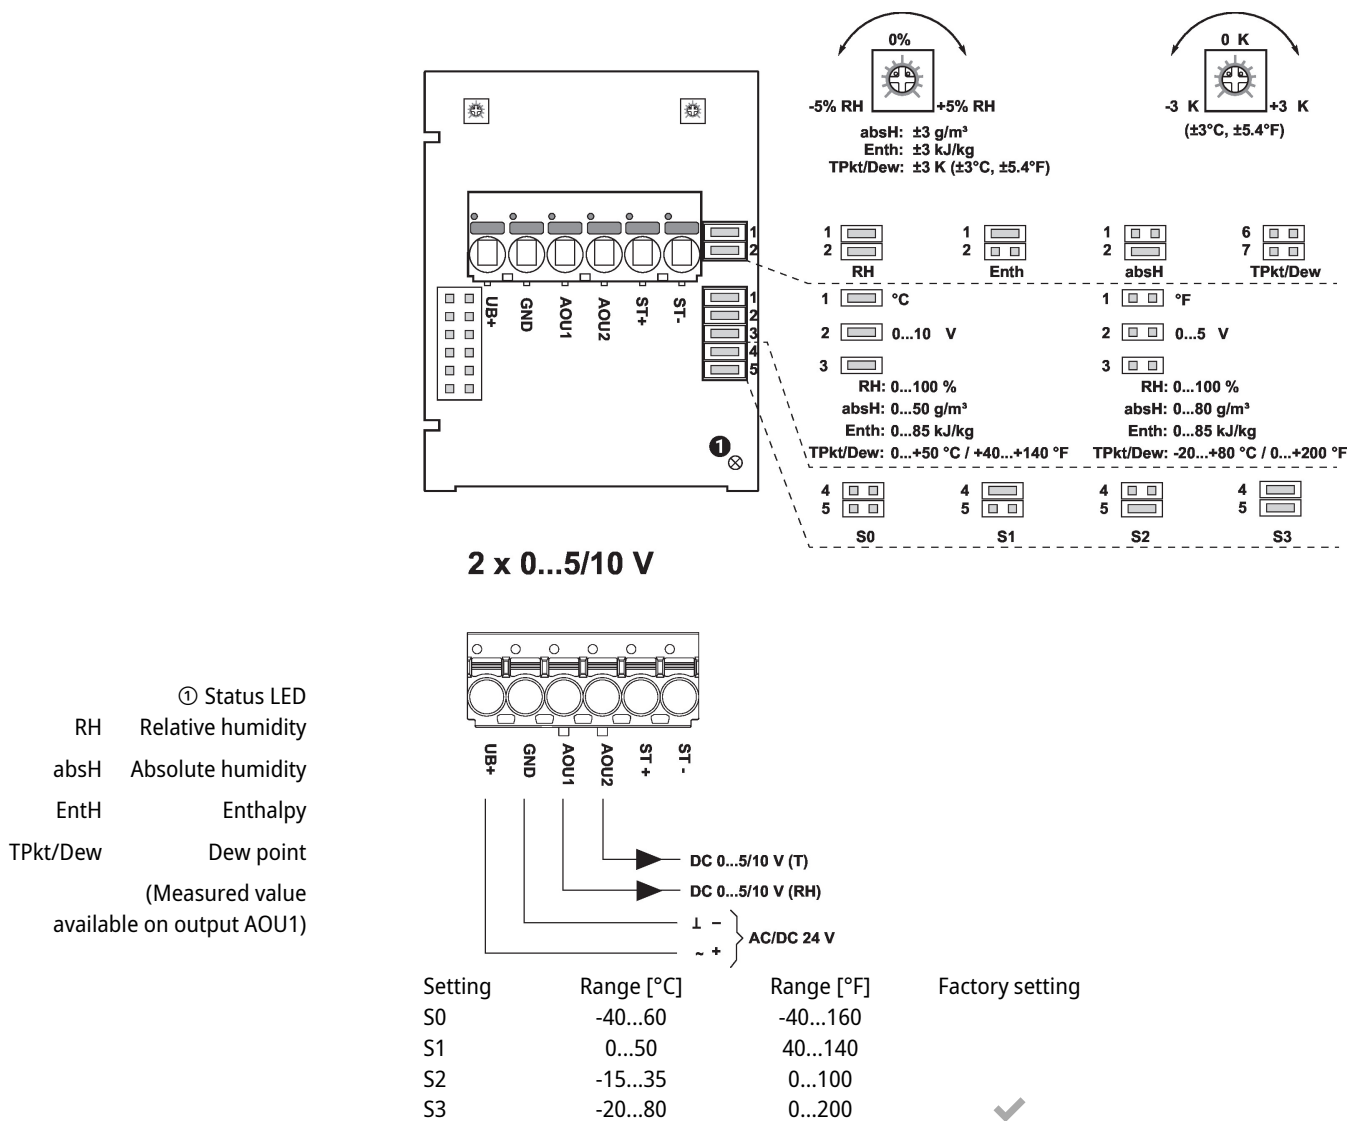

Dimensions

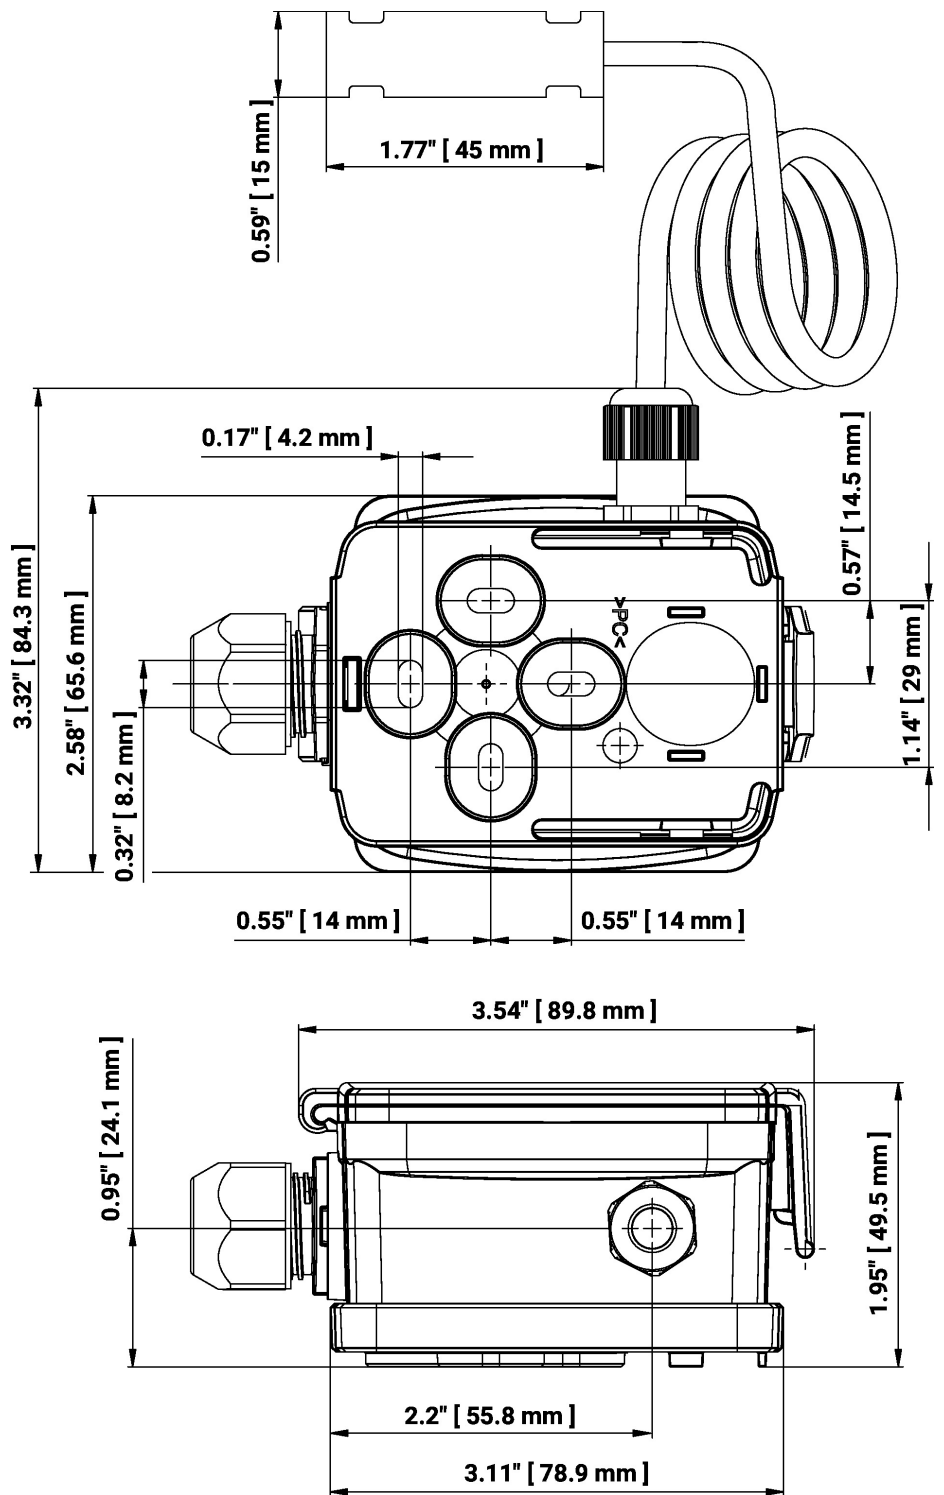

Type	Cable length	Weight
22HTH-110X	2 m	0.14 kg

Further documentation

- Installation instructions