



PHOTOMETRIC LIGHT REPORT

Floodlight pro | 100W | 120° | extra warm white 2000K

Article number: 146-334



Go to the
webshop
of Tronix
Lighting



TRONIX



146-334 Floodlight pro | 100W | 120° | extra warm white 2000K

Introduction

Purpose of this Document

This document provides accurate and objective photometric data for Tronix Lighting item 146-334. All information is based on actual measurements taken from standard production units. No modifications were made to enhance performance results. In some cases, minor adjustments—such as temporary removal of covers, cables, or mounting features—were necessary for testing purposes. These did not influence product performance.

Test Methodology

Testing was conducted using randomly selected, unopened samples from regular inventory. All tests comply with the LM-79-19 standard, the recognized method for photometric and electrical measurements of LED and OLED luminaires. This standard, an update of IES LM-79-2008, outlines environmental test conditions, stabilization procedures, measurement methods, and approved instruments. It uses absolute photometry, meaning results directly reflect the performance of the tested product, without comparison to rated lamp standards.

Product 146-334 was tested using:

- A photogoniometer to measure luminous intensity distribution at various angles
- An integrating sphere to determine total luminous flux and colour characteristics

Compliance & Certification

Item 146-334 meets the requirements of the following EU directives. Tronix Lighting certifies that all relevant tests were executed in accordance with the applicable standards, and the CE mark is applied accordingly:

- General Product Safety – Directive 2023/988/EC
- Low Voltage Directive (LVD) – Directive 2014/35/EU
- Electromagnetic Compatibility (EMC) – Directive 2004/108/EC
- Ecodesign – Directive 2009/125/EC
- RoHS 3 – Directive 2011/65/EU + Amendment 2015/863/EU

Recycling & Sustainability

Tronix Lighting is affiliated with national recycling systems for electrical and electronic waste. The luminaire is over 90% recyclable when disposed of as electronic waste at end of life. In addition, Tronix Lighting participates in national packaging recycling schemes, ensuring full compliance with both the WEEE and packaging directives.



146-334 Floodlight pro | 100W | 120° | extra warm white 2000K

Laboratory and equipment

Laboratory owner and location	Tronix Lighting BV. Uden. The Netherlands
Gonio spectrometer system and type	Viso Systems Type C. horizontal
Spectrometer manufacturer and model	(Gonio) Ocean Optics STS VIS (Sphere) Admesy HERA VIS 380–780nm
Flicker meter manufacturer and model	Viso Systems LabFlicker
Oscilloscope manufacturer and model	Tektronix MDO3024 oscilloscope (4 Channels. 200 MHz)
Power meter manufacturer and model	Vitretek PA900 Precision Multi-Channel Harmonic Power Analyzer
Power source manufacturer and model	(DC) Keithley Source Measure Unit SMU-2420 3A DC Source Meter (AC) Chroma 61601 AC Source
Datalogger Manufacturer and Model	Omega 8-Channel Thermocouple Thermometer/Data Logger

Measurement conditions gonio spectrometer

Number of C-planes and Resolution	8 planes – 45°
γ (gamma)-Resolution	2.5°
Test Distance	1.81 m
Room Temperature and Humidity	22°C +/- 10% – RH 50% +/- 20%
Input Power. Power and Displacement Factors	101.8 W – PF 0.98 – DPF 0.99
Frequency of Input Power	50 Hz
Warm-up Time and Variation	Lamp stabilized in 25 min 42 sec --6.7%

Tested light source

Manufacturer and Order Code	Tronix Lighting – 146-334
Product Description	Floodlight pro 100W 120° extra warm white 2000K

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)	8655 lm – 0% / 100%
Efficiency	85 lm/W
Energy efficiency class	G
Peak Intensity and Beam Angle	3148 cd – 114.8°
Correlated Colour Temperature	CCT = 1990 K
Colour Shift. CIE duv	Duv -0.0026
Colour Rendering Index	CRI 82.1
Colour Rendering TM30-18	R _f 83.6 – R _g 98.1
Television Lighting Consistency Index	TLCI = 69
Flicker	SVM 0 – PstLM 0.01



146-334 Floodlight pro | 100W | 120° | extra warm white 2000K

Electrical measurement details

Input Power

RMS Input voltage feed. V_{RMS}	226 V
RMS Input current feed. I_{RMS}	0.457 A
Total input power	101.8 W
Frequency of input power	50 Hz
Power factor	0.98
Displacement power factor	0.99
Total harmonic distortion of the current	6.12%
Total harmonic distortion of the voltage	2.25%

Input Power Curve

Voltage - Current



Efficiency

Radiated power efficiency: 31.8%




Lumen efficiency: 85 lm/W



Harmonics

3rd Harmonic	1.09%
5th Harmonic	4.43%
7th Harmonic	1.53%
9th Harmonic	2.72%
11th Harmonic	1.04%

Current Harmonics %

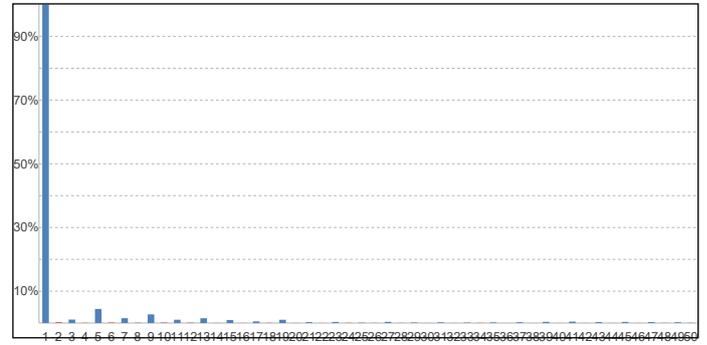

Stabilization Details

Warm-up Conditions

Stable period	15 min	Colour temperature change during warm-up	CCT start	1984 K
Stable change max	2.0%		CCT shift	+6 K
Minimum warm-up time	15 min		CCT end	1990 K

Warm-up Results

Total warmup time	Lamp stabilized in 25 min 42 sec	Output intensity change during warm-up	Output start	9259 lm
Warmup variation	-6.7%		Output change	-604 lm
			Output end	8655 lm




146-334 Floodlight pro | 100W | 120° | extra warm white 2000K

Colour measurement details


Total lumen output 8655 lm
 Correlated Colour Temperature 1990 K
 Colour coordinates CIE 1931 (x,y) = (0.522;0.405)
 Colour deviation from BBL Duv = -0.0026

TM30-18 Colour Fidelity Index R_f 83.6
 TM30-18 Colour Gamut Index R_g 98.1
 Colour Rendering Index (Ra) CRI 82.1
 Colour Rendering Index. (red component) R9 = 17.3


Colour Quality Scale CQS = 73.0
 Television Lighting Consistency Index TLCI = 69

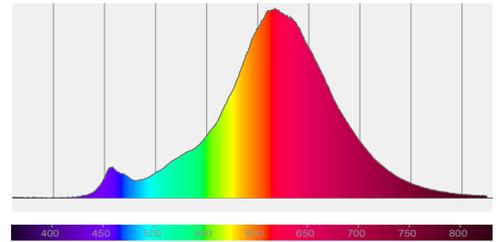


Relative spectral power distribution

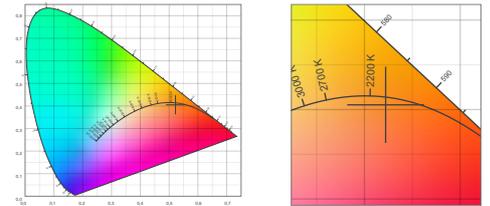

TM30 details

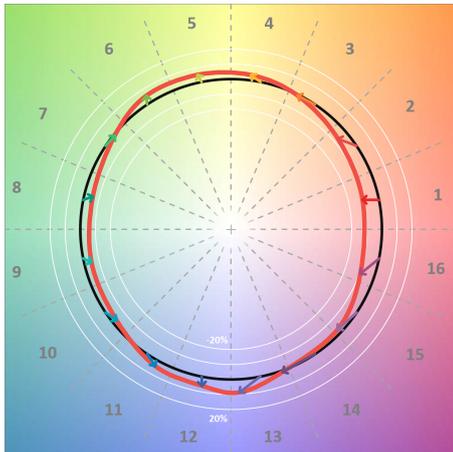


TM30 Colour vectors per hue bin

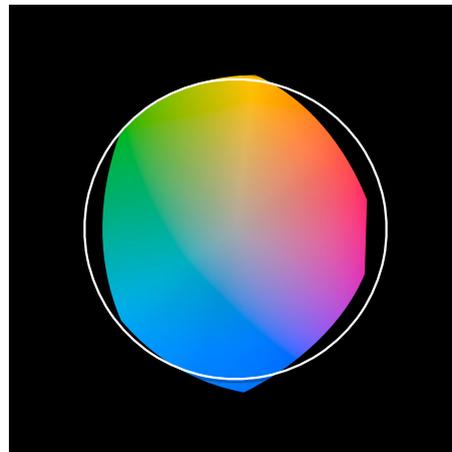


TM30 Colour distortion


Hue Bin	R _f	Shifts (%)	
		Chroma	Hue
C1	79	-11%	2%
C2	77	-8%	11%
C3	76	-1%	13%
C4	88	3%	7%
C5	94	5%	2%
C6	90	5%	-3%
C7	86	-1%	-9%
C8	90	-6%	-3%
C9	88	-5%	4%
C10	85	-3%	8%
C11	85	4%	9%
C12	87	6%	2%
C13	84	8%	-16%
C14	57	-2%	-25%
C15	77	-4%	-17%
C16	77	-10%	-13%

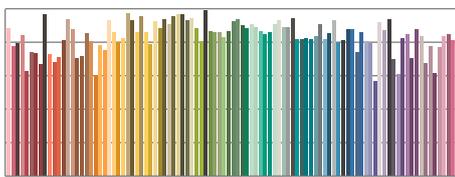

TM30-18 R_f-values per reference colour

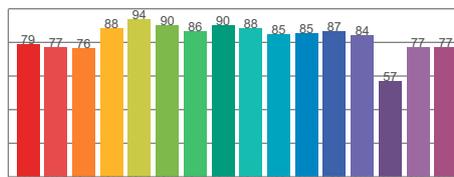


TM30-18 R_f-values per hue bin

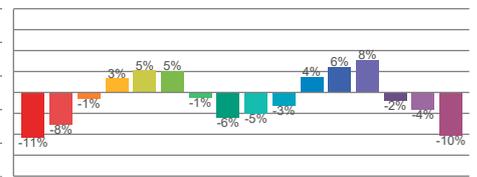


TM30 Chroma shift

Colour Quality details

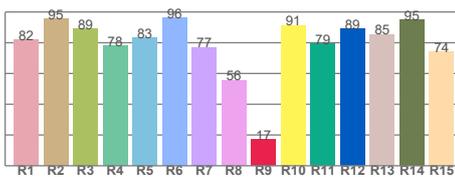

Colour Rendering Index

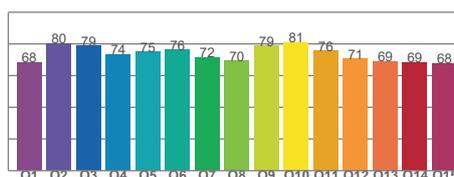

Colour Quality Scale



146-334 Floodlight pro | 100W | 120° | extra warm white 2000K

Flicker / temporal light artefacts details

Measurement conditions

Flicker meter type	Viso Systems LabFlicker
Flicker/TLA sample rate	20000 samples/s
Measurement time	5x 180 seconds (15 minutes) for PstLM. 1.2 sec for all other indices

Flicker indices according to Illuminating Engineering Society (IES)


Flicker frequency	100.5 Hz
Percent flicker	0.11 %
Flicker index	0

TLA indices (according IEC TR 61547-1, EN 61000-3-3 and EN 61000-4-15)


An LED luminaire is considered flicker-free if the SVM value is ≤ 0.4 and if the PstLM value is ≤ 1.0

PstLM value (F < 80 Hz)	0.01
SVM value (80 < F < 2000 Hz)	0


Flicker frame (one flicker period in time domain)

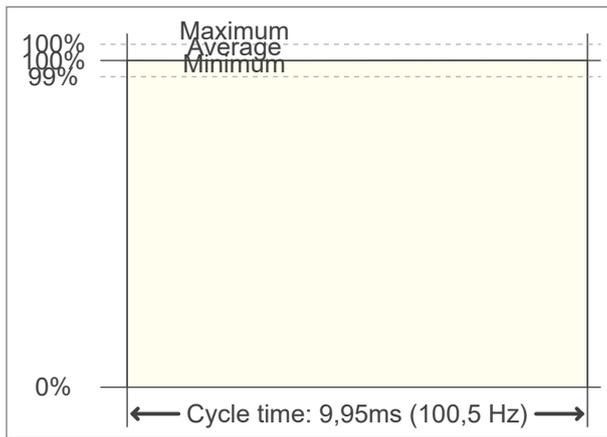

Flicker FFT (flicker curve in frequency domain)

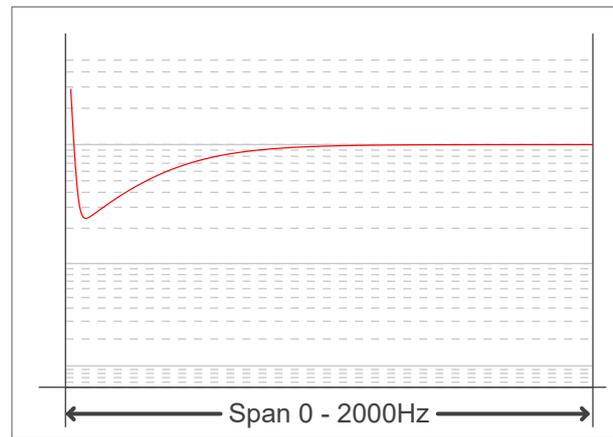

IEEE 1789-2015 Lighting Flicker Risk Zones

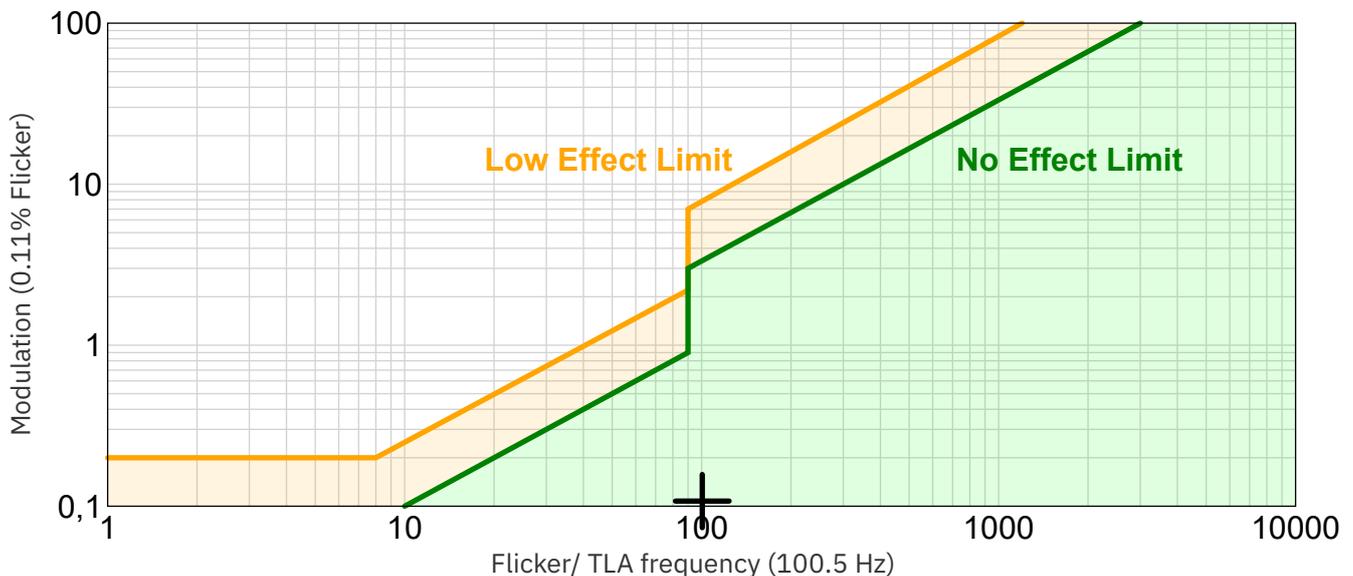

Document revision date: 1-7-2025 Measurement serial: VFR-250219-3146-MS




146-334 Floodlight pro | 100W | 120° | extra warm white 2000K

Beam angle

Luminous Intensity diagram

Unit: 0-100% of peak intensity

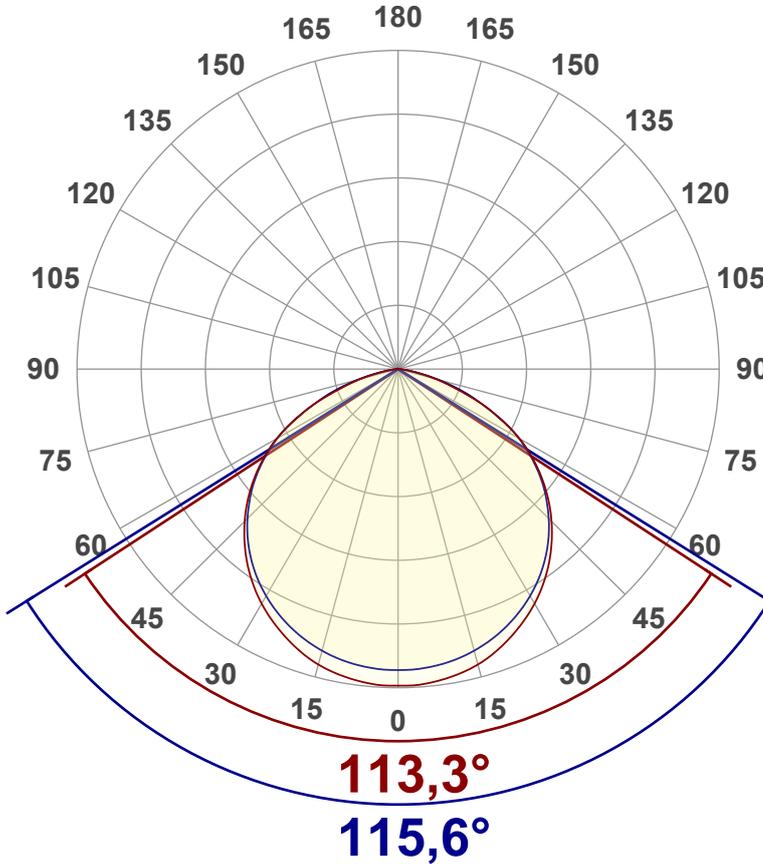

Main Values

Output (total Lumen)	8655 lm
Lumen Up/Down	0% / 100%
Peak Intensity	3148 cd
Beam Angle (50%)	114.8°
Beam Angle (90%)	115.6°
Beam Angle (10%)	113.3°

Cut-off Angle

Average 2.5%	165.3°
--------------	--------

Field Angle

Average 10%	153.5°
-------------	--------


Intensity Ratio

In 120° cone	82.1%
In 90° cone	55.6%

C planes

- C000-C180
- C090-C270

Linear distribution diagram - Intensity (candela) vs γ -angle

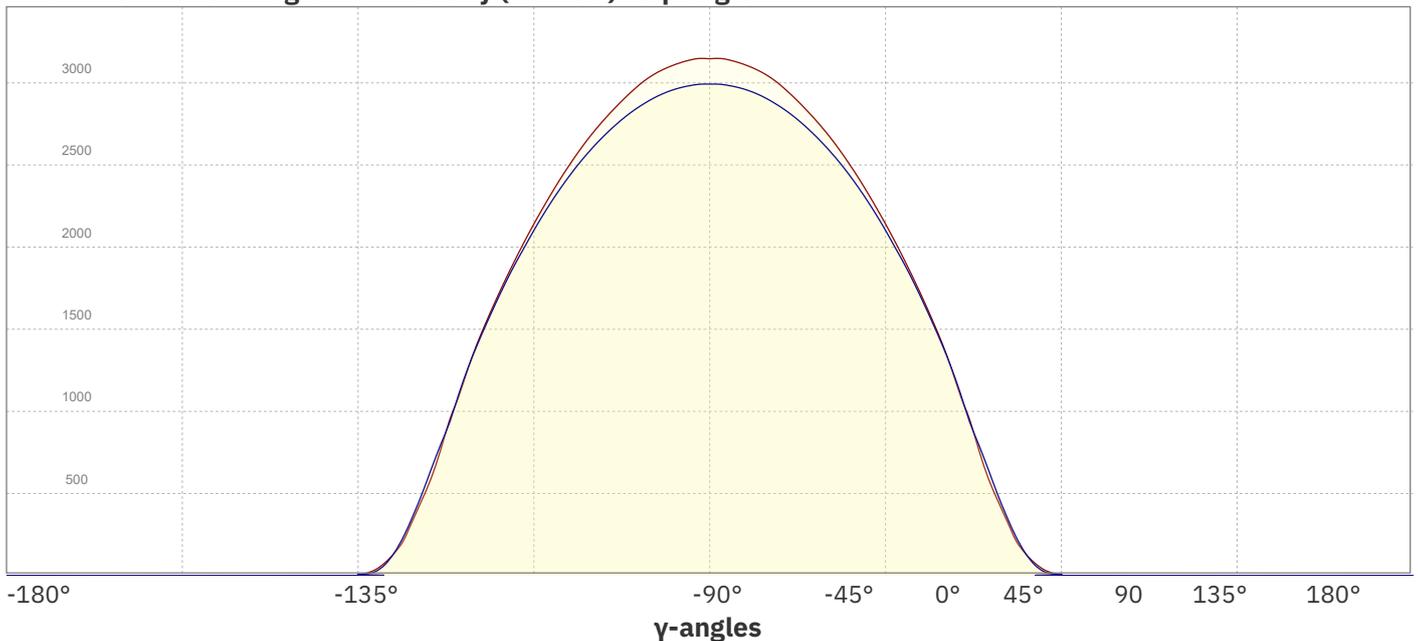


Document revision date: 1-7-2025 Measurement serial: VFR-250219-3146-MS



146-334 Floodlight pro | 100W | 120° | extra warm white 2000K

Beam Details

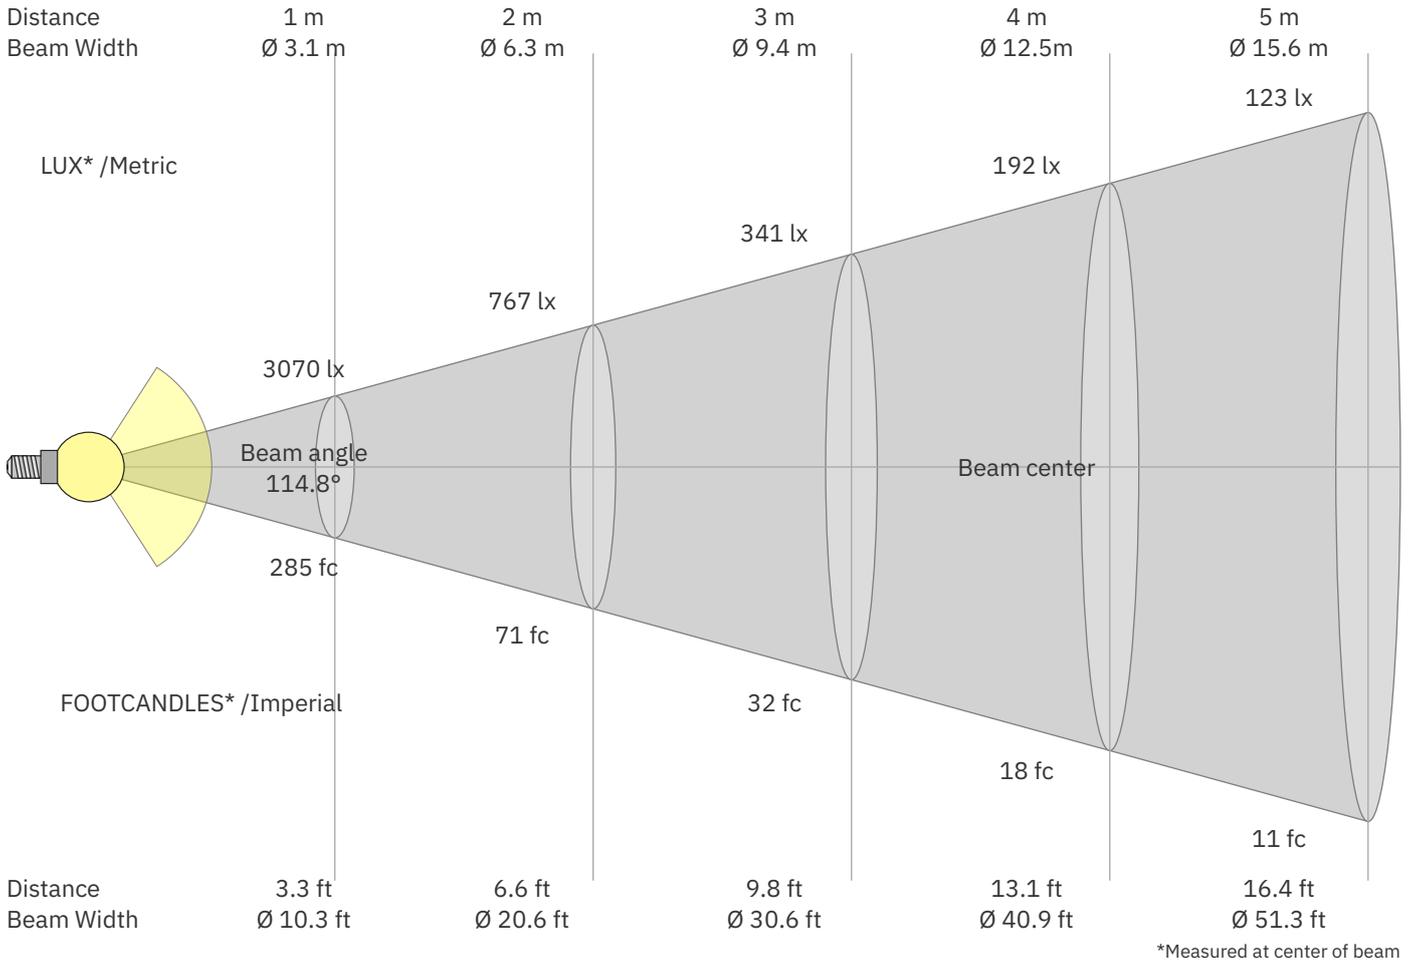

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3.3	6.6	9.8	13.1	16.4	19.7	23	26.2	29.5	32.8	36.1	39.4	42.7	45.9	49.2	52.5	55.8	59.1	62.3	65.6	ft
3070	767	341	192	123	85	63	48	38	31	25	21	18	16	14	12	11	9	9	8	lux
285.2	71.3	31.7	17.8	11.4	7.9	5.8	4.5	3.5	2.9	2.4	2	1.7	1.5	1.3	1.1	1	0.9	0.8	0.7	fc

Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
3070	3139	3101	3040	2946	2828	2692	2531	2346	2140	1913	1662	1382	1043	685	390	160	46	6	0	cd
100%	102%	101%	99%	96%	92%	88%	82%	76%	70%	62%	54%	45%	34%	22%	13%	5%	1%	0%	0%	of 0°val

Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
3070	2983	2952	2898	2822	2723	2604	2461	2294	2102	1888	1645	1375	1048	727	419	169	34	4	0	cd
100%	97%	96%	94%	92%	89%	85%	80%	75%	68%	62%	54%	45%	34%	24%	14%	6%	1%	0%	0%	of 0°val

Intensities in 180° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
3070	3139	3101	3040	2946	2828	2692	2531	2346	2140	1913	1662	1382	1043	685	390	160	46	6	0	cd
100%	102%	101%	99%	96%	92%	88%	82%	76%	70%	62%	54%	45%	34%	22%	13%	5%	1%	0%	0%	of 0°val

Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
3070	2983	2952	2898	2822	2723	2604	2461	2294	2102	1888	1645	1375	1048	727	419	169	34	4	0	cd
100%	97%	96%	94%	92%	89%	85%	80%	75%	68%	62%	54%	45%	34%	24%	14%	6%	1%	0%	0%	of 0°val

Document revision date: 1-7-2025 Measurement serial: VFR-250219-3146-MS



146-334 Floodlight pro | 100W | 120° | extra warm white 2000K

Light Planning – UGR table

Uncorrected, comprehensive UGR table according to CIE 117-1995

Reflectances		70	70	50	50	30	70	70	50	50	30
ρ Ceiling		70	70	50	50	30	70	70	50	50	30
ρ Walls		50	30	50	30	30	50	30	50	30	30
ρ Floor		20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	29.4	30.6	29.7	30.9	31.1	29.4	30.6	29.6	30.9	31.1
	3H	30.5	31.8	30.9	32.0	32.2	30.5	31.8	31.0	32.1	32.3
	4H	30.8	32.0	31.2	32.3	32.5	30.9	32.1	31.3	32.4	32.6
	6H	31.0	32.0	31.3	32.3	32.7	31.1	32.1	31.4	32.4	32.8
	8H	31.0	32.0	31.3	32.3	32.7	31.1	32.1	31.4	32.4	32.8
	12H	31.0	31.9	31.3	32.3	32.7	31.0	32.0	31.4	32.3	32.8
4H	2H	30.0	31.2	30.4	31.4	31.7	30.0	31.1	30.4	31.4	31.7
	3H	31.4	32.3	31.7	32.7	33.1	31.4	32.3	31.8	32.7	33.1
	4H	31.7	32.5	32.1	33.0	33.5	31.7	32.6	32.2	33.0	33.6
	6H	31.8	32.7	32.3	33.0	33.4	31.9	32.8	32.4	33.1	33.5
	8H	31.8	32.6	32.3	33.0	33.3	31.9	32.7	32.4	33.0	33.4
	12H	31.8	32.4	32.3	32.9	33.3	31.9	32.5	32.4	32.9	33.4
8H	4H	31.8	32.6	32.3	32.9	33.3	31.9	32.6	32.4	33.0	33.4
	6H	32.0	32.6	32.5	33.0	33.6	32.1	32.7	32.6	33.1	33.7
	8H	32.1	32.6	32.6	33.1	33.7	32.1	32.6	32.7	33.2	33.8
	12H	32.1	32.5	32.6	33.0	33.6	32.1	32.6	32.7	33.1	33.7
12H	4H	31.8	32.4	32.3	32.8	33.3	31.8	32.5	32.3	32.9	33.4
	6H	32.0	32.5	32.5	33.0	33.7	32.1	32.6	32.6	33.1	33.8
	8H	32.1	32.5	32.6	33.0	33.6	32.1	32.6	32.7	33.1	33.7

Variations with the observer position for the luminaire spacings. S:

S = 1.0H	0.1 / -0.2	0.1 / -0.2
S = 1.5H	0.3 / -0.4	0.3 / -0.4
S = 2.0H	0.8 / -1.0	0.8 / -1.0

Coefficients of Utilization

Ceiling reflectance	80	70	50	30	10	0												
Wall reflectance	70 50 30	10 70 50	30 10 50	30 10 50	30 10 50	30 10 0												
Floor reflectance	20 20 20	20 20 20	20 20 20	20 20 20	20 20 20	20 20 0												
RCR	(RCR: Room Cavity Ratio)																	
	Room Values are expressed as percentage of Lumen delivered to the task surface																	
0	119	119	119	119	116	116	116	116	111	111	106	106	106	102	102	102	100	
1	109	105	101	97	107	103	99	96	99	96	93	95	92	90	91	89	87	85
2	100	92	85	80	97	90	84	79	86	81	77	83	79	75	80	77	74	72
3	91	81	73	67	89	79	72	66	76	70	65	74	68	64	71	66	63	60
4	83	72	63	56	81	70	62	56	68	61	55	65	59	54	63	58	54	52
5	77	64	55	48	75	63	54	48	61	53	48	59	52	47	57	51	47	45
6	71	57	49	42	69	57	48	42	55	47	42	53	46	41	51	46	41	39
7	66	52	43	37	64	51	43	37	50	42	37	48	42	37	47	41	36	34
8	61	47	39	33	59	47	39	33	45	38	33	44	38	33	43	37	32	31
9	57	44	35	30	55	43	35	30	42	35	30	41	34	29	40	34	29	27
10	53	40	32	27	52	40	32	27	39	32	27	38	31	27	37	31	27	25