



PHOTOMETRIC LIGHT REPORT

Floodlight pro | 100W | 120° | warm white 3000K

Article number: 146-330



Go to the
webshop
of Tronix
Lighting



TRONIX



146-330 Floodlight pro | 100W | 120° | warm white 3000K

Introduction

Purpose of this Document

This document provides accurate and objective photometric data for Tronix Lighting item 146-330. All information is based on actual measurements taken from standard production units. No modifications were made to enhance performance results. In some cases, minor adjustments—such as temporary removal of covers, cables, or mounting features—were necessary for testing purposes. These did not influence product performance.

Test Methodology

Testing was conducted using randomly selected, unopened samples from regular inventory. All tests comply with the LM-79-19 standard, the recognized method for photometric and electrical measurements of LED and OLED luminaires. This standard, an update of IES LM-79-2008, outlines environmental test conditions, stabilization procedures, measurement methods, and approved instruments. It uses absolute photometry, meaning results directly reflect the performance of the tested product, without comparison to rated lamp standards.

Product 146-330 was tested using:

- A photogoniometer to measure luminous intensity distribution at various angles
- An integrating sphere to determine total luminous flux and colour characteristics

Compliance & Certification

Item 146-330 meets the requirements of the following EU directives. Tronix Lighting certifies that all relevant tests were executed in accordance with the applicable standards, and the CE mark is applied accordingly:

- General Product Safety – Directive 2023/988/EC
- Low Voltage Directive (LVD) – Directive 2014/35/EU
- Electromagnetic Compatibility (EMC) – Directive 2004/108/EC
- Ecodesign – Directive 2009/125/EC
- RoHS 3 – Directive 2011/65/EU + Amendment 2015/863/EU

Recycling & Sustainability

Tronix Lighting is affiliated with national recycling systems for electrical and electronic waste. The luminaire is over 90% recyclable when disposed of as electronic waste at end of life. In addition, Tronix Lighting participates in national packaging recycling schemes, ensuring full compliance with both the WEEE and packaging directives.



146-330 Floodlight pro | 100W | 120° | warm white 3000K

Laboratory and equipment

Laboratory owner and location	Tronix Lighting BV. Uden. The Netherlands
Gonio spectrometer system and type	Viso Systems Type C. horizontal
Spectrometer manufacturer and model	(Gonio) Ocean Optics STS VIS (Sphere) Admesy HERA VIS 380–780nm
Flicker meter manufacturer and model	Viso Systems LabFlicker
Oscilloscope manufacturer and model	Tektronix MDO3024 oscilloscope (4 Channels. 200 MHz)
Power meter manufacturer and model	Vitrek PA900 Precision Multi-Channel Harmonic Power Analyzer
Power source manufacturer and model	(DC) Keithley Source Measure Unit SMU-2420 3A DC Source Meter (AC) Chroma 61601 AC Source
Datalogger Manufacturer and Model	Omega 8-Channel Thermocouple Thermometer/Data Logger

Measurement conditions gonio spectrometer

Number of C-planes and Resolution	8 planes – 45°
γ (gamma)-Resolution	2.5°
Test Distance	1.81 m
Room Temperature and Humidity	22°C +/- 10% – RH 50% +/- 20%
Input Power. Power and Displacement Factors	101.2 W – PF 0.98 – DPF 0.98
Frequency of Input Power	50 Hz
Warm-up Time and Variation	Lamp stabilized in 20 min 54 sec --4.4%

Tested light source

Manufacturer and Order Code	Tronix Lighting – 146-330
Product Description	Floodlight pro 100W 120° warm white 3000K

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)	13370 lm – 0% / 100%
Efficiency	132 lm/W
Energy efficiency class	E
Peak Intensity and Beam Angle	4782 cd – 114.4°
Correlated Colour Temperature	CCT = 3090 K
Colour Shift. CIE duv	Duv -0.0009
Colour Rendering Index	CRI 72.0
Colour Rendering TM30-18	R _f 73.4 – R _g 96.4
Television Lighting Consistency Index	TLCI = 44
Flicker	SVM 0 – PstLM 0.01



146-330 Floodlight pro | 100W | 120° | warm white 3000K

Electrical measurement details

Input Power

RMS Input voltage feed. V_{RMS} 231 V
 RMS Input current feed. I_{RMS} 0.445 A
 Total input power 101.2 W

Frequency of input power 50 Hz
 Power factor 0.98
 Displacement power factor 0.98

Total harmonic distortion of the current 6.76%
 Total harmonic distortion of the voltage 2.32%

Input Power Curve

Voltage - Current




Efficiency

Radiated power efficiency: 37.9%

Lumen efficiency: 132 lm/W

Current Harmonics %

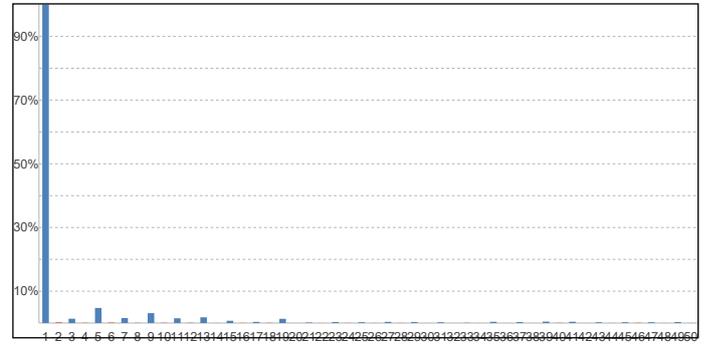

Harmonics

3rd Harmonic 1.36%
 5th Harmonic 4.73%
 7th Harmonic 1.58%
 9th Harmonic 3.1%
 11th Harmonic 1.5%

Stabilization Details

Warm-up Conditions

Stable period 15 min
 Stable change max 2.0%
 Minimum warm-up time 15 min

Colour temperature change during warm-up

CCT start 3079 K
 CCT shift +11 K
 CCT end 3090 K

Warm-up Results

Total warmup time Lamp stabilized in 20 min 54 sec
 Warmup variation -4.4%

Output intensity change during warm-up

Output start 13968 lm
 Output change -598 lm
 Output end 13370 lm




146-330 Floodlight pro | 100W | 120° | warm white 3000K

Colour measurement details



Total lumen output: 13370 lm
 Correlated Colour Temperature: 3090 K
 Colour coordinates CIE 1931: (x;y) = (0.430;0.399)
 Colour deviation from BBL: Duv = -0.0009

TM30-18 Colour Fidelity Index: R_f 73.4
 TM30-18 Colour Gamut Index: R_g 96.4
 Colour Rendering Index (Ra): CRI 72.0
 Colour Rendering Index. (red component): $R_9 = -27.4$


Colour Quality Scale: CQS = 70.7
 Television Lighting Consistency Index: TLCI = 44

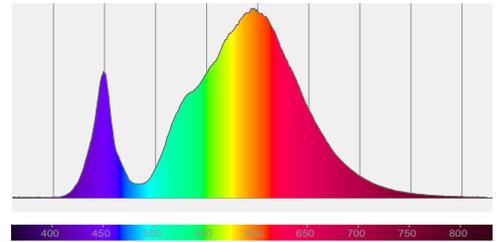


Relative spectral power distribution



TM30 details

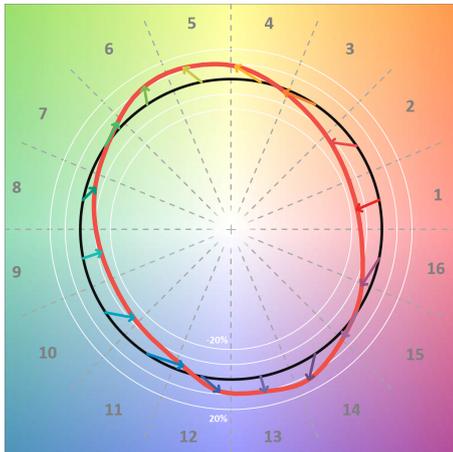


TM30 Colour vectors per hue bin

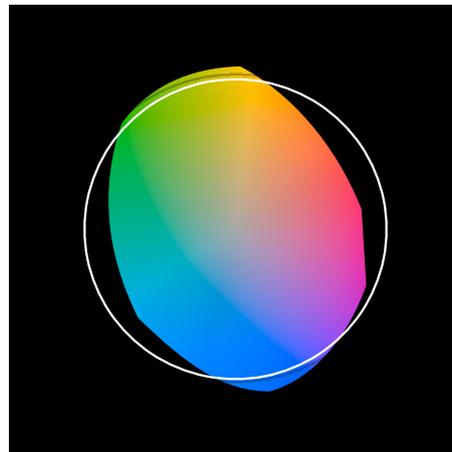


TM30 Colour distortion


Hue Bin	R_f	Shifts (%)	
		Chroma	Hue
C1	72	-16%	-3%
C2	70	-13%	12%
C3	59	-4%	22%
C4	70	7%	18%
C5	82	12%	10%
C6	82	11%	-5%
C7	73	2%	-17%
C8	82	-6%	-9%
C9	81	-13%	-2%
C10	67	-14%	13%
C11	63	-6%	24%
C12	78	7%	13%
C13	84	11%	1%
C14	77	12%	-13%
C15	71	2%	-18%
C16	74	-8%	-20%

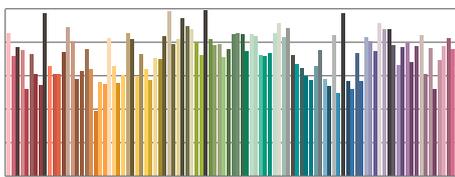

TM30-18 R_f -values per reference colour

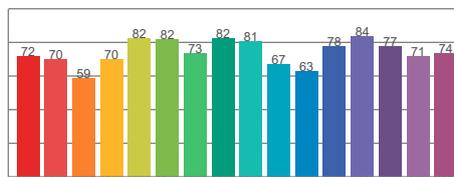


TM30-18 R_f -values per hue bin

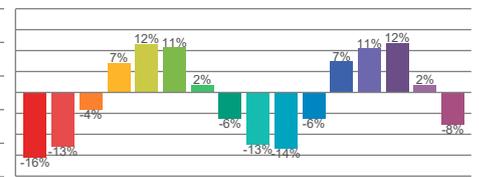


TM30 Chroma shift

Colour Quality details

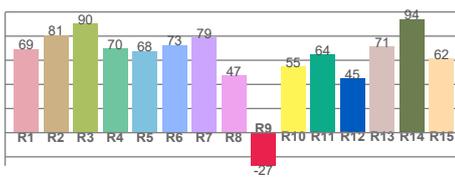

Colour Rendering Index

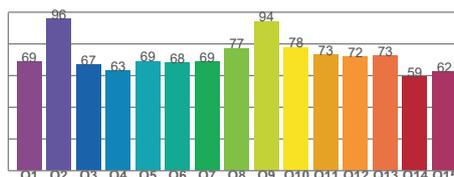

Colour Quality Scale



146-330 Floodlight pro | 100W | 120° | warm white 3000K

Flicker / temporal light artefacts details

Measurement conditions

Flicker meter type	Viso Systems LabFlicker
Flicker/TLA sample rate	20000 samples/s
Measurement time	5x 180 seconds (15 minutes) for PstLM. 1.2 sec for all other indices

Flicker indices according to Illuminating Engineering Society (IES)


Flicker frequency	100.5 Hz
Percent flicker	0.11 %
Flicker index	0

TLA indices (according IEC TR 61547-1, EN 61000-3-3 and EN 61000-4-15)


An LED luminaire is considered flicker-free if the SVM value is ≤ 0.4 and if the PstLM value is ≤ 1.0

PstLM value (F < 80 Hz)	0.01
SVM value (80 < F < 2000 Hz)	0


Flicker frame (one flicker period in time domain)

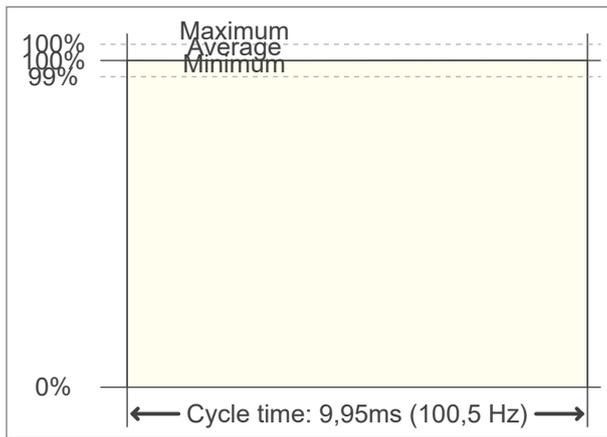

Flicker FFT (flicker curve in frequency domain)

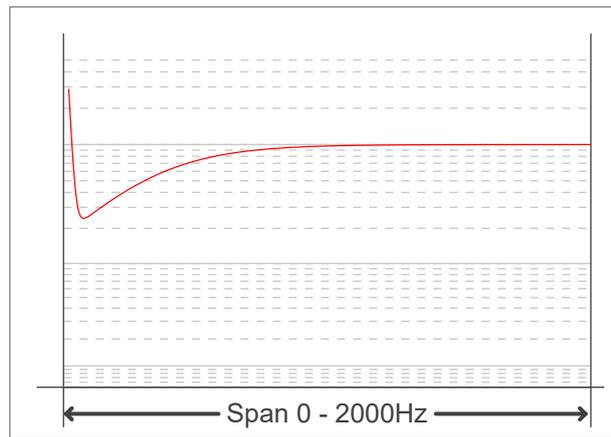

IEEE 1789-2015 Lighting Flicker Risk Zones

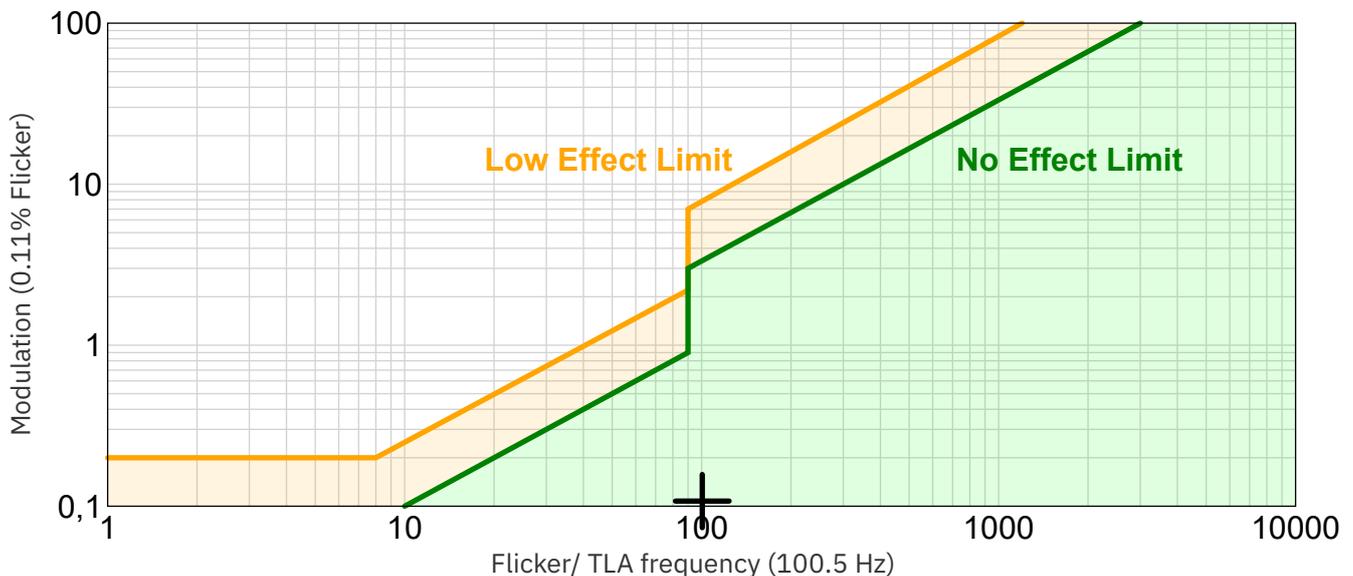

Document revision date: 1-7-2025 Measurement serial: VFR-250219-3084-MS




146-330 Floodlight pro | 100W | 120° | warm white 3000K

Beam angle

Luminous Intensity diagram

Unit: 0-100% of peak intensity

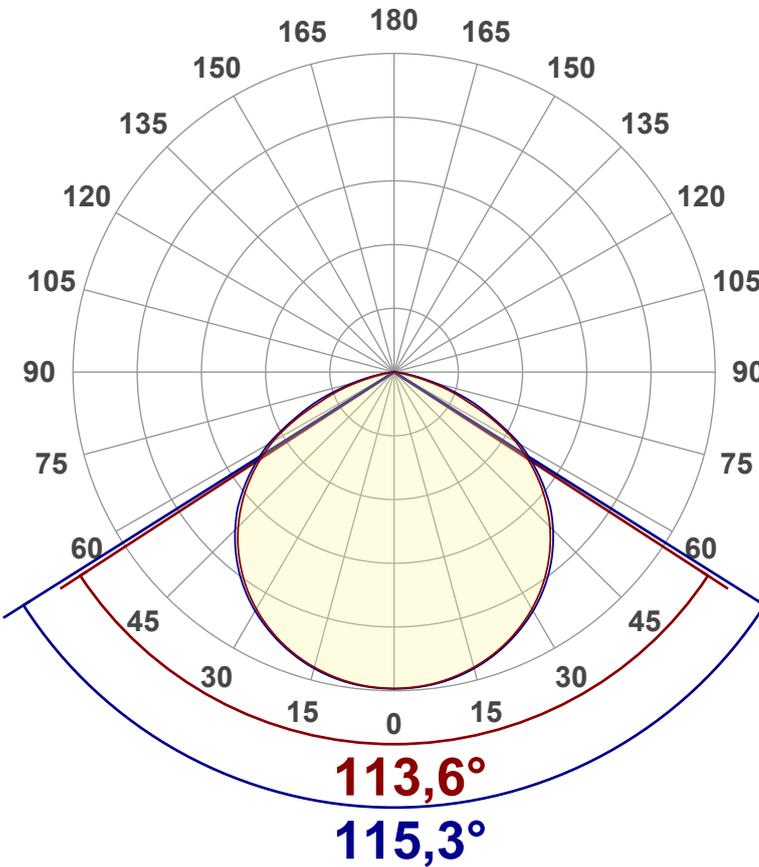

Main Values

Output (total Lumen)	13370 lm
Lumen Up/Down	0% / 100%
Peak Intensity	4782 cd
Beam Angle (50%)	114.4°
Beam Angle (90%)	115.3°
Beam Angle (10%)	113.6°

Cut-off Angle

Average 2.5%	164.3°
--------------	--------

Field Angle

Average 10%	152.5°
-------------	--------


Intensity Ratio

In 120° cone	82.8%
In 90° cone	56.1%

C planes

- C000-C180
- C090-C270

Linear distribution diagram - Intensity (candela) vs γ-angle

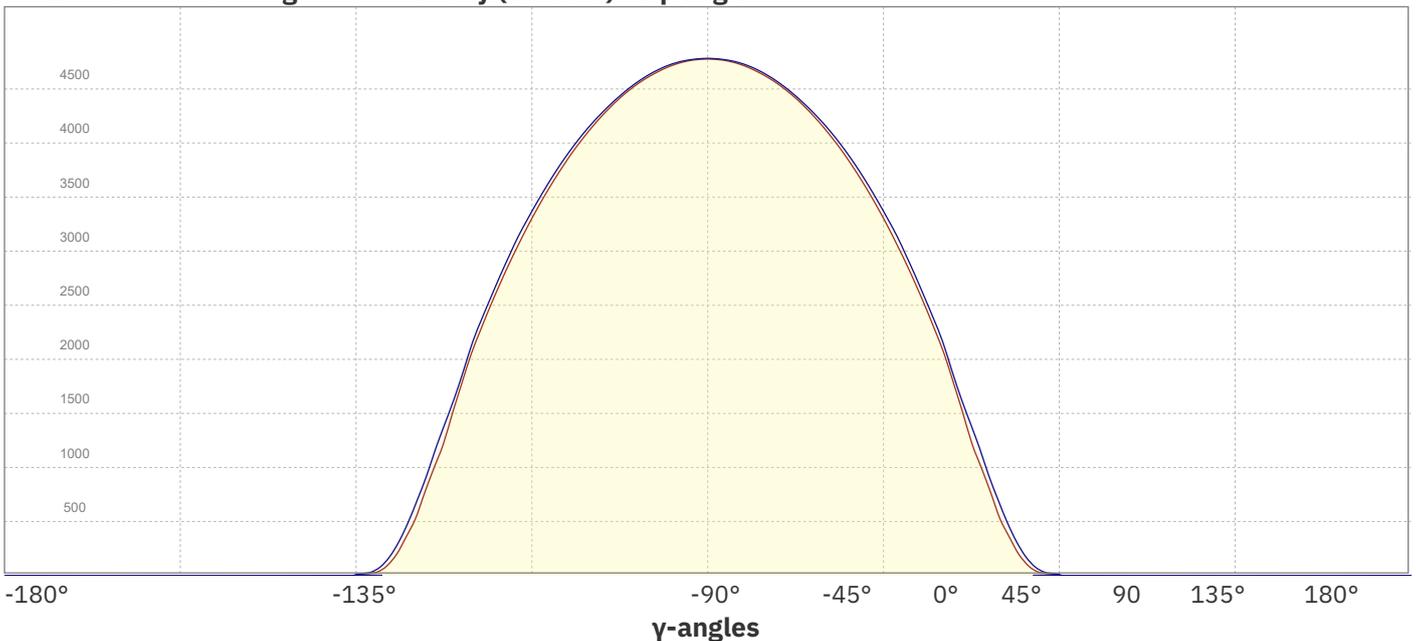


Document revision date: 1-7-2025 Measurement serial: VFR-250219-3084-MS



146-330 Floodlight pro | 100W | 120° | warm white 3000K

Beam Details

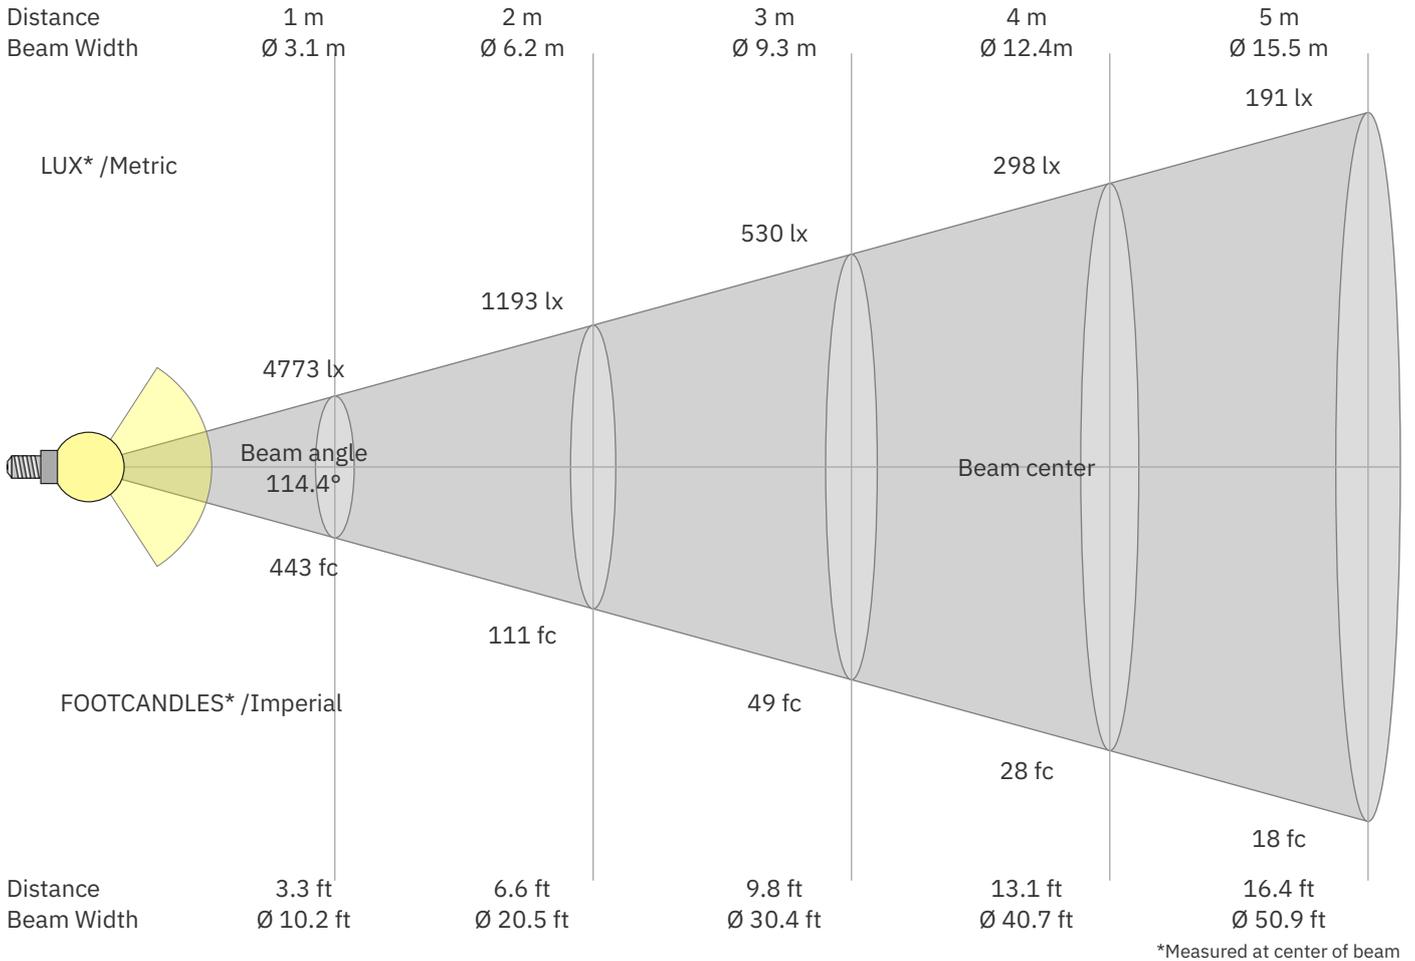

*Measured at center of beam

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3.3	6.6	9.8	13.1	16.4	19.7	23	26.2	29.5	32.8	36.1	39.4	42.7	45.9	49.2	52.5	55.8	59.1	62.3	65.6	ft
4773	1193	530	298	191	133	97	75	59	48	39	33	28	24	21	19	17	15	13	12	lux
443.4	110.9	49.3	27.7	17.7	12.3	9	6.9	5.5	4.4	3.7	3.1	2.6	2.3	2	1.7	1.5	1.4	1.2	1.1	fc

Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
4773	4758	4704	4614	4491	4328	4129	3894	3617	3301	2944	2545	2098	1539	1001	512	180	32	7	0	cd
100%	100%	99%	97%	94%	91%	87%	82%	76%	69%	62%	53%	44%	32%	21%	11%	4%	1%	0%	0%	of 0°val

Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
4773	4766	4719	4633	4510	4353	4165	3939	3673	3367	3020	2615	2176	1625	1134	640	257	56	6	0	cd
100%	100%	99%	97%	94%	91%	87%	83%	77%	71%	63%	55%	46%	34%	24%	13%	5%	1%	0%	0%	of 0°val

Intensities in 180° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
4773	4758	4704	4614	4491	4328	4129	3894	3617	3301	2944	2545	2098	1539	1001	512	180	32	7	0	cd
100%	100%	99%	97%	94%	91%	87%	82%	76%	69%	62%	53%	44%	32%	21%	11%	4%	1%	0%	0%	of 0°val

Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
4773	4766	4719	4633	4510	4353	4165	3939	3673	3367	3020	2615	2176	1625	1134	640	257	56	6	0	cd
100%	100%	99%	97%	94%	91%	87%	83%	77%	71%	63%	55%	46%	34%	24%	13%	5%	1%	0%	0%	of 0°val

Document revision date: 1-7-2025 Measurement serial: VFR-250219-3084-MS



146-330 Floodlight pro | 100W | 120° | warm white 3000K

Light Planning – UGR table

Uncorrected, comprehensive UGR table according to CIE 117-1995

Reflectances		70	70	50	50	30	70	70	50	50	30
ρ Ceiling		70	70	50	50	30	70	70	50	50	30
ρ Walls		50	30	50	30	30	50	30	50	30	30
ρ Floor		20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	30.9	32.1	31.1	32.4	32.6	31.0	32.2	31.2	32.5	32.7
	3H	31.9	33.1	32.3	33.4	33.6	32.1	33.3	32.5	33.6	33.8
	4H	32.1	33.3	32.5	33.6	33.8	32.4	33.6	32.9	33.9	34.1
	6H	32.3	33.3	32.6	33.5	33.9	32.6	33.7	32.9	33.9	34.3
	8H	32.2	33.2	32.6	33.5	33.9	32.6	33.6	33.0	33.9	34.3
	12H	32.2	33.1	32.5	33.5	33.9	32.6	33.5	32.9	33.9	34.3
4H	2H	31.4	32.6	31.8	32.8	33.1	31.5	32.7	31.9	32.9	33.2
	3H	32.7	33.6	33.0	34.0	34.4	32.9	33.8	33.3	34.2	34.6
	4H	32.9	33.8	33.4	34.2	34.8	33.2	34.1	33.7	34.5	35.0
	6H	33.0	33.9	33.5	34.2	34.6	33.4	34.2	33.9	34.6	34.9
	8H	33.0	33.8	33.5	34.1	34.5	33.4	34.2	33.9	34.5	34.9
	12H	33.0	33.6	33.5	34.0	34.5	33.4	34.0	33.9	34.4	34.9
8H	4H	33.0	33.8	33.5	34.2	34.5	33.3	34.1	33.8	34.4	34.8
	6H	33.2	33.8	33.7	34.2	34.8	33.5	34.1	34.0	34.6	35.1
	8H	33.2	33.7	33.7	34.2	34.9	33.6	34.1	34.1	34.6	35.2
	12H	33.2	33.6	33.8	34.1	34.7	33.6	34.0	34.2	34.5	35.1
12H	4H	33.0	33.6	33.5	34.1	34.5	33.3	33.9	33.8	34.3	34.8
	6H	33.2	33.7	33.7	34.2	34.9	33.6	34.0	34.1	34.6	35.2
	8H	33.2	33.6	33.8	34.1	34.7	33.6	34.0	34.2	34.5	35.1

Variations with the observer position for the luminaire spacings. S:

S = 1.0H	0.1 / -0.2	0.1 / -0.2
S = 1.5H	0.3 / -0.5	0.3 / -0.4
S = 2.0H	0.9 / -1.3	0.8 / -1.1

Coefficients of Utilization

Ceiling reflectance	80	70	50	30	10	0												
Wall reflectance	70 50 30	10 70 50	30 10 50	30 10 50	30 10 50	30 10 0												
Floor reflectance	20 20 20	20 20 20	20 20 20	20 20 20	20 20 20	20 20 0												
RCR	(RCR: Room Cavity Ratio)																	
	Room Values are expressed as percentage of Lumen delivered to the task surface																	
0	119	119	119	119	116	116	116	116	111	111	106	106	106	102	102	102	100	
1	110	105	101	98	107	103	99	96	99	96	93	95	92	90	91	89	88	85
2	100	92	86	80	97	90	84	79	87	82	77	83	79	76	80	77	74	72
3	91	81	73	67	89	79	72	66	77	70	65	74	68	64	71	67	63	61
4	84	72	63	57	81	71	63	56	68	61	56	66	60	55	64	58	54	52
5	77	64	55	49	75	63	55	49	61	54	48	59	53	47	57	52	47	45
6	71	58	49	43	69	57	48	42	55	48	42	53	47	42	52	46	41	39
7	66	52	44	38	64	51	43	37	50	43	37	49	42	37	47	41	37	35
8	61	48	39	33	60	47	39	33	46	38	33	44	38	33	43	37	33	31
9	57	44	36	30	56	43	35	30	42	35	30	41	34	30	40	34	29	28
10	53	40	32	27	52	40	32	27	39	32	27	38	31	27	37	31	27	25