

# 产品认证证书

## II型自愿认证

证书编号: CQC2018010307129261

发证日期: 2021年08月10日

有效期至: 2031年08月10日

**委托人名称** ABB S.p.A.  
**及注册地址** Via Vittor Pisani 16-20124 Milano (MI)-Italy

**制造商名称** ABB S.p.A.  
**及注册地址** Viale dell'Industria 18-20010 Vittuone (MI)-Italy

**生产企业名称** ABB S.p.A.  
**及生产地址** Via Ardeatina 2491-00040 Santa Palomba (RM) - Italy

**产品名称和系列、规格、型号** 剩余电流动作断路器  
F202, F204: 详情及型号解释见附件

**产品标准和技术要求** GB/T 22794-2017

**认证模式** 产品型式试验+初次工厂检查+获证后监督

上述产品符合 CQC12-000001-2020 认证规则的要求, 特发此证。

本证书为变更证书, 证书首次颁发日期: 2020年08月28日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

可通过扫描下方二维码或登录国家认监委网站 ([www.cnca.gov.cn](http://www.cnca.gov.cn)) 查验证书信息



授权签字人

陈昕

签发

谢肇煦

中国质量认证中心



<http://www.cqc.com.cn>

中国·北京·南四环西路188号9区 100070

电话: +86 10 83886666

C(2) 0065929

# CERTIFICATE OF PRODUCT CERTIFICATION

## TYPE II CQC CERTIFICATION

CERTIFICATE NO.: CQC2018010307129261

Valid from: Aug.10,2021

Valid until: Aug.10,2031

**NAME AND REGISTERED ADDRESS OF THE APPLICANT** ABB S.p.A.  
Via Vittor Pisani 16-20124 Milano (MI)-Italy

**NAME AND REGISTERED ADDRESS OF THE MANUFACTURER** ABB S.p.A.  
Viale dell'Industria 18-20010 Vittuone (MI)-Italy

**NAME AND LOCATION OF THE FACTORY** ABB S.p.A.  
Via Ardeatina 2491-00040 Santa Palomba (RM) - Italy

**PRODUCT NAME, MODEL AND SPECIFICATION** Residual Current Operated Circuit-breakers without Integral Overcurrent Protection  
F202 , F204 : See the appendix

**THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS** GB/T 22794-2017

**TYPE OF CERTIFICATION SCHEMES** Type Testing of Product + Initial Factory Inspection + Follow up Factory Inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC12-000001-2020.

Date of original issued: Aug.28,2020

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

The certificate information is available through the QR code below or CNCA's website: [www.cnca.gov.cn](http://www.cnca.gov.cn)



SIGN BY

陈昕

SIGNATURE

谢肇煦



CHINA QUALITY CERTIFICATION CENTRE



<http://www.cqc.com.cn>

Section 9, No. 188, Nansihuan Xilu, Beijing 100070 P.R. China

Tel: +86 10 83886666

C(2) 0065929

# 产品认证证书

## II型自愿认证

### 附 录

证书编号: CQC2018010307129261

第 1 页 共 4 页

纸 号: 65929

F202:

Uimp: 4kV;

Ui: 500V;

Ue: AC230 V (2P);

In: 16 A, 25 A, 40 A, 63 A;

极数: 2P;

额定剩余动作类型: B 型;

I $\Delta$ n: 30mA, 300mA;

电磁式;

I $\Delta$ m: 1kA;

Im: 1kA;

适用于隔离

额定频率: 50Hz

F204:

Uimp: 4kV;

Ui: 500V;

Ue: AC230/AC400 V (3P+N);

In: 25 A, 40 A, 63 A;

I $\Delta$ n: 30mA, 300mA, 500 mA;

极数: 3P+N(N 极可开闭);

额定剩余动作类型:

B 型: 25A (30mA, 300mA), 40A, 63A;

B 型/延时型: 40A (300mA, 500mA), 63A (300mA, 500mA)

注: 此附录与证书同时使用时有效。



中国质量认证中心



# 产品认证证书

## II型自愿认证


附 录

证书编号: CQC2018010307129261

第 2 页 共 4 页

纸 号: 65929

电磁式;  
 $I_{\Delta m}$ : 1kA;  
 $I_m$ : 1kA;  
适用于隔离  
额定频率: 50Hz

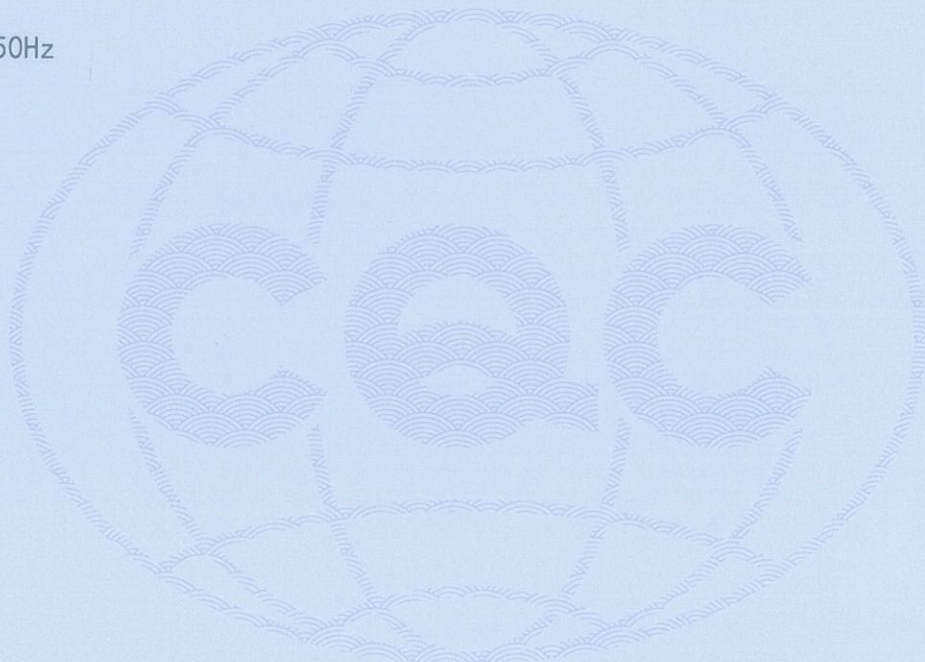

注: 此附录与证书同时使用时有效。



中国质量认证中心



# 产品认证证书

## II型自愿认证


附 录

证书编号: CQC2018010307129261

第 3 页 共 4 页

纸 号: 65929

型号解释:

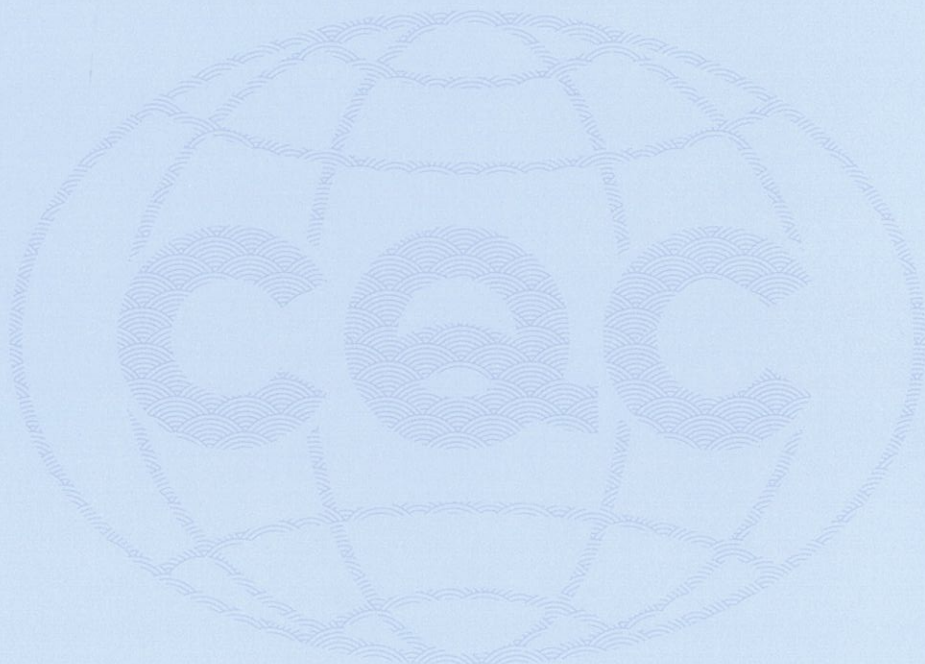

注: 此附录与证书同时使用时有效。



中国质量认证中心



# 产品认证证书

## II型自愿认证

附 录

证书编号: CQC2018010307129261

第 4 页 共 4 页

纸 号: 65929

F 20 2 B 25 0.03  
1 2 3 4 5

- 1— Basic Type 基本型号
- 2— Number of pole 极数:  
2-2P, 4-3P+N(N 极可开闭)
- 3— Operating characteristic 剩余电流动作特性:  
B- B 型  
BS- SB 型
- 4— Rated current 额定电流:  
16=16 A; 25=25 A; 40=40 A; 63=63 A
- 5— Rated residual current 额定剩余动作电流  $I_{\Delta n}$   
0.03=30 mA, 0.3=300 mA, 0.5=500 mA

Poles 极数	Rated current 额定电流	Rated residual current 额定剩余电流	Type 剩余电流动作类型
2P	16A, 25A, 40A, 63A	30mA, 300mA	B 型
3P+N(N 极可开闭)	25A, 40A, 63A	30mA, 300mA	B 型
	40A, 63A	500mA	B 型
	40A, 63A	300mA, 500mA	B 型/延时型

注: 此附录与证书同时使用时有效。



中国质量认证中心

