Product Environmental Profile

TRANSFORMER CONTROL 500VA 240/480V-120V



General information

Reference product	TRANSFORMER CONTROL 500VA 240/480V-120V - 9070T500D1
Description of the product	Control power transformers from Schneider Electric set the industry standard for design innovation and performance. They are designed with low impedance windings for excellent voltage regulation, and can accommodate the high inrush current associated with contactors, starters, solenoids, and relays.
Description of the range	Single product
Functional unit	Convert distribution voltage of either 240V or 480V to required control voltage of 120V, units are specifically design to limit voltage drop during high inrush currents from control devices, during 20 years
Specifications are:	Rated Power: 500 VA Phase: Single-phase Frequency: 50/60 Hz Primary Voltage: 240 × 480 VAC (also configurable for 230×460 V and 220×440 V) Secondary Voltage: 120 VAC (also 115 V and 110 V taps available) Temperature Rise: 115°C Insulation Class Temperature: 180°C (356°F)

Constituent materials

Reference product mass	5646.7 g	including the product and its packaging

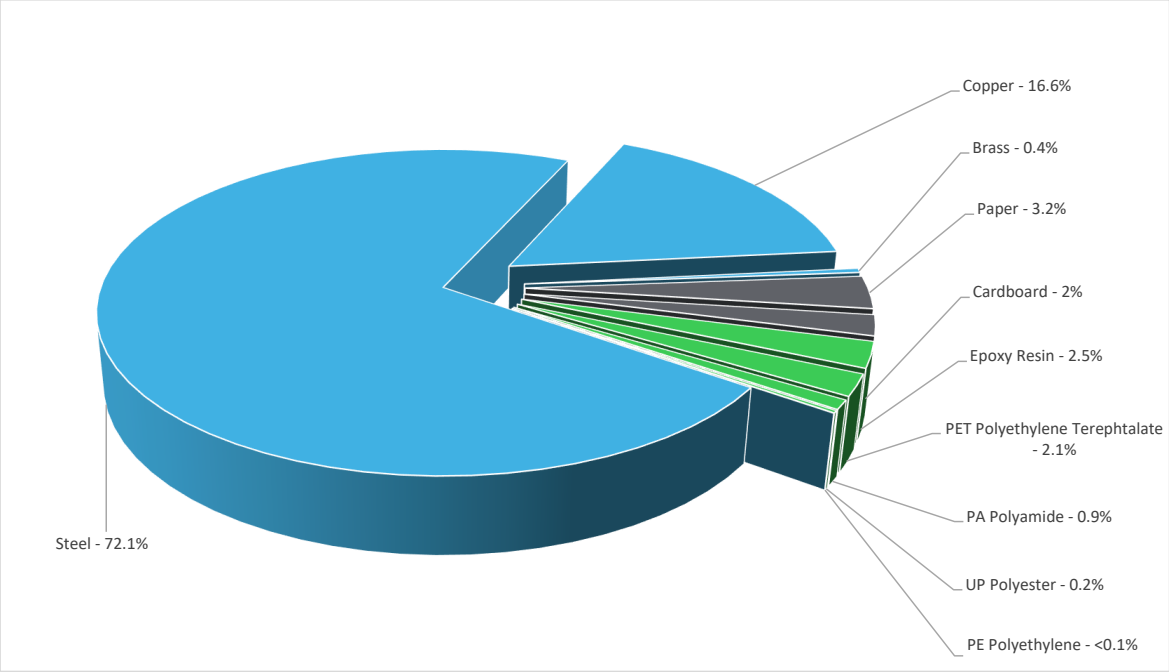

Metals	89.1%
Plastics	5.7%
Others	5.2%

Substance assessment

Details of ROHS and REACH substances information are available on the Schneider-Electric website
https://www.se.com

Additional environmental information

End Of Life	Recyclability potential:	**92%**	The recyclability rate was calculated from the recycling rates of each material making up the product based on REEECY'LAB tool developed by Ecosystem, for components/materials not covered by the tool, data from the EIME database and the related PSR was taken. If no data was found a conservative assumption was used (0% recyclability).

Environmental impacts

Reference service life time	20 years			
Product category	Industrial Control Transformer			
Life cycle of the product	The manufacturing, the distribution, the installation, the use and the end of life were taken into consideration in this study			
Electricity consumption	The electricity consumed during manufacturing processes is considered for each part of the product individually, the final assembly generates a negligible consumption			
Installation elements	The product does not require any installation operations.			
Use scenario	The product has a service life of 20 years with a power consumption of 5392.656 kWh in Active mode for 60% of its operating time and 906.66 kWh in Standby mode for 25% of its operating time throughout its lifetime.			
Time representativeness	The collected data are representative of the year 2026			
Technological representativeness	The Modules of Technologies such as material production, manufacturing processes and transport technology used in the PEP analysis (LCA EIME in the case) are similar and representative of the actual type of technologies used to make the product.			
Geographical representativeness	**Final assembly site**	**Use phase**		**End-of-life**
	Mexico, USA	USA		USA
Energy model used	**[A1 - A3]**	**[A5]**	**[B6]**	**[C1 - C4]**
	Electricity mix; Production mix; low voltage; 2024; United States, US	No energy used	Electricity mix; Consumption mix; Low voltage; 2024; United States, US	Global, European and French datasets are used.

Detailed results of the optional indicators mentioned in PCRed4 are available in the LCA report and on demand in a digital format - Country Customer Care Center - http://www.se.com/contact

Mandatory Indicators		TRANSFORMER CONTROL 500VA 240/480V-120V - 9070T500D1						
Impact indicators	**Unit**	**Total (without Module D)**	**[A1 - A3] - Manufacturing**	**[A4] - Distribution**	**[A5] - Installation**	**[B1 - B7] - Use**	**[C1 - C4] - End of life**	**[D] - Benefits and loads**
Contribution to climate change	kg CO2 eq	2.70E+03	2.60E+01	1.00E+00	5.56E-01	2.66E+03	7.11E+00	0.00E+00
Contribution to climate change-fossil	kg CO2 eq	2.68E+03	2.66E+01	1.00E+00	0*	2.65E+03	7.08E+00	0.00E+00
Contribution to climate change-biogenic	kg CO2 eq	1.52E+01	-5.44E-01	1.65E-03	4.67E-01	1.52E+01	3.26E-02	0.00E+00
Contribution to climate change-land use and land use change	kg CO2 eq	3.25E-05	7.70E-07	1.52E-06	7.97E-09	2.58E-05	4.36E-06	0.00E+00
Contribution to ozone depletion	kg CFC-11 eq	1.72E-05	3.57E-06	1.17E-08	3.55E-09	1.33E-05	2.97E-07	0.00E+00
Contribution to acidification	mol H+ eq	1.09E+01	3.15E-01	1.57E-03	0*	1.06E+01	3.50E-02	0.00E+00
Contribution to eutrophication, freshwater	kg P eq	5.22E-03	8.78E-05	3.74E-06	0*	5.11E-03	1.43E-05	0.00E+00
Contribution to eutrophication, marine	kg N eq	1.19E+00	1.73E-02	2.86E-04	1.34E-04	1.16E+00	3.95E-03	0.00E+00
Contribution to eutrophication, terrestrial	mol N eq	1.43E+01	1.98E-01	3.14E-03	1.80E-03	1.40E+01	4.68E-02	0.00E+00
Contribution to photochemical ozone formation - human health	kg COVNM eq	4.17E+00	7.63E-02	1.01E-03	0*	4.07E+00	1.42E-02	0.00E+00
Contribution to resource use, minerals and metals	kg Sb eq	1.07E-02	7.67E-03	0*	0*	3.01E-03	3.22E-06	0.00E+00
Contribution to resource use, fossils	MJ	6.25E+04	5.90E+02	1.78E+01	0*	6.17E+04	1.12E+02	0.00E+00
Contribution to water use	m3 eq	1.26E+02	1.86E+01	3.69E-02	0*	1.06E+02	1.13E+00	0.00E+00

Inventory flows Indicators		TRANSFORMER CONTROL 500VA 240/480V-120V - 9070T500D1						
Inventory flows	Unit	Total (without Module D)	[A1 - A3] - Manufacturing	[A4] - Distribution	[A5] - Installation	[B1 - B7] - Use	[C1 - C4] - End of life	[D] - Benefits and loads
Contribution to renewable primary energy used as energy	MJ	1.63E+04	2.35E+01	0*	0*	1.63E+04	1.26E+01	0.00E+00
Contribution to renewable primary energy used as raw material	MJ	5.65E+00	5.65E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Contribution to total renewable primary energy	MJ	1.63E+04	2.92E+01	0*	0*	1.63E+04	1.26E+01	0.00E+00
Contribution to non renewable primary energy used as energy	MJ	6.24E+04	5.79E+02	1.78E+01	0*	6.17E+04	1.12E+02	0.00E+00
Contribution to non renewable primary energy used as raw material	MJ	1.04E+01	1.04E+01	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Contribution to total non renewable primary energy	MJ	6.25E+04	5.90E+02	1.78E+01	0*	6.17E+04	1.12E+02	0.00E+00
Contribution to use of secondary material	kg	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Contribution to use of renewable secondary fuels	MJ	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Contribution to use of non renewable secondary fuels	MJ	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Contribution to net use of fresh water	m³	2.99E+00	4.33E-01	8.59E-04	0*	2.52E+00	3.46E-02	0.00E+00
Contribution to hazardous waste disposed	kg	6.63E+02	6.02E+02	0*	1.11E-01	6.02E+01	2.72E-01	0.00E+00
Contribution to non hazardous waste disposed	kg	4.15E+02	1.62E+01	9.32E-02	0*	3.93E+02	6.20E+00	0.00E+00
Contribution to radioactive waste disposed	kg	1.24E-01	7.26E-03	7.38E-05	0*	1.17E-01	3.47E-04	0.00E+00
Contribution to components for reuse	kg	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Contribution to materials for recycling	kg	5.28E+00	2.27E-01	0*	0*	0*	5.06E+00	0.00E+00
Contribution to materials for energy recovery	kg	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Contribution to exported energy	MJ	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00

* represents less than 0.01% of the total life cycle of the reference flow

Contribution to biogenic carbon content of the product	kg of C	0.00E+00
Contribution to biogenic carbon content of the associated packaging	kg of C	1.01E-01

** The calculation of the biogenic carbon is based on the Ademe for the Cardboard (28%), EN16485 for Wood (39,52%), and APESA/RECORD for Paper (37,8%)*

Mandatory Indicators		TRANSFORMER CONTROL 500VA 240/480V-120V - 9070T500D1							
Impact indicators	Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
Contribution to climate change	kg CO2 eq	2.66E+03	0	0.00E+00	0	0	0	2.66E+03	0
Contribution to climate change-fossil	kg CO2 eq	2.65E+03	0	0.00E+00	0	0	0	2.65E+03	0
Contribution to climate change-biogenic	kg CO2 eq	1.52E+01	0	0.00E+00	0	0	0	1.52E+01	0
Contribution to climate change-land use and land use change	kg CO2 eq	2.58E-05	0	0.00E+00	0	0	0	2.58E-05	0
Contribution to ozone depletion	kg CFC-11 eq	1.33E-05	0	0.00E+00	0	0	0	1.33E-05	0
Contribution to acidification	mol H+ eq	1.06E+01	0	0.00E+00	0	0	0	1.06E+01	0
Contribution to eutrophication, freshwater	kg P eq	5.11E-03	0	0.00E+00	0	0	0	5.11E-03	0
Contribution to eutrophication marine	kg N eq	1.16E+00	0	0.00E+00	0	0	0	1.16E+00	0
Contribution to eutrophication, terrestrial	mol N eq	1.40E+01	0	0.00E+00	0	0	0	1.40E+01	0
Contribution to photochemical ozone formation - human health	kg COVNM eq	4.07E+00	0	0.00E+00	0	0	0	4.07E+00	0
Contribution to resource use, minerals and metals	kg Sb eq	3.01E-03	0	0.00E+00	0	0	0	3.01E-03	0

Inventory flows Indicators		TRANSFORMER CONTROL 500VA 240/480V-120V - 9070T500D1							
Inventory flows	Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	1.63E+04	0	0.00E+00	0	0	0	1.63E+04	0
Contribution to use of renewable primary energy resources used as raw material	MJ	0.00E+00	0	0.00E+00	0	0	0	0.00E+00	0
Contribution to total use of renewable primary energy resources	MJ	1.63E+04	0	0.00E+00	0	0	0	1.63E+04	0
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	6.17E+04	0	0.00E+00	0	0	0	6.17E+04	0
Contribution to use of non renewable primary energy resources used as raw material	MJ	0.00E+00	0	0.00E+00	0	0	0	0.00E+00	0
Contribution to total use of non-renewable primary energy resources	MJ	6.17E+04	0	0.00E+00	0	0	0	6.17E+04	0
Contribution to use of secondary material	kg	0.00E+00	0	0.00E+00	0	0	0	0.00E+00	0
Contribution to use of renewable secondary fuels	MJ	0.00E+00	0	0.00E+00	0	0	0	0.00E+00	0
Contribution to use of non renewable secondary fuels	MJ	0.00E+00	0	0.00E+00	0	0	0	0.00E+00	0
Contribution to net use of freshwater	m^3	2.52E+00	0	0.00E+00	0	0	0	2.52E+00	0
Contribution to hazardous waste disposed	kg	6.02E+01	0	0.00E+00	0	0	0	6.02E+01	0
Contribution to non hazardous waste disposed	kg	3.93E+02	0	0.00E+00	0	0	0	3.93E+02	0
Contribution to radioactive waste disposed	kg	1.17E-01	0	0.00E+00	0	0	0	1.17E-01	0
Contribution to components for reuse	kg	0.00E+00	0	0.00E+00	0	0	0	0.00E+00	0
Contribution to materials for recycling	kg	0*	0	0.00E+00	0	0	0	0*	0
Contribution to materials for energy recovery	kg	0.00E+00	0	0.00E+00	0	0	0	0.00E+00	0
Contribution to exported energy	MJ	0.00E+00	0	0.00E+00	0	0	0	0.00E+00	0

** represents less than 0.01% of the total life cycle of the reference flow*

Life cycle assessment performed with EIME version v6.3.4, database version 2026-04 in compliance with ISO14044, EF3.1 method is applied, for biogenic carbon storage, assessment methodology -1/1 is used

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration number :	ENVPEP2609056_V1	*Drafting rules*	PEP-PCR-ed4-2021 09 06
		Supplemented by	No PSR
Date of issue	10-2026	*Information and reference documents*	www.pep-ecopassport.org
		Validity period	5 years

Independent verification of the declaration and data, in compliance with ISO 14021 : 2016

Internal X External

The PCR review was conducted by a panel of experts chaired by Julie Orgelet (DDemain)

PEPs are compliant with XP C08-100-1:2016 and EN 50693:2019 or NF E38-500 :2022

The components of the present PEP may not be compared with components from any other program.

Document complies with ISO 14021:2016 "Environmental labels and declarations. Type II environmental declarations"

Schneider Electric Industries SAS

Country Customer Care Center
http://www.se.com/contact

Head Office

35, rue Joseph Monier

CS 30323

F- 92500 Rueil Malmaison Cedex

RCS Nanterre 954 503 439
Capital social 928 298 512 €

©2024 - Schneider Electric – All rights reserved