



产品认证证书

证书编号: CQC2007010309251577

申请人名称及地址

ABB France

3 Rue Jean Perrin CS 90009 69687 Chassieu Cedex, France

制造商名称及地址

ABB 新会低压开关有限公司

广东省江门市新会区今古洲工业开发区

生产企业名称及地址

ABB 新会低压开关有限公司 (V005372)

广东省江门市新会区今古洲工业开发区

产品名称和系列、规格、型号

接触器

AS09,AS12,AS16,ASL09,ASL12,ASL16;详见参数附件

产品标准和技术要求

GB/T14048.4-2010

认证模式

型式试验+获证后监督

上述产品符合 CQC11-462142-2019 认证规则的要求, 特发此证。

发证日期: 2020 年 08 月 14 日 有效期至: 2024 年 11 月 18 日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

主任: _____

陆杨



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

C 0346459



PRODUCT CERTIFICATE

CERTIFICATE NO.: CQC2007010309251577

NAME AND ADDRESS OF THE APPLICANT

ABB France
3 Rue Jean Perrin CS 90009 69687 Chassieu Cedex, France

NAME AND ADDRESS OF THE MANUFACTURER

ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

NAME AND ADDRESS OF THE FACTORY

ABB Xinhui Low Voltage Switchgear Co.,Ltd. (V005372)
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

PRODUCT NAME, MODEL AND SPECIFICATION

Contactor
AS09,AS12,AS16,ASL09,ASL12,ASL16;See the Appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T14048.4-2010

TYPE OF CERTIFICATION SCHEMES

Type testing+Follow up factory inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC11-462142-2019 .

Valid from: Aug.14,2020

Valid until: Nov.18,2024

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

President: _____

Lu Mei



CHINA QUALITY CERTIFICATION CENTRE

Section 9, No.188, Nanshuan Xilu, Beijing 100070 P.R.China

<http://www.cqc.com.cn>

C 0346459



产品认证证书

附录:

证书编号: CQC2007010309251577

第 1 页 共 3 页

纸号: 346459

AS09, AS12, AS16, ASL09, ASL12, ASL16

Ith: AS09/ASL09: 22A(螺钉接线), 20A(弹簧接线);

AS12/ASL12: 25A(螺钉接线), 22A(弹簧接线);

AS16/ASL16: 25A(螺钉接线), 22A(弹簧接线);

AS09/ASL09:

AC-3: Ue/Ie: 220/230/240V/9A, 400-415V/9A, 440V/8A, 500V/8A, 690V/5A;

AC-4: Ue/Ie: 230V/7.2A, 400-415V/7.2A, 500V/5.6A, 690V/4A;

AC-1: Ue/Ie: 690V/22A(螺钉接线), 690V/20A(弹簧接线);

AC-8a: Ue/Ie: 400V/12A;

AS12/ASL12:

AC-3: Ue/Ie: 220/230/240V/12A, 400-415V/12A, 440V/11A, 500V/11A, 690V/7A;

AC-4: Ue/Ie: 230V/9.6A, 400-415V/9A, 500V/8A, 690V/5.6A;

AC-1: Ue/Ie: 690V/24A(螺钉接线), 690V/22A(弹簧接线);

AC-8a: Ue/Ie: 400V/16A;

AS16/ASL16:

AC-3: Ue/Ie: 220/230/240V/15.7A, 400-415V/15.7A, 440V/13.6A, 500V/12.5A, 690V/9A;

AC-4: Ue/Ie: 230V/12.6A, 400-415V/12.4A, 500V/10A, 690V/7.2A;

AC-1: Ue/Ie: 690V/24A(螺钉接线), 690V/22A(弹簧接线);

AC-8a: Ue/Ie: 400V/22A;

注: 此附录与证书同时使用时有效。

主任: _____

陆梅



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



产品认证证书

附录:

证书编号: CQC2007010309251577

第 2 页 共 3 页

纸号: 346459

Us: AC 50/60Hz: 24V, 42V, 48V, 110V, 115V, 220V, 230V, 240V, 400V, 415V;

AC 50Hz: 380V; AC 60Hz: 120V, 277V;

DC: 12V, 24V, 48V, 60V, 110V, 125V, 220V, 240V;

3P

配用辅助触头(本体):

Ue/Ie: AC-15: 24-127V/6A, 220-240V/4A, 380-440V/3A, 500-690V/2A;

DC-13: 24V/6A, 48V/2.8A, 72V/1A, 110V/0.55A, 125V/0.55A, 220-250V/0.3A

注: 此附录与证书同时使用时有效。

主任: 陆梅



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



产品认证证书

附录:


证书编号: CQC2007010309251577

第 3 页 共 3 页

纸号: 346459

型号的解释:

ASL 16-3 0-1 0 S-81

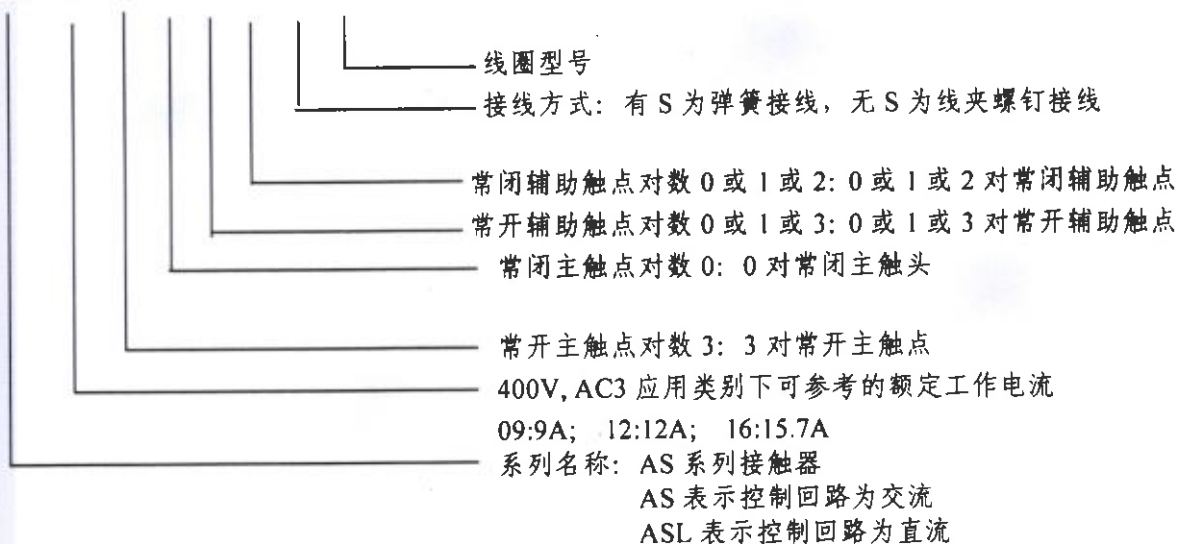

注: 此附录与证书同时使用时有效。

主任: 陆梅



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>