

# 产品认证证书

## II型自愿认证

证书编号: CQC2017010304970103

发证日期: 2021年09月10日

有效期至: 2031年09月10日


委托人名称	ABB Electrification Sweden AB, Motor Starting & Safety
及注册地址	Motorgrand 20, 72161 Vasteras, Sweden
制造商名称	ABB Electrification Sweden AB, Motor Starting & Safety
及注册地址	Motorgrand 20, 72161 Vasteras, Sweden
生产企业名称	ABB 新会低压开关有限公司
及生产地址	广东省江门市新会区今古洲工业开发区
产品名称和系列、规格、型号	接触器 AF2650; Uimp: 8kV; Ui:1140V; Ith: 2650A; AC-1:Ue/Ie:1000V/2650A,1140V/2650A; Us:100~250VAC/DC, 50/60Hz; 3P; 配用的辅助触头:(外置) 1NO1NC,2NO2NC; CAL18-11,CAL18-11B:CQC2009010304365509; Ith:16A; AC-15: Ue/Ie: 24-127V/6A,220-240V/4A,280-440V/3A,500-690V/2A; DC-13: Ue/Ie: 24V/6A,48V/2.8A,72V/1A,125V/0.55A, 250V/0.3A; 规格参数详见附件
产品标准和技术要求	GB/T 14048.4-2020
认证模式	产品型式试验+初次工厂检查+获证后监督

上述产品符合 CQC12-000001-2020 认证规则的要求, 特发此证。

本证书为变更证书, 证书首次颁发日期: 2020年08月14日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

可通过扫描下方二维码或登录国家认监委网站 ([www.cnca.gov.cn](http://www.cnca.gov.cn)) 查验证书信息



授权签字人

签发

刘江

谢肇煦



中国质量认证中心



<http://www.cqc.com.cn>

中国·北京·南四环西路188号9区 100070

电话: +86 10 83886666

C(2) 0104120

# CERTIFICATE OF PRODUCT CERTIFICATION

## TYPE II CQC CERTIFICATION

CERTIFICATE NO.: CQC2017010304970103

Valid from: Sep.10,2021

Valid until: Sep.10,2031


<b>NAME AND REGISTERED ADDRESS OF THE APPLICANT</b>	ABB Electrification Sweden AB, Motor Starting & Safety Motorgrand 20, 72161 Vasteras, Sweden
<b>NAME AND REGISTERED ADDRESS OF THE MANUFACTURER</b>	ABB Electrification Sweden AB, Motor Starting & Safety Motorgrand 20, 72161 Vasteras, Sweden
<b>NAME AND LOCATION OF THE FACTORY</b>	ABB Xinhui Low Voltage Switchgear Co., Ltd. Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China
<b>PRODUCT NAME, MODEL AND SPECIFICATION</b>	Contactors AF2650; Uimp: 8kV; Ui: 1140V; Ith: 2650A; AC-1: Ue/Ie: 1000V/2650A, 1140V/2650A; Us: 100~250VAC/DC, 50/60Hz; 3P; Attached Auxiliary Contacts: 1NO1NC, 2NO2NC; CAL18-11, CAL18-11B: CQC2009010304365509; Ith: 16A; AC-15: Ue/Ie: 24-127V/6A, 220-240V/4A, 280-440V/3A, 500-690V/2A; DC-13: Ue/Ie: 24V/6A, 48V/2.8A, 72V/1A, 125V/0.55A, 250V/0.3A; See the Appendix
<b>THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS</b>	GB/T 14048.4-2020
<b>TYPE OF CERTIFICATION SCHEMES</b>	Type Testing of Product + Initial Factory Inspection + Follow up Factory Inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC12-000001-2020.

Date of original issued: Aug.14,2020

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

The certificate information is available through the QR code below or CNCA's website: [www.cnca.gov.cn](http://www.cnca.gov.cn)



SIGN BY

SIGNATURE



CHINA QUALITY CERTIFICATION CENTRE



# 产品认证证书

## II型自愿认证

证书编号: CQC2017010304970103

第1页 共2页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 104120

上报参数:

AF2650

Uimp: 8kV;

Ui:1140V;

Ith: 2650A;

AC-1:Ue/Ie:1000V/2650A,1140V/2650A;

Us:100~250VAC/DC, 50/60Hz;

3P;

配用的辅助触头:(外置)

CAL18-11,CAL18-11B:CQC2009010304365509;

1NO1NC,2NO2NC;

Ith:16A;

AC-15: Ue/Ie: 24-127V/6A,220-240V/4A,280-440V/3A,500-690V/2A;

DC-13: Ue/Ie: 24V/6A,48V/2.8A,72V/1A,125V/0.55A, 250V/0.3A

型号解释:

AF 2650 - 30 - 00

1 2 3 4

- 1: 产品系列 Product series
- 2: 基本型号 Basic type 2650
- 3: 主触头数量 number of main contacts  
-30=3NO + 0 NC
- 4: 辅助触头数量 Number of auxiliary contacts  
-00 = 0 NO + 0 NC  
-11 = 1 NO + 1 NC



中国质量认证中心



# 产品认证证书

## II型自愿认证


证书编号: CQC2017010304970103

第 2 页 共 2 页

本证书及附件应同时使用, 信息查验说明见证书页

纸号: 104120

-22 = 2 NO + 2 NC

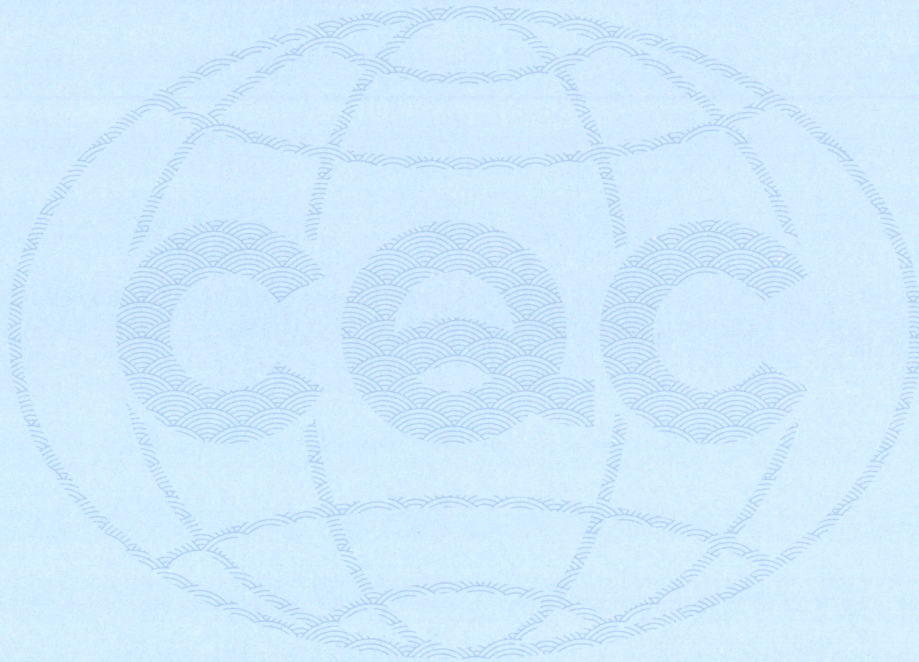

中国质量认证中心

