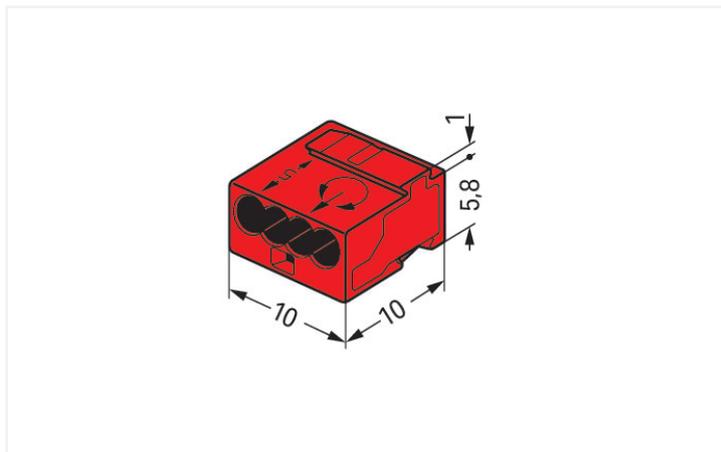# MICRO PUSH WIRE® connector for junction boxes; for solid conductors; max. 0.8 mm Ø; 4-conductor; light gray cover; Surrounding air temperature: max 60°C; red

https://www.wago.com/243-804

**WAGO**



Color: ■ red



Dimensions in mm

Push wire® splicing connector, 243 Series, Push-in

Push wire® splicing connector (item number 243-804) provides seamless electrical installations. WAGO's 243 Series MICRO PUSH WIRE® connectors for junction boxes are perfect for low-voltage installations in buildings. Whether for bell or intercom system wiring, our MICRO junction box connectors stand out thanks to their compact design—perfect for these types of installations. Strip lengths must be between 5 and 6 mm when connecting conductors to push wire® splicing connector. This splicing connector has a rated voltage of 100 V and can handle currents up to 6 A. This product features one conductor terminal and utilizes PUSH WIRE®. Our PUSH WIRE® connection uses the stiffness of the conductor to overcome the clamping spring's contact force, allowing faster and easier conductor clamping. The dimensions are (10 x 6.8 x 10) mm (width x height x depth).

## Notes

| General safety information | **NOTICE: Observe installation and safety instructions!** |
|---|---|
| | • **Only to be used by electricians!** |
| | • Do not work under voltage/load! |
| | • Use only for proper use! |
| | • Observe national regulations/standards/guidelines! |
| | • Observe technical specifications for the products! |
| | • Observe the number of permissible potentials! |
| | • Do not use damaged/dirty components! |
| | • Observe conductor types, cross-sections and strip lengths! |
| | • Insert conductor until it hits the product's backstop! |
| | • Use original accessories! |
| | **To be sold only with installation instructions!** |

## Electrical data

| Ratings per | | EN 60664 | | | General information | |
|---|---|---|---|---|---|---|
| Overvoltage category | III | III | II | | Wiring direction | Side-entry wiring |
| Pollution degree | 3 | 2 | 2 | | | |
| Nominal voltage | - | - | 100 V | | | |
| Rated impulse withstand voltage | - | - | 1.5 kV | | | |
| Rated current | - | - | 6 A | | | |

## Connection data

| | | | |
|---|---|---|---|
| Clamping units | 4 | | |
| Total number of potentials | 1 | | |
| Number of connection types | 1 | | |
| Number of levels | 1 | | |

### Connection 1

| | |
|---|---|
| Connection technology | PUSH WIRE® |
| Actuation type | Push-in |
| Connectable conductor materials | Copper |
| Solid conductor | 22 … 20 AWG |
| Conductor diameter | 0.6 … 0.8 mm / 22 … 20 AWG |
| Conductor diameter (note) | When using conductors of the same diameter, 0.5 mm (24 AWG) or 1 mm (18 AWG) diameters are also possible. |
| Strip length | 5 … 6 mm / 0.2 … 0.24 inches |
| Wiring direction | Side-entry wiring |

## Physical data

| | |
|---|---|
| Width | 10 mm / 0.394 inches |
| Height | 6.8 mm / 0.268 inches |
| Depth | 10 mm / 0.394 inches |

## Material data

| | |
|---|---|
| Note (material data) | Information on material specifications can be found here |
| Color | red |
| Cover color | light gray |
| Fire load | 0.012 MJ |
| Weight | 0.8 g |

## Environmental requirements

| | |
|---|---|
| Ambient temperature (operation) | +60 °C |
| Continuous operating temperature | 105 °C |

## Commercial data

| | |
|---|---|
| PU (SPU) | 1000 (100) pcs |
| Packaging type | Box |
| Country of origin | DE |
| GTIN | 4044918441025 |
| Customs tariff number | 85369010000 |

## Product Classification

| | |
|---|---|
| UNSPSC | 39121409 |
| eCl@ss 10.0 | 27-14-11-04 |
| eCl@ss 9.0 | 27-14-11-04 |
| ETIM 9.0 | EC000446 |
| ETIM 10.0 | EC000446 |
| ECCN | NO US CLASSIFICATION |

## Environmental Product Compliance

| | |
|---|---|
| RoHS Compliance Status | Compliant,No Exemption |

## Approvals / Certificates

### Declarations of conformity and manufacturer's declarations

| Approval | Standard | Certificate Name |
|---|---|---|
| EU-Declaration of Conformity<br>WAGO GmbH & Co. KG | - | - |
| UK-Declaration of Conformity<br>WAGO GmbH & Co. KG | - | - |

## Downloads

### Environmental Product Compliance

**Compliance Search**

| | |
|---|---|
| Environmental Product Compliance 243-804 | ↓ |

## Documentation

**Bid Text**

| | | | |
|---|---|---|---|
| 243-804 | 19.02.2019 | xml<br>3.26 KB | ↓ |
| 243-804 | 17.05.2017 | doc<br>25.00 KB | ↓ |
| ausschreiben.de<br>243-804 | | | ↓ |

## CAD/CAE-Data

**CAD data**

| | |
|---|---|
| 2D/3D Models 243-804 | ↓ |

**CAE data**

| | |
|---|---|
| EPLAN Data Portal<br>243-804 | ↓ |
| WSCAD Universe<br>243-804 | ↓ |
| ZUKEN Portal 243-804 | ↓ |

## 1 Compatible Products

### 1.1 Optional Accessories

#### 1.1.1 Marking

##### 1.1.1.1 Marking strip



**Item No.: 210-332/575-103**
Marking strips; as a DIN A4 sheet; MAR-KED; 1-12 (160x); Height of marker strip: 3 mm; Strip length 182 mm; Horizontal marking; Self-adhesive; white

### 1.1.2 Mounting adapter

#### 1.1.2.1 Mounting accessories



**Item No.: 243-112**
Mounting carrier; for 4 connectors; 243 Series; for DIN-35 rail mounting/screw mounting; orange



**Item No.: 243-113**
Mounting carrier; for 6 connectors; 243 Series; for DIN-35 rail mounting/screw mounting; orange

## Installation Notes

### Conductor termination



Strip solid conductors to 5 ... 6 mm (0.19 ... 0.23 inch).



Termination: Insert the stripped solid conductor until it hits the backstop.



Removal: Hold conductor to be removed and twist alternately left and right while pulling the connector.

### Installation



**Connector strips:**
Assembling modular connectors into connector strips.

Version 11.02.2026

## Commoning



Commoned connector strips

## Testing



Testing via test port opposite to conductor entry.



**The 243 Series can be used in both communication and alarm systems according to the VdS (German Association of Property Insurers) guidelines.**

No general approval is given to PUSH WIRE® connectors by the VdS association. The connectors must be tested together with the different parts of the system. The requirements for connectors are specified in the VdS guidelines for junction boxes (VdS 2116) in section 8.7: "The junction box connectors must be designed to guarantee a reliable and stable connection."

The verification of the fulfillment of these requirements is documented in the VDE test report No. 2574-1440-4031 for the insulated 243 Series PUSH WIRE® Connectors.