



# 中国国家强制性产品认证证书

证书编号：2024010304656668

认证委托人名称及地址

ABB France

11 Rue d' Arsonval 69680, Chassieu, FRANCE

生产者名称及地址

ABB France

11 Rue d' Arsonval 69680, Chassieu, FRANCE

生产企业名称及地址

ABB France

11 Rue d' Arsonval 69680, Chassieu, FRANCE

产品名称和系列、型号、规格

接触器

AF\*26, AF\*30, AF\*38; 具体型号见附页

产品标准和技术要求

GB/T 14048. 4-2020

上述产品符合《强制性产品认证实施规则 低压电器 低压元器件》  
(CNCA-C03-02:2024) 的要求，特发此证。

发证日期：2024 年 07 月 12 日 有效期至：2029 年 07 月 11 日

证书信息和有效性可扫描下方二维码或登录发证机构网站查验，  
也可在认监委网站 ([www.cnca.gov.cn](http://www.cnca.gov.cn)) 查询。



签发：

谢肇煦



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE



中国质量认证中心有限公司



# 中国国家强制性产品认证证书

证书编号: 2024010304656668

证书附页: 第 1 页 共 5 页

AF\*26, AF\*30, AF\*38

Ui: 690V;

Uimp:6kV;

Ith,使用类别及对应的 Ue 和 Ie 见下表

Category	Ue (Vac)	AF26 3P	AF26 4P	AF26 3P	AF30 3P	AF38 3P	AF38 4P
		screw 螺钉 / Push-In 插入 Ring Tongue 环 形	screw 螺钉 / Ring Tongue 环 形	spring 弹 簧	screw 螺钉 / Push-In 插入 Ring Tongue 环 形	screw 螺钉 / Push-In 插入 Ring Tongue 环 形	screw 螺钉 / Ring Tongue 环 形
Ith		50A	55A	35A	50A	50A	55A
AC-1	690	45A	45A	35A	50A	50A	55A
AC-3, AC-3e	220...240	26A	-	26A	33A	40A	-
	380...400	26A	-	26A	32A	38A	-
	415	26A	-	26A	32A	38A	-
	440	26A	-	26A	32A	38A	-
	500	23A	-	23A	28A	33A	-
AC-4	690	17A	-	17A	21A	24A	-
	220...500	23A		23A	23A	23A	
AC-8a	690	17A		17A	17A	17A	
	400	30A	-	30A	40A	50A	-

Us:

AF: Normal Power: 24-60V 50/60Hz ,24-60V 50/60Hz/20-60V DC, 48-130V 50/60Hz/DC, 100-250V 50/60Hz/DC , 250-500V 50/60Hz-DC , Low Power: 12-20VDC, 24-60V 50/60Hz/20-60V DC, 48-130V 50/60Hz-DC, 100-250V 50/60Hz-DC,24VDC;

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



# 中国国家强制性产品认证证书

证书编号：2024010304656668

证书附页：第 2 页 共 5 页

AFC: 220-230V 50Hz / 230-240V 60Hz, 24V 50Hz / 60Hz, 110V 50Hz / 110-120V 60Hz,  
230-240V 50Hz / 240-260V 60Hz

极数:3P,4P;

IP20;

配用辅助触头: (外置)

CA4-\*\*\*, CAT4-\*\*\*, VE4; (CQC2013010304651497)

1NO,1NC,2NO2NC

Ith: 16A;

AC-15:Ue/Ie: 500-690V/2A, 380-440V/3A, 220-240V/4A, 24-127V/6A;

DC-13:Ue/Ie: 600V/0.1A, 500V/0.13A, 400V/0.15A,220-250V/0.27A,

110-125V/0.55A, 72V/1A, 48V/2.8A, 24V/6A;

CAL4-\*\*, CA4-\*\*, CC4-\*\*; (CQC2011010304496319)

1NO,1NC,2NO2NC

Ith: 16A;

AC-15:Ue/Ie: 500-690V/2A, 380-440V/3A, 220-240V/4A, 24-127V/6A;

DC-13:Ue/Ie: 600V/0.1A, 500V/0.13A, 400V/0.15A,220-250V/0.27A,

110-125V/0.55A, 72V/1A, 48V/2.8A, 24V/6A;

本页为证书附页，应与证书主页同时使用。



中国质量认证中心

CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



# 中国国家强制性产品认证证书

证书编号: 2024010304656668

证书附页: 第 3 页 共 5 页

型号的解释(Explanation of / type):

Example 例如: AFS26ZB-30-00RT-21U									
AF	S	26	Z	B	-30	-00	RT	-21	U
I	II	III	IV	V	VI	VII	VIII	IX	X

I - Name of series 系列名称

AF series 系列

II - Application 大小

Blank - Standard applications 空白: 基本型号

S contactor for safety application S: 安全接触器

C contactor with conventional electromagnet 常规电磁铁接触器

III - Range size 大小

26, 30, 38

IV - Coil Type 线圈类型

Blank - Normal Power Coil (NP) 空白-正常功耗线圈(NP)

Z - Low Power Coil (LP) Z-低功耗线圈(LP)

V - Application type 应用类型

Blank - Industrial 空白-工业用

B - Railway / rolling stock B-铁路机车应用

VI - Main Pole Construction

22 - 2 normally opened and 2 normally closed main poles. 2 常开 2 常闭

30 - 3 normally opened and 0 normally closed main poles. 3 常开

40 - 4 normally opened and 0 normally closed main poles. 4 常开

VII - Auxiliary Pole Construction

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



# 中国国家强制性产品认证证书

证书编号: 2024010304656668

证书附页: 第 4 页 共 5 页

00 - 0 normally closed auxiliary pole provided. 无辅助触头

11 - 1 normally opened and 1 normally closed auxiliary poles, side mounting  
1 常开 1 常闭, 侧面安装

22 - 2 normally opened and 2 normally closed auxiliary poles, mounted as 2nd stack (AFS only available with this configuration) 2 常开 2 常闭, 仅用于安全接触器

VIII - Connection type 接线方式

Blank = Screw type connection 空白=螺钉端子接线

S = Spring type connection 弹簧端子接线

K = Push in terminals 插入式端子接线

RT = Ring Tongue connection 环形端子接线

IX - Coil code 线圈代号

Control voltage		Coil code
50/60Hz	DC	
24-60V		41
24-60V	20-60V	11
48-130V	48-130V	12
100-250V	100-250V	13
250-500	250-500	14
-	12-20V	20
24-60V	20-60V	21
48-130V	48-130V	22
100-250V	100-250V	23
-	24V	30

Control Voltage 控制电压	Coil code 线圈代号
-------------------------	-------------------

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



# 中国国家强制性产品认证证书

证书编号：2024010304656668

证书附页：第 5 页 共 5 页

220-230V 50Hz / 230-240V 60HZ	80
24V 50Hz / 60HZ	81
110V 50Hz / 110-120V 60HZ	84
230-240V 50Hz / 240-260V 60HZ	88

X - Blank =All the markets 空白=所有市场

U = For North America markets U=北美市场

本页为证书附页，应与证书主页同时使用。



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



# CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，  
不得单独使用  
This translated document  
does not have legal validity and  
cannot be used in isolation

**CERTIFICATE NO.:** 2024010304656668

**NAME AND ADDRESS OF THE APPLICANT**

ABB France  
11 Rue d'Arsonval 69680, Chassieu, FRANCE

**NAME AND ADDRESS OF THE MANUFACTURER**

ABB France  
11 Rue d'Arsonval 69680, Chassieu, FRANCE

**NAME AND LOCATION OF THE FACTORY**

ABB France  
11 Rue d'Arsonval 69680, Chassieu, FRANCE

**PRODUCT NAME,MODEL AND SPECIFICATION**

Contactor  
AF\*26, AF\*30, AF\*38 ; see the appendix

**STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS**

GB/T 14048.4-2020

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification(REFNO. CNCA-C03-02:2024).

**Valid from:** Jul.12,2024

**Valid until:** Jul.11,2029

The certificate information and validity could be checked by scanning the QR code below or logging in to the website of the issuing authority, or on the website of the CNCA (www.cnca.gov.cn).



SIGNATURE:

谢肇煦



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.





# CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，  
不得单独使用  
This translated document  
does not have legal validity and  
cannot be used in isolation

CERTIFICATE NO. : 2024010304656668

Appendix: Page 1 of 5

AF\*26, AF\*30, AF\*38

Ui: 690V;

Uimp:6kV;

Ith, Utilization Category: Ue/Ie

Category	Ue (Vac)	AF26_3P	AF26_4P	AF26_3P	AF30_3P	AF38_3P	AF38_4P
		screw 螺 钉 / Push-In 插入 Ring Tongue 环 形	screw 螺 钉/ Ring Tongue 环 形	spring 弹 簧	screw 螺 钉/ Push-In 插入 Ring Tongue 环 形	screw 螺 钉/ Push-In 插入 Ring Tongue 环 形	screw 螺 钉/ Ring Tongue 环 形
Ith		50A	55A	35A	50A	50A	55A
AC-1	690	45A	45A	35A	50A	50A	55A
AC-3, AC-3e	220...240	26A	-	26A	33A	40A	-
	380...400	26A	-	26A	32A	38A	-
	415	26A	-	26A	32A	38A	-
	440	26A	-	26A	32A	38A	-
	500	23A	-	23A	28A	33A	-
	690	17A	-	17A	21A	24A	-
AC-4	220...500	23A		23A	23A	23A	
	690	17A		17A	17A	17A	
AC-8a	400	30A	-	30A	40A	50A	-

Us:

AF: Normal Power: 24-60V 50/60Hz ,24-60V 50/60Hz/20-60V DC, 48-130V 50/60Hz/DC, 100-250V 50/60Hz/DC , 250-500V 50/60Hz-DC , Low Power: 12-20VDC, 24-60V 50/60Hz/20-60V DC, 48-130V 50/60Hz-DC, 100-250V 50/60Hz-DC,24VDC;

This page is attached to the certificate and should be used at the same time as the certificate page.



**中国质量认证中心**  
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.



# CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，  
不得单独使用  
This translated document  
does not have legal validity and  
cannot be used in isolation

CERTIFICATE NO. : 2024010304656668

Appendix: Page 2 of 5

AFC: 220-230V 50Hz / 230-240V 60Hz ,24V 50Hz / 60Hz,110V 50Hz / 110-120V 60Hz,  
230-240V 50Hz / 240-260V 60Hz

Poles:3P,4P;

IP20;

Attached Auxiliary Contacts: (extraposition)

CA4-\*\*\*, CAT4-\*\*\*, VE4; (CQC2013010304651497)

1NO,1NC,2NO2NC

Ith: 16A;

AC-15:Ue/Ie: 500-690V/2A, 380-440V/3A, 220-240V/4A, 24-127V/6A;

DC-13:Ue/Ie: 600V/0.1A, 500V/0.13A, 400V/0.15A,220-250V/0.27A,

110-125V/0.55A, 72V/1A, 48V/2.8A, 24V/6A;

CAL4-\*\*, CA4-\*\*, CC4-\*\*; (CQC2011010304496319)

1NO,1NC,2NO2NC

Ith: 16A;

AC-15:Ue/Ie: 500-690V/2A, 380-440V/3A, 220-240V/4A, 24-127V/6A;

DC-13:Ue/Ie: 600V/0.1A, 500V/0.13A, 400V/0.15A,220-250V/0.27A,

110-125V/0.55A, 72V/1A, 48V/2.8A, 24V/6A;

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.



# CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，  
不得单独使用  
This translated document  
does not have legal validity and  
cannot be used in isolation

CERTIFICATE NO. : 2024010304656668

Appendix: Page 3 of 5

型号的解释(Explanation of / type):

Example 例如: AFS26ZB-30-00RT-21U

AF	S	26	Z	B	-30	-00	RT	-21	U
I	II	III	IV	V	VI	VII	VIII	IX	X

I - Name of series 系列名称

AF series 系列

II - Application 大小

Blank - Standard applications 空白: 基本型号

S contactor for safety application S: 安全接触器

C contactor with conventional electromagnet 常规电磁铁接触器

III - Range size 大小

26, 30, 38

IV - Coil Type 线圈类型

Blank - Normal Power Coil (NP) 空白-正常功耗线圈(NP)

Z - Low Power Coil (LP) Z-低功耗线圈(LP)

V - Application type 应用类型

Blank - Industrial 空白-工业用

B - Railway / rolling stock B-铁路机车应用

VI - Main Pole Construction

22 - 2 normally opened and 2 normally closed main poles. 2 常开 2 常闭

30 - 3 normally opened and 0 normally closed main poles. 3 常开

40 - 4 normally opened and 0 normally closed main poles. 4 常开

VII - Auxiliary Pole Construction

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.



# CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，  
不得单独使用  
This translated document  
does not have legal validity and  
cannot be used in isolation

CERTIFICATE NO. : 2024010304656668

Appendix: Page 4 of 5

00 - 0 normally closed auxiliary pole provided. 无辅助触头

11 - 1 normally opened and 1 normally closed auxiliary poles, side mounting  
1 常开 1 常闭，侧面安装

22 - 2 normally opened and 2 normally closed auxiliary poles, mounted as 2nd  
stack (AFS only available with this configuration) 2 常开 2 常闭，仅用于安全接触器

VIII - Connection type 接线方式

Blank = Screw type connection 空白=螺钉端子接线

S = Spring type connection 弹簧端子接线

K = Push in terminals 插入式端子接线

RT = Ring Tongue connection 环形端子接线

IX - Coil code 线圈代号

Control voltage		Coil code
50/60Hz	DC	
24-60V		41
24-60V	20-60V	11
48-130V	48-130V	12
100-250V	100-250V	13
250-500	250-500	14
-	12-20V	20
24-60V	20-60V	21
48-130V	48-130V	22
100-250V	100-250V	23
-	24V	30

Control Voltage	Coil code
控制电压	线圈代号

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.



# CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，  
不得单独使用  
This translated document  
does not have legal validity and  
cannot be used in isolation


CERTIFICATE NO. : 2024010304656668

Appendix: Page 5 of 5

220-230V 50Hz / 230-240V 60HZ	80
24V 50Hz / 60HZ	81
110V 50Hz / 110-120V 60HZ	84
230-240V 50Hz / 240-260V 60HZ	88

X - Blank =All the markets 空白=所有市场

U = For North America markets U=北美市场

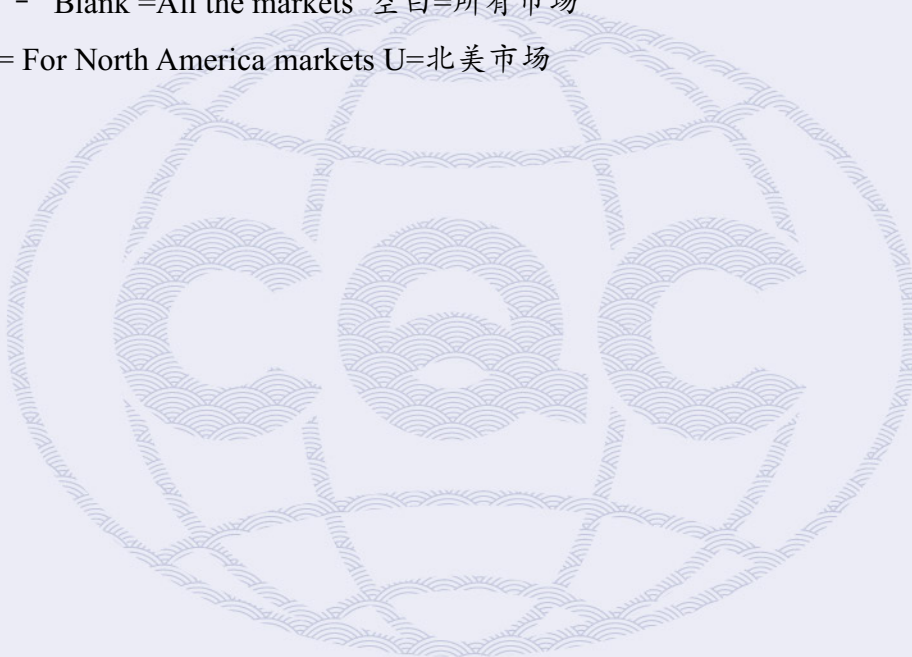

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.